


**Amerimax Exterior Home Products Alumawood™ Patio Cover, Carport and Commercial Structure Engineering 2019 CBC**

PAGES	DRAWING	SECTION DESCRIPTION
2 PAGES	GN01-2019CBC GN02-2019CBC	GENERAL NOTES
1 PAGE		PROFESSIONAL ENGINEERING STAMPS PAGE
2 PAGES	SC01-2018 SC02-2018	SOLID PANEL STRUCTURAL CONFIGURATIONS ALUMAWOOD STRUCTURAL CONFIGURATIONS
4 PAGES		SECTION 1.0 RAFTER SPANS FOR COMMERCIAL AND PATIO STRUCTURES
38 PAGES		SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS
4 PAGES	LT01-2018 LT02-2018 LT03-2018 LT04-2018	COMPONENT PARTS AND CONNECTION DETAILS FOR LATTICE STRUCTURES
7 PAGES		SECTION 4.0 SOLID COVER PANEL SPANS FOR COMMERCIAL AND PATIO STRUCTURES
51 PAGES		SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS
4 PAGES	NP01-2018 NP02-2018 NP03-2018 NP04-2018	COMPONENT PARTS AND CONNECTION DETAILS FOR NEWPORTS
9 PAGES	CD01-2018 CD02-2018 CD03-2018 CD04-2018 CD05-2018 CD06-2018 CD07-2018 CD08-2018 CD09-2018	COMPONENT PARTS AND CONNECTION DETAILS
11 PAGES	Misc1a-2018 Misc1b-2018 Misc2-2018 Misc3-2018 Misc4a-2018 Misc4b-2018 Misc5a-2018 Misc5b-2018 Misc6-2018 Misc7-2018 Misc8-2018	MISCELLANEOUS DETAILS MISCELLANEOUS DETAILS FAN BEAM DETAILS 7.0 POST AND FASTENER REQUIREMENTS FOR ALL STRUCTURES 7.0 ALTERNATIVE FOOTING TABLES 7.0 ALTERNATIVE FOOTING TABLES 7.0 REQUIREMENTS FOR SURFACE MOUNTED POSTS ON CONCRETE SLABS OR FOOTINGS 7.0 REQUIREMENTS FOR SURFACE MOUNTED POSTS ON CONCRETE SLABS OR FOOTINGS 7.0 FORCES ON EXISTING STRUCTURES STRUCTURAL PROPERTIES OF BEAMS, FASCIA, PANELS AND RAFTERS FOR USE BY DESIGN PROFESSIONALS CONCRETE SLAB REQUIREMENTS FOR CONSTRAINED FOOTINGS

Live/Ground Snow Loads: 10-60 psf  
Wind Speeds: 95- 130 mph

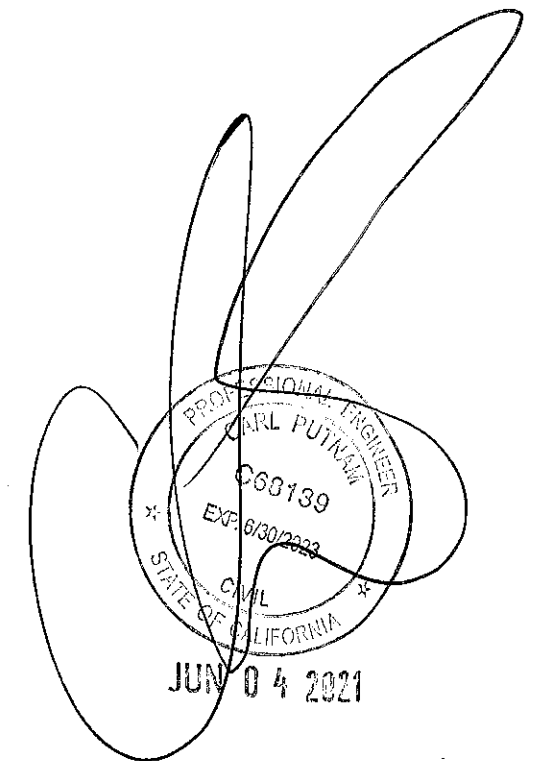

December 9, 2019

**GENERAL NOTES:**

1. DESIGNED IN ACCORDANCE WITH THE 2019 CALIFORNIA BUILDING CODE.
2. ALUMINUM DESIGN IN ACCORDANCE WITH THE 2015 EDITION OF ALUMINUM ASSOCIATION'S SPECIFICATIONS AND CHAPTER 20 OF THE INTERNATIONAL BUILDING CODE.
3. DESIGN LOADINGS:  $C_t = 1.2$ ,  $I = 1.0$ ,  $C_e = 1.0$  (ALL EXPOSURES EXCEPT B AND C WHEN LOCATED TIGHT AMONG CONIFERS)

GROUND SNOW LOAD	DESIGN LOAD
10 PSF	10 PSF LIVE LOAD ONLY
15 PSF	15 PSF DESIGN ROOF SNOW LOAD
20 PSF	20 PSF LIVE LOAD ONLY
25 PSF	21.0 PSF DESIGN ROOF SNOW LOAD
30 PSF	25.2 PSF DESIGN ROOF SNOW LOAD
35.7 PSF	30.0 PSF DESIGN ROOF SNOW LOAD
42 PSF	35.3 PSF DESIGN ROOF SNOW LOAD
50 PSF	42.0 PSF DESIGN ROOF SNOW LOAD
60 PSF	50.4 PSF DESIGN ROOF SNOW LOAD

FOR  $0.25/12 < \text{SLOPE} < 1/12$

WIND SPEEDS IN THE 2018 IBC ARE "ULTIMATE DESIGN WIND SPEED". ALL STRUCTURES DESCRIBED IN THIS REPORT ARE DESIGNED USING PRESSURES CALCULATED FROM "ULTIMATE DESIGN WIND SPEEDS" FOR RISK CATEGORY II. FOR ATTACHED STRUCTURES THE MAXIMUM MEAN ROOF HEIGHT OF THE EXISTING STRUCTURE IS 30'.  $K_{zt}$  WAS ASSUMED AS 1.0 FOR ALL WIND LOADS. SITE LOCATIONS REQUIRING HIGHER A HIGHER  $K_{zt}$  VALUE (ISOLATED HILLS, RIDGES, ESCARPMENTS) WILL REQUIRE HIGHER WIND LOADS AS PER ASCE7-16 SECTION 26.8 AND ARE OUTSIDE THE SCOPE OF THIS REPORT.

NOTE: EXPOSURE B: SHALL APPLY WHEN THE GROUND SURFACE ROUGHNESS CATEGORY B (URBAN AND SUBURBAN AREAS, WOODED AREAS, OR OTHER TERRAIN W/ NUMEROUS CLOSELY SPACED OBSTRUCTIONS HAVING THE SIZE OF A SINGLE FAMILY DWELLING OR LARGER) PREVAILS IN THE UPWIND DIRECTION FOR A DISTANCE OF AT LEAST 1500 FT.

EXPOSURE C: SHALL APPLY WHEN EXPOSURE B AND D (SMOOTH MUD FLATS, SALT FLATS, UNBROKEN ICE AND OTHER) DO NOT.

**SEISMIC LOADING**

MAXIMUM  $S_s = 150\%$  SHOWN IN 2019 CBC FIGURE 1613.2.1(1)

$S_s > 150\%$  ARE NOT REQUIRED AS PER ASCE7-16 12.8.1.3 FOR  $S_s < 215\%$

S1 NOT APPLICABLE TO THESE STRUCTURES

SITE CLASS = D

BASIC SEISMIC FORCE RESISTING SYSTEM

POSTS EMBEDDED INTO FOOTINGS = ORDINARY STEEL MOMENT FRAME >>  $R = 1.25$

POSTS SURFACE MOUNTED = GENERIC SYSTEM >>  $R = 1.25$

ANALYSIS PROCEDURE = EQUIVALENT LATERAL FORCE PROCEDURE

THESE ROOFS ARE NOT SUBJECT TO MAINTENANCE WORKERS AND HAVE NOT BEEN EVALUATED FOR A CONCENTRATED 300 LBF LOAD.

THE BASIS OF THE DESIGN FORCES ARE IN ACCORDANCE WITH THE BASIC LOAD COMBINATIONS DESCRIBED IN 2019 CBC SECTION 1605.3.1 AND NO FURTHER INCREASES ARE PERMITTED FOR PATIO COVERS RESISTING WIND OR SEISMIC FORCES.

4. THIS ENTIRE ENGINEERING PACKAGE IS NOT REQUIRED FOR MOST BUILDING PERMITS. SUBMISSION FOR A BUILDING PERMIT MUST INCLUDE:

- a. GENERAL NOTES (2 PAGES)
- b. STRUCTURAL CONFIGURATIONS (1 OR 2 PAGES)
- c. RAFTER SPAN TABLES (FOR LATTICE STRUCTURES), PANEL SPAN TABLES FOR SOLID COVER STRUCTURES) OR BOTH (FOR COMBINATION STRUCTURES)
- d. HEADER POST SPACING, FOOTING SIZE AND POST TABLE FOR LIVE/SNOW AND WIND LOAD
- e. ALL APPROPRIATE DETAILS
- f. OTHER DOCUMENTATION REQUIRED BY LOCAL BUILDING AUTHORITY.

5. CONCRETE MIX: CONCRETE WILL MEET THE DURABILITY REQUIREMENTS OF ACI 318-14. PATIO STRUCTURES MAY BE ATTACHED TO CONCRETE SLAB WITHOUT FOOTINGS WHEN THE POST LOAD IS 750# OR LESS AND THE FROST DEPTH IS ZERO. CONCRETE SHALL BE A MINIMUM OF 3.5 INCHES THICK AND NO CRACKS WITHIN 2'-6" OF POSTS. POSTS AND CONCRETE ANCHORS SHALL BE SET BACK A MINIMUM OF 4 INCHES FROM EDGE OR EXPANSION JOINT OF A SLAB.


6. FOOTINGS HAVE BEEN DESIGNED FOR CLASS 5 SOIL AS PER 2018 IBC TABLE 1806.2. ALLOWABLE FOUNDATION PRESSURE IS 1500 POUNDS PER SQUARE FOOT. LATERAL BEARING PRESSURE IS 100 PSF/FT AND IS DOUBLED PER 2019 CBC SECTION 1806.3.4. THESE DESIGN VALUES DO NOT APPLY TO MUD, ORGANIC SILTS, ORGANIC CLAYS, PEAT OR UNPREPARED FILLS AND MAY REQUIRE FURTHER SOIL INVESTIGATION. THE BUILDING OFFICIAL MAY ASSIGN A LOAD BEARING CAPACITY. UNITS IN SNOW/LIVE LOAD AREA OF 25 PSF OR LESS MAY BE BUILT ON 1000 PSF BEARING SOIL W/O ADDITIONAL ENGINEERING. MINIMUM FOOTING DEPTH IS THE LOCAL FROST DEPTH.

7. 20 PSF AND HIGHER LIVE LOAD STRUCTURES MAY BE USED AS COVERS FOR PARKING OF MOTOR VEHICLES. CARPORTS MUST HAVE AT LEAST TWO OPEN SIDES AND HAVE FLOOR SURFACES MADE OF APPROVED NONCOMBUSTIBLE MATERIAL OR ASPHALT.

8. AT LEAST ONE HORIZONTAL DIMENSION (PROJECTION OR WIDTH) OF COVER SHALL BE LESS THAN 30'.

9. ALL STEEL SHALL BE GALVANIZED ASTM A-653 G90, A123 G45 OR A153 B-3, PAINTED ASTM A755 OR USE AN APPROVED COATING COMPLYING WITH 2019 CBC SECTION 2203.1.

10. ALTERNATE ALUMINUM ALLOYS OF EQUAL OR HIGHER STRENGTHS MAY BE USED. 3004H2x ALUMINUM MAY BE SUBSTITUTED FOR 3004H3x.

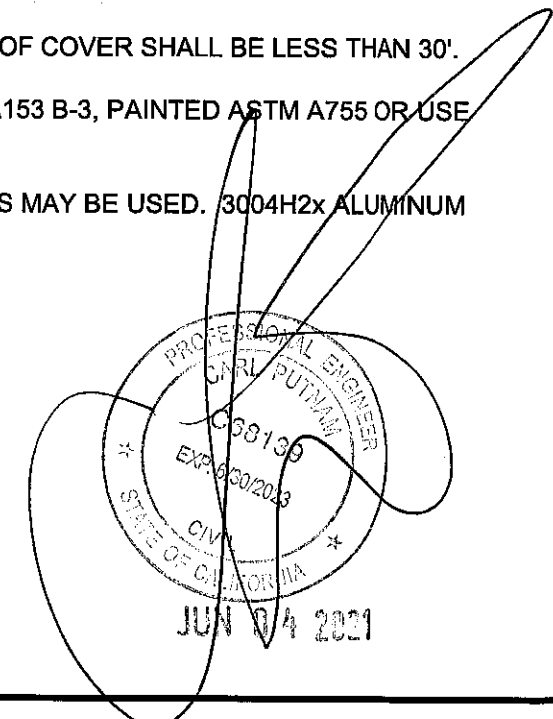

<b>Amerimax</b> <sup>™</sup>		28921 US Hwy 74 Romoland, CA 92585	
EXTERIOR HOME PRODUCTS			
DRAWN BY:	CMP		
SCALE:	NONE	DRAWING OR PART NAME:	GENERAL NOTES
DATE:		DRAWING OR PART NUMBER:	GN01-2019CBC
			SHEET 1 OF 2

**GENERAL NOTES:**  
(CONTINUED FROM SHEET NO. 1)

11. STEEL FASTENERS SHALL BE EITHER STAINLESS (3000 SERIES), GALVANIZED OR DOUBLE CADMIUM PLATED. BOLTS SHALL BE ASTM A-307 HOT DIPPED GALVANIZED, MECHANICALLY GALVANIZED, ZINC ELECTROPLATED, ALUMINIZED OR 300 SERIES STAINLESS STEEL. CONCRETE ANCHOR BOLTS ARE SPECIFIED IN THE DETAILS. ALL WOOD SCREWS MUST COMPLY WITH ANSI/ASME STANDARD B18.6.1 AND AWC NDS-18 12.1.5. ALL LAG SCREWS MUST COMPLY WITH ANSI/ASME B18.2.1 AND AWC NDS-18 12.1.4. ALL STEEL WASHERS TO BE ASTM F844 W/ DIMENSIONS IN ACCORDANCE WITH ASME B18.22.1, TYPE A. ALL STEEL NUTS TO BE ASTM A563. THE MINIMUM WASHER DIAMETER SHALL BE 1" FOR BOLTED CONNECTIONS. SCREWS AND BOLTS WILL HAVE A MINIMUM EDGE DISTANCE OF 2X FASTENER DIAMETER.

12. EMBEDDED POST SURFACES SHALL BE CLEAN AND FREE FROM OILY SURFACES.

13. HEADER SPLICES SHALL NOT BE LOCATED NEARER TO THE END OF THE STRUCTURE THAN THE FIRST INTERIOR POST. (EXCEPT FOR FULL STRENGTH SPLICES) FULL STRENGTH SPLICES (DETAILS U, AND X) MAY BE LOCATED ANYWHERE.

14. ALL SELF DRILLING AND SELF TAPPING SCREWS MUST COMPLY TO ICC- ESR 1271, 1408, 1976, 2196, 3006, 3215, 3223, 3231, 3294, 3332, 3528, 3558 OR EQUIVALENT AND USE HEADS W/ DIAMETERS EQUAL TO #8 =  $\frac{5}{16}$ ", #10 =  $\frac{3}{8}$ ", #12 =  $\frac{13}{32}$ " AND #14 =  $\frac{1}{2}$ " OR STEEL WASHERS OF SIMILAR DIAMETER AND AS PER GENERAL NOTE #11

15. STRUCTURES MAY NOT BE ENCLOSED IN ANY MANNER WITHOUT ADDITIONAL ENGINEERING ANALYSIS OR APPROVAL OF THE LOCAL BUILDING AUTHORITY.

16. ALUMINUM SOLID ROOF PANELS ARE CLASS A FIRE RATED AS INDICATED BY THE EXCEPTION #2 IN 2018 IBC SECTION 1505.2. ALUMINUM IS A NONCOMBUSTIBLE MATERIAL AS PER 2019 CBC CHAPTER 20 AND THE ALUM ASSOC. 2015 ALUMINUM DESIGN MANUAL (AA ADM 1) PART III SECTION 7.

17. STRUCTURES MAY BE ATTACHED TO EAVE OVERHANGS PER SCHEDULE.

18. WHERE ALUMINUM ALLOY PARTS ARE IN CONTACT WITH DISSIMILAR METALS (OTHER THAN STAINLESS, ALUMINIZED OR GALVANIZED STEEL) OR ABSORBENT BUILDING MATERIALS, LIKELY TO BE CONTINUOUSLY OR INTERMITTENTLY WET, THE FAYING SURFACES SHALL BE PAINTED OR OTHERWISE SEPARATED IN ACCORDANCE WITH THE ALUMINUM DESIGN MANUAL PART I SECTION M7.1 OR M7.2.

19. WHEN A SINGLE SPAN ATTACHED UNIT HAS POSTS ATTACHED TO A WOODEN DECK, THE MAXIMUM DEAD LOAD + ROOF LOAD FROM THE PATIO COVER IS 750 LBS AND THE POST SPACING SHALL NOT EXCEED THAT SPECIFIED FOR ATTACHING TO A CONCRETE SLAB. THE MAXIMUM CONNECTION UPLIFT LOAD IS 1162 LBS FOR 115 MPH EXP C WIND SPEED. CONNECTIONS ARE FOR MAXIMUM PATIO ROOF HEIGHTS OF 12 FT FROM GRADE. THE EXISTING DECK STRUCTURE MUST BE ADEQUATE TO SUSTAIN THESE ADDITIONAL LOADS. THE STRUCTURAL ADEQUACY OF THE DECK TO SAFELY SUSTAIN THESE ADDITIONAL LOADS WILL REQUIRE APPROVAL BY LOCAL BUILDING AUTHORITY OR ADDITIONAL ENGINEERING. SEE DETAIL L13, N12 OR AL. CONSTRUCTION OUTSIDE OF THESE PARAMETERS MAY REQUIRE ADDITIONAL ENGINEERING.

20. All structures must comply with one of the following:
- a. All structures with a roof snow load of 30 psf or less may be built in Seismic Design Category (SDC) A-D up to the maximum Ss noted in General Note #3.
  - b. Structures with flat roof design snow loads over 30 psf complying with CBC Section 1613.1 Exception #1 do not require additional seismic analysis.
  - c. Structures not complying with (a) or (b) must have constrained footings and are limited to the Ss shown in Sections 2.0 or 5.0.

21. DRIFTING SNOW IS ADDRESSED IN DETAIL M4. SLIDING SNOW IS BEYOND THE SCOPE OF THIS REPORT.


22. ALL MULTISPAN TABLES AND DETAILS ASSUME EQUAL SPANS WITHIN 20%. ALL SPECIFICATIONS MUST BE BASED ON LONGEST ACTUAL SPAN.

23. WOOD USED IN CONNECTIONS SHALL BE PROTECTED FROM WEATHER AS PER IBC SECTION 1402.2 (WALLS) AND/OR 1503 (ROOFS), WHICHEVER IS MORE APPROPRIATE.





24. AT LEAST ONE HORIZONTAL DIMENSION OF A FREESTANDING COVER (PROJECTION OR WIDTH) SHALL BE LESS THAN 30'

**GENERAL NOTES FOR LATTICE STRUCTURES:**  
(PERTAINS TO LATTICE STRUCTURES ON DRAWINGS SC02-2018 AND LT01-2018 THRU LT04-2018.)



- 1. SEE GENERAL NOTE #3 FOR LIVE AND SNOW LOADS.
- 2. NOTE INTENTIONALLY LEFT BLANK.
- 3. SINGLE SPAN ATTACHED LATTICE STRUCTURES THAT DO NOT USE DETAIL L29 MUST COMPLY WITH TABLE L1 AND L2 ON SHEET M5.

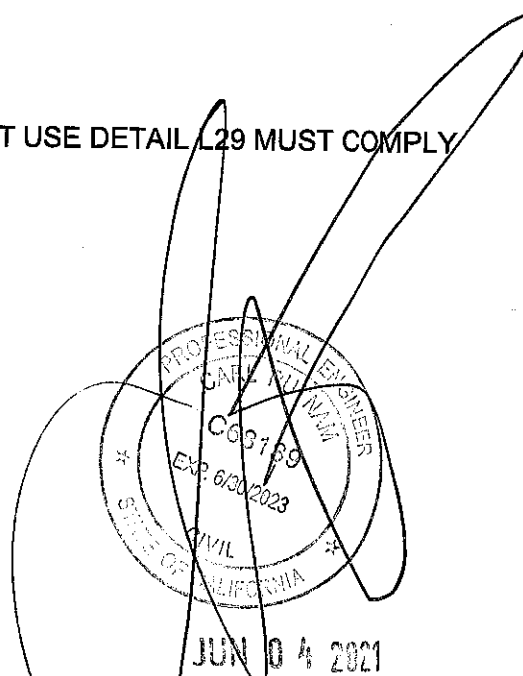


<b>Amerimax</b> <sup>™</sup>		28921 US Hwy 74	
EXTERIOR HOME PRODUCTS		Romoland, CA 92585	
DRAWN BY:	CMP		
SCALE:	NONE	DRAWING OR PART NAME:	GENERAL NOTES
DATE:		DRAWING OR PART:	GN02-2019CBC
			SHEET 2 OF 2

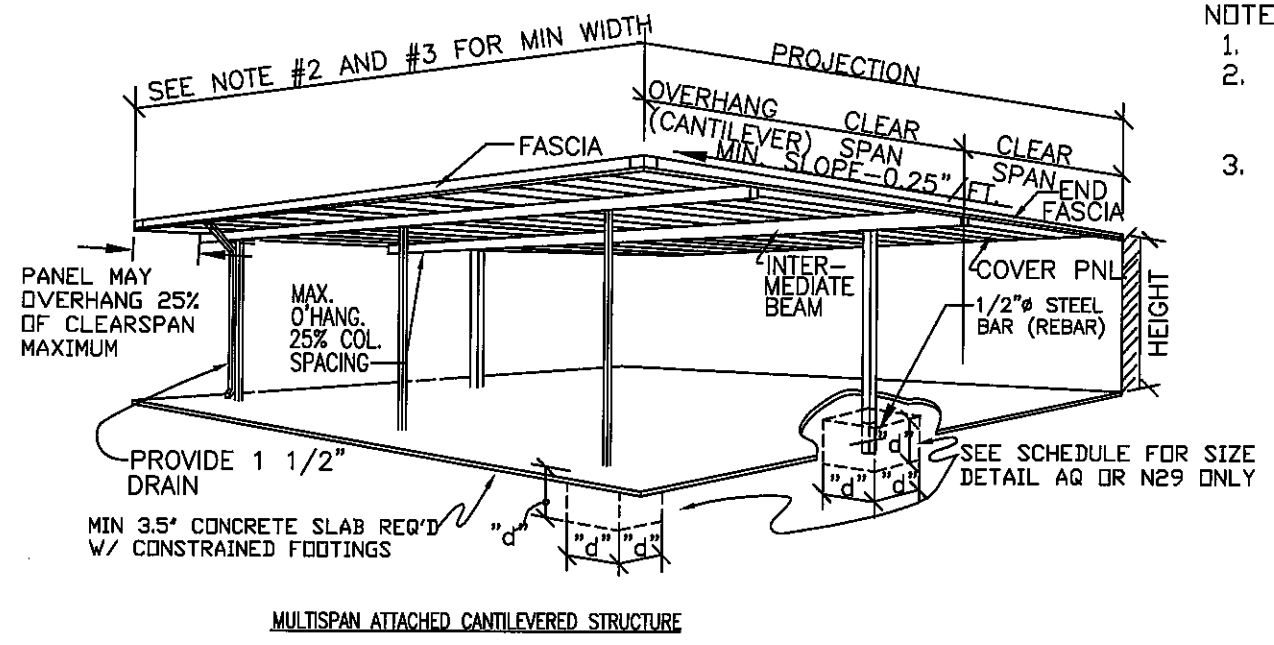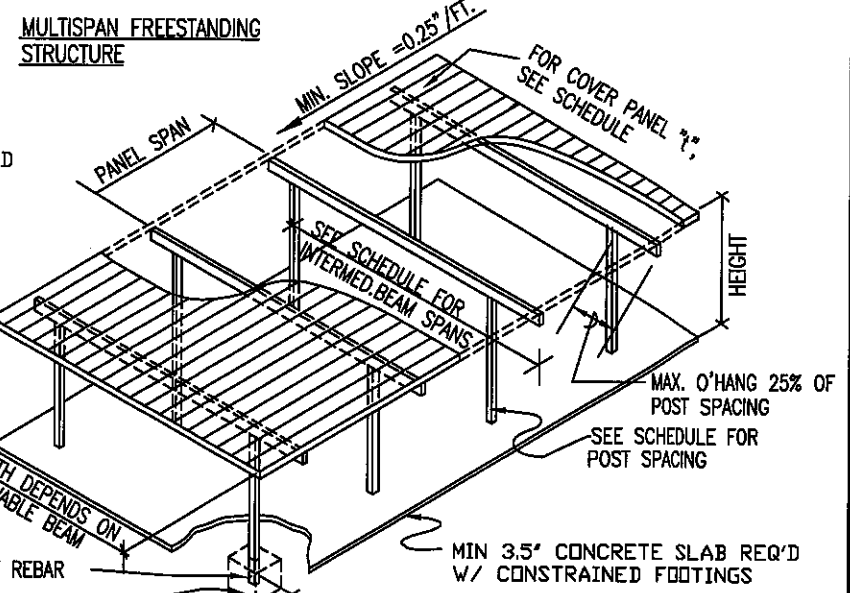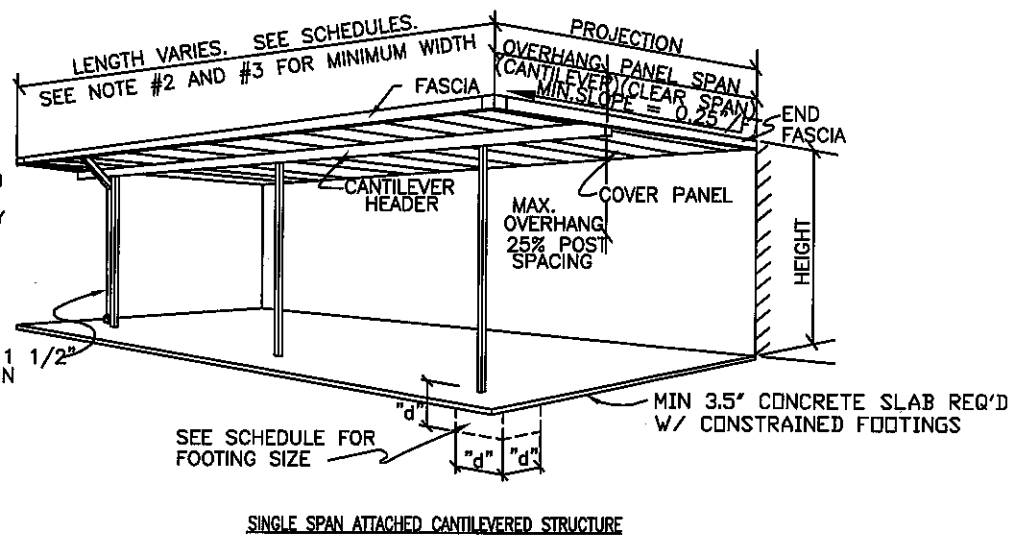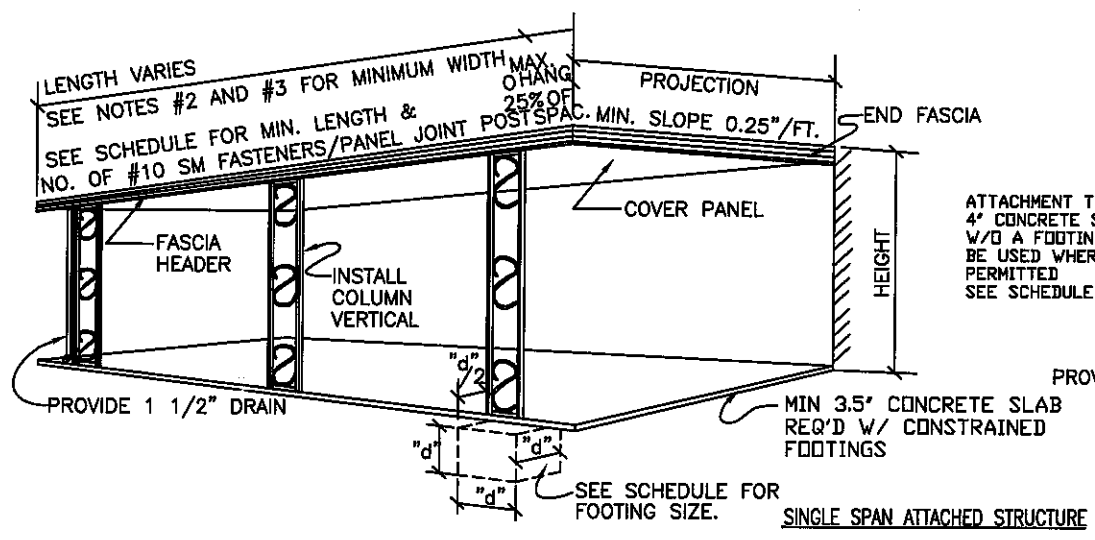

- NOTES:
1. SEE SCHEDULES FOR POST SPACING
  2. MIN WIDTH IS 100% OF PROJECTION FOR WIND SPEEDS UP TO 115 MPH EXP C. HIGHER WIND SPEEDS MUST BE 150%
  3. THERE IS NO MINIMUM WIDTH IF USING CONSTRAINED FOOTINGS AND DETAILS N29, AQ OR M5.





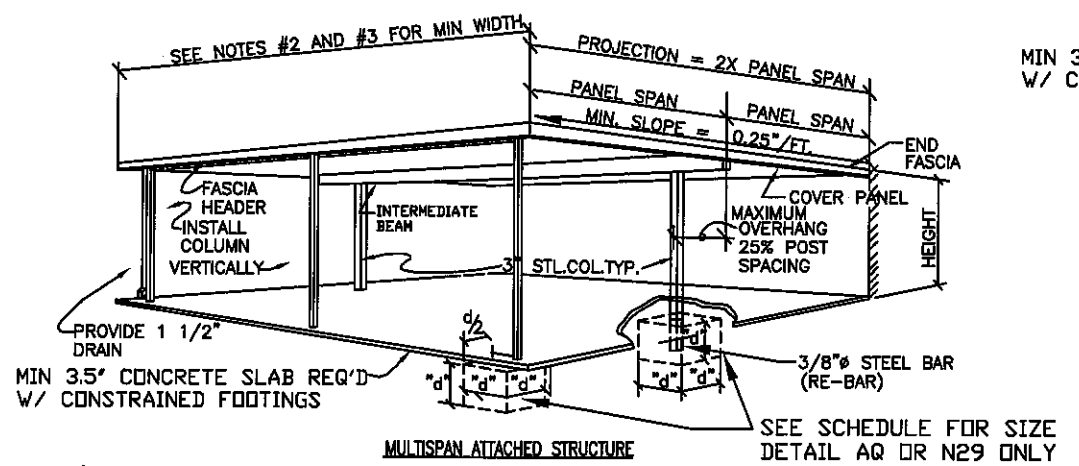
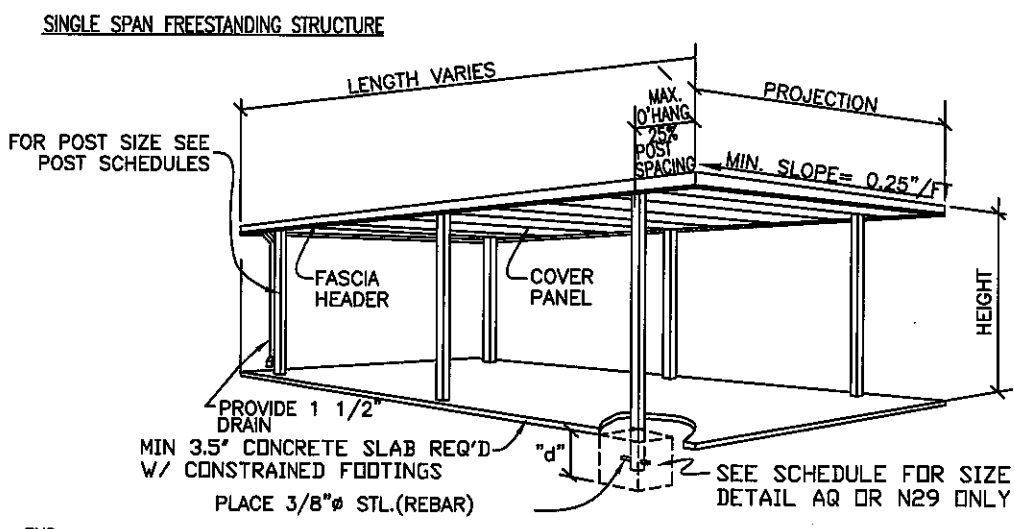


PATIO COVERS ARE LIMITED TO 12' HEIGHT. CARPORTS AND COMMERCIAL STRUCTURES ARE LIMITED TO 15' HEIGHT.

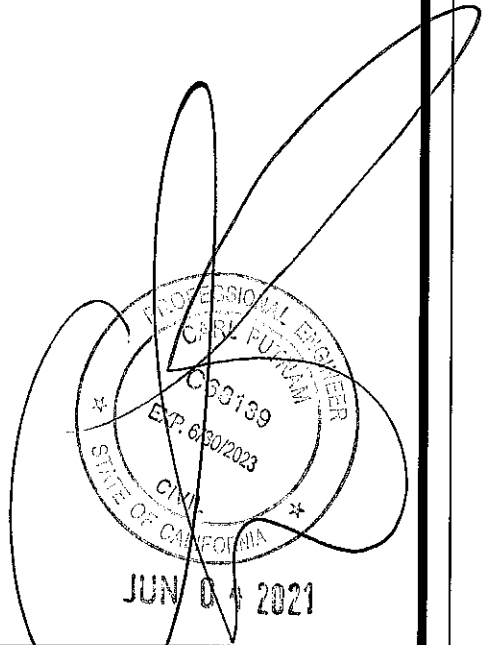

<b>Amerimax</b>		28921 US Hwy 74 Romoland, CA 92585	
EXTERIOR HOME PRODUCTS			
DRAWN BY:	CMP	DRAWING OR PART NAME	SOLID PANEL STRUCTURAL CONFIGURATIONS
SCALE:	NONE	DRAWING OR PART NUMBER	SC01-2018
DATE:			SHEET 1 OF 2



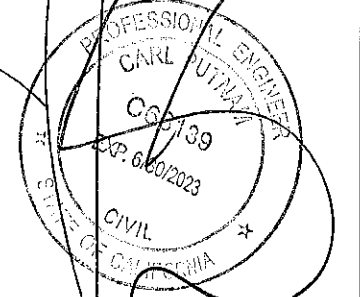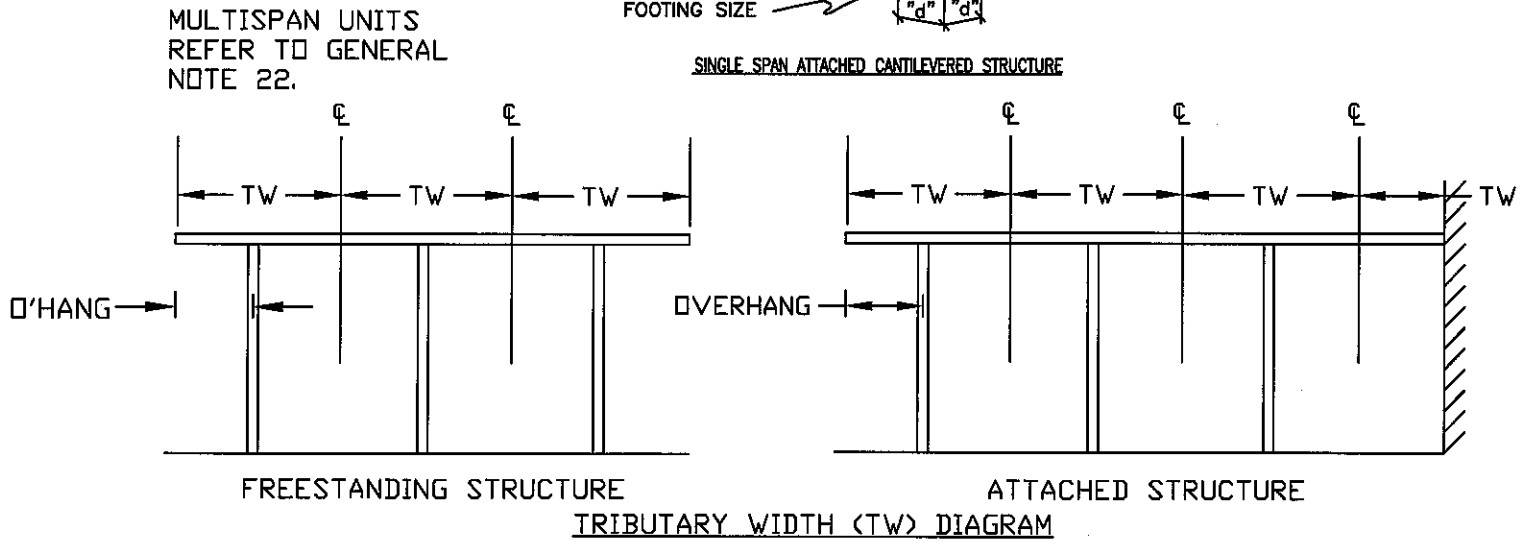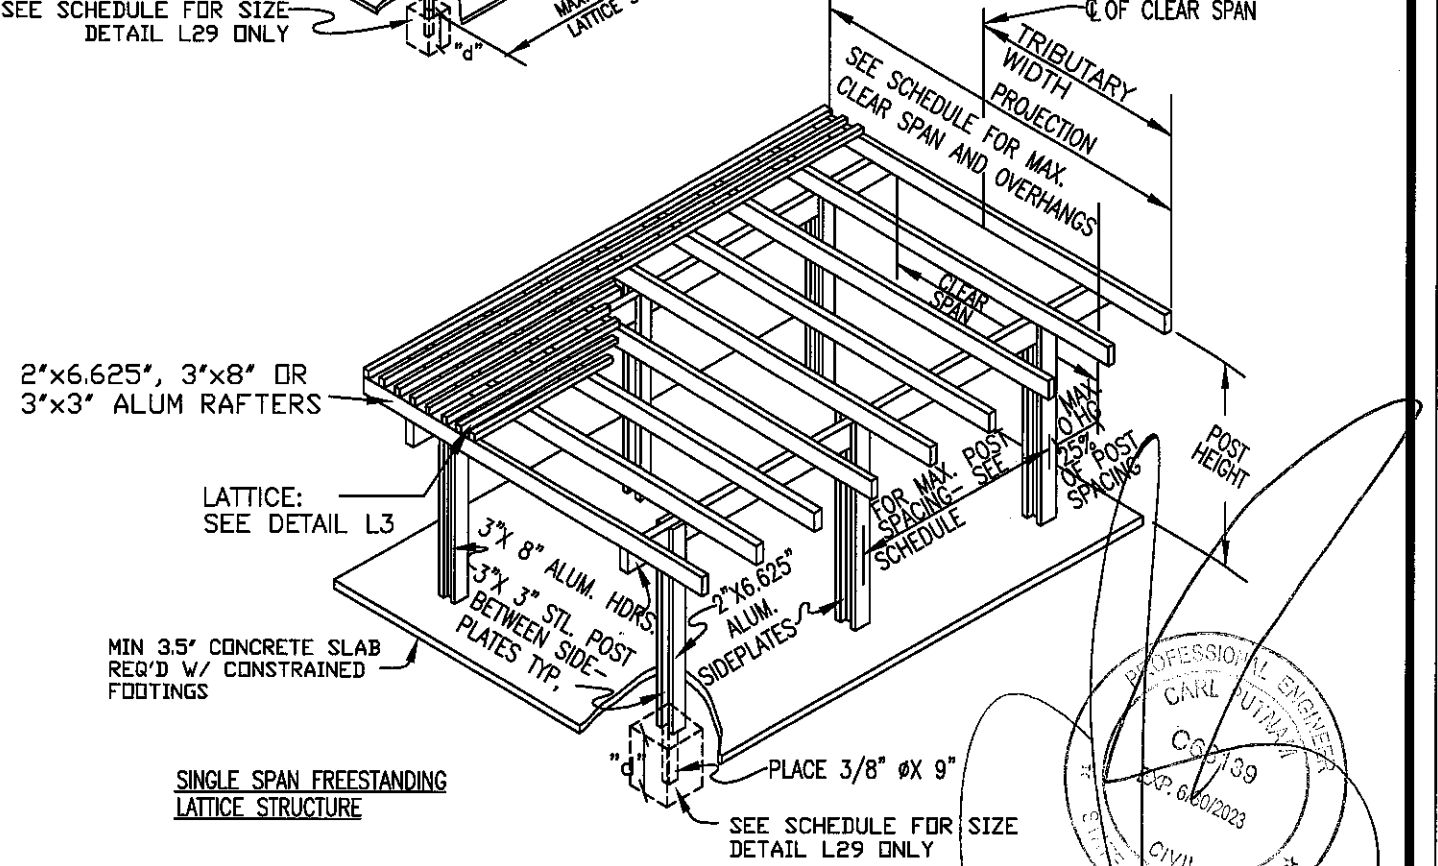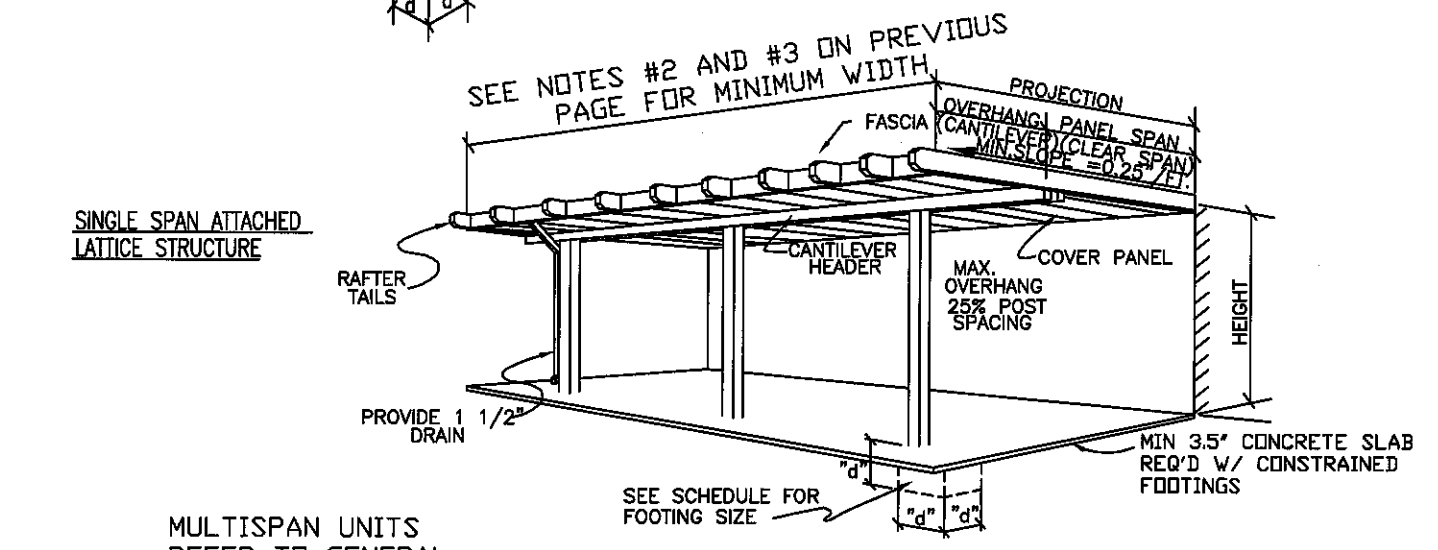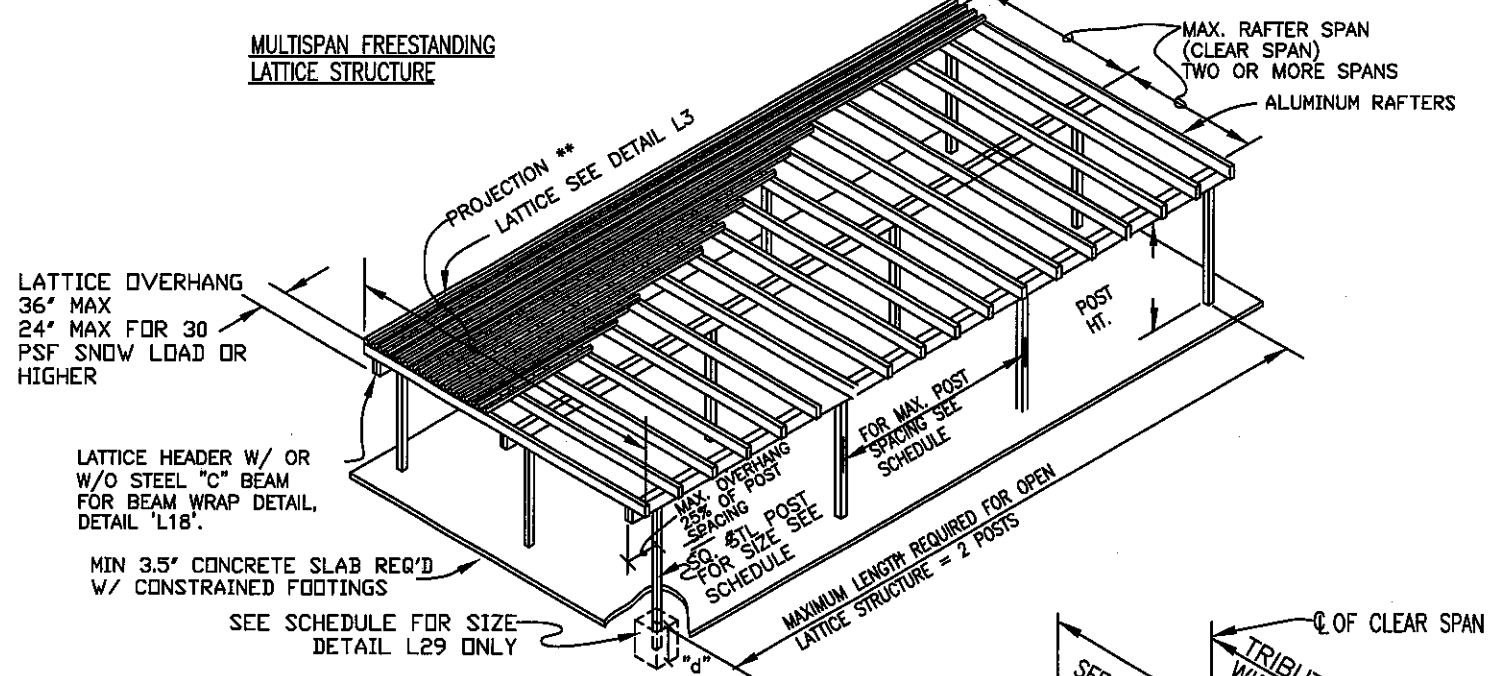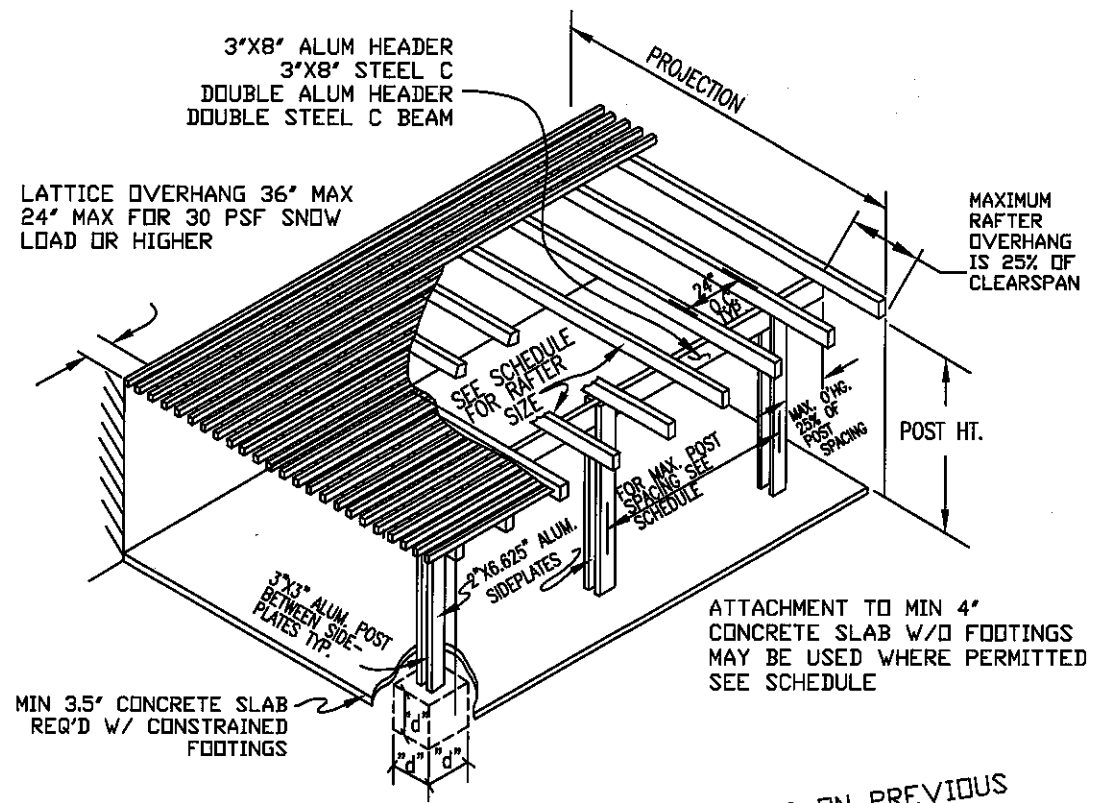

**Amerimax** 28921 US Hwy 74  
 EXTERIOR HOME PRODUCTS Romoland, CA 92585

DRAWN BY: CMP	DRAWING OR PART NAME: ALUMAWOOD STRUCTURAL CONFIGURATIONS		SHEET: 2 OF 2
SCALE: NONE	DRAWING OR PART NUMBER: SC02-2018		
DATE:			



SECTION 1.0 RAFTER SPANS FOR COMMERCIAL AND PATIO STRUCTURES

0.024"x2"x6.625" Rafter (Single Span)

Ground Snow Load (psf)	Rafter Spacing (in)	Wind Speed and Exposure						
		Exp B			Exp C			
		120	130	140	100	110	115	115
10	24"	8'-9"	8'-9"	8'-9"	8'-9"	8'-9"	8'-9"	8'-9"
LIVE	20"	10'-6"	10'-6"	10'-2"	10'-6"	10'-6"	10'-6"	10'-6"
	16"	13'-0"	12'-5"	11'-5"	13'-0"	12'-5"	11'-9"	11'-9"
	12"	15'-1"	14'-1"	13'-1"	14'-1"	14'-1"	13'-6"	13'-6"

Exposure C

Ground Snow Load (psf)	Rafter Spacing (in)	Wind Speed and Exposure						
		Exposure C						
		120	130	140	150	160	170	170
10	24"	8'-9"	7'-8"	6'-4"	6'-4"	5'-5"	4'-2"	4'-2"
LIVE	20"	10'-0"	9'-2"	7'-10"	7'-10"	6'-7"	4'-11"	4'-11"
	16"	11'-3"	10'-3"	9'-5"	9'-5"	8'-5"	6'-2"	6'-2"
	12"	12'-11"	11'-10"	10'-10"	10'-10"	8'-5"	6'-2"	6'-2"

TABLE 1.4

0.032"x2"x6.625" Rafter (Single Span)

Ground Snow Load (psf)	Rafter Spacing (in)	Wind Speed and Exposure						
		Exp B			Exp C			
		120	130	140	100	110	115	115
10	24"	14'-10"	13'-11"	12'-11"	14'-10"	13'-10"	13'-3"	13'-3"
LIVE	20"	16'-2"	15'-2"	14'-0"	16'-2"	15'-1"	14'-5"	14'-5"
	16"	18'-0"	16'-9"	15'-7"	18'-0"	16'-9"	16'-0"	16'-0"
	12"	20'-8"	19'-1"	17'-8"	20'-8"	19'-1"	18'-3"	18'-3"

Exposure C

Ground Snow Load (psf)	Rafter Spacing (in)	Wind Speed and Exposure						
		Exposure C						
		120	130	140	150	160	170	170
10	24"	12'-8"	11'-8"	10'-10"	10'-10"	10'-1"	8'-10"	8'-10"
LIVE	20"	13'-10"	12'-9"	11'-10"	11'-10"	11'-0"	9'-8"	9'-8"
	16"	15'-4"	14'-1"	13'-1"	13'-1"	12'-2"	10'-9"	10'-9"
	12"	17'-5"	16'-1"	14'-11"	14'-11"	13'-10"	12'-2"	12'-2"

TABLE 1.5

0.040"x2"x6.625" Rafter (Single Span)

Ground Snow Load (psf)	Rafter Spacing (in)	Wind Speed and Exposure						
		Exp B			Exp C			
		120	130	140	100	110	115	115
10	24"	18'-4"	17'-7"	16'-3"	18'-4"	17'-7"	16'-9"	16'-9"
LIVE	20"	20'-0"	19'-2"	17'-9"	20'-0"	19'-2"	18'-3"	18'-3"
	16"	22'-3"	21'-3"	19'-8"	22'-3"	21'-3"	20'-3"	20'-3"
	12"	25'-5"	24'-3"	22'-5"	25'-5"	24'-2"	23'-1"	23'-1"

Exposure C

Ground Snow Load (psf)	Rafter Spacing (in)	Wind Speed and Exposure						
		Exposure C						
		120	130	140	150	160	170	170
10	24"	16'-1"	14'-10"	13'-9"	13'-9"	12'-9"	11'-3"	11'-3"
LIVE	20"	17'-6"	16'-1"	14'-11"	14'-11"	13'-11"	12'-3"	12'-3"
	16"	19'-5"	17'-10"	16'-7"	16'-7"	15'-5"	13'-7"	13'-7"
	12"	22'-1"	20'-4"	18'-10"	18'-10"	17'-7"	15'-5"	15'-5"

TABLE 1.6

0.042"x3"x8" Rafter (Single Span)

Ground Snow Load (psf)	Rafter Spacing (in)	Wind Speed and Exposure						
		Exp B			Exp C			
		120	130	140	100	110	115	115
10	36"	16'-5"	16'-4"	15'-1"	16'-5"	16'-3"	15'-7"	15'-7"
LIVE	32"	18'-4"	17'-3"	16'-0"	18'-4"	17'-3"	16'-5"	16'-5"
	24"	21'-1"	19'-8"	18'-3"	21'-1"	19'-8"	18'-10"	18'-10"
	16"	25'-6"	23'-8"	21'-11"	25'-6"	23'-7"	22'-7"	22'-7"

Exposure C

Ground Snow Load (psf)	Rafter Spacing (in)	Wind Speed and Exposure						
		Exposure C						
		120	130	140	150	160	170	170
10	36"	14'-11"	13'-9"	12'-9"	12'-9"	11'-10"	10'-6"	10'-6"
LIVE	32"	15'-9"	14'-6"	13'-5"	13'-5"	12'-7"	11'-1"	11'-1"
	24"	18'-0"	16'-7"	15'-4"	15'-4"	14'-4"	12'-7"	12'-7"
	16"	21'-7"	19'-10"	18'-5"	18'-5"	17'-2"	15'-1"	15'-1"

TABLE 1.7

3"x3" Rafter @6" o/c (Multispan or Single)

Ground Snow Load (psf)	Rafter Gauge (in)	Wind Speed and Exposure						
		Exposure C						
		120	130	140	150	160	170	170
10	0.024"	12'-6"	12'-1"	11'-1"	11'-1"	10'-3"	8'-11"	8'-11"
LIVE	0.040"	21'-3"	20'-7"	19'-0"	19'-0"	17'-8"	15'-6"	15'-6"
20	0.024"	8'-6"	8'-6"	8'-6"	8'-6"	8'-6"	8'-6"	8'-6"
LIVE	0.040"	15'-0"	15'-0"	15'-0"	15'-0"	15'-0"	15'-0"	15'-0"

TABLE 1.8

Amerimax Exterior Home Products  
28921 US Hwy 74  
Romoland, CA 92585

Carl Putnam, P. E.  
3441 Ivylink Place  
Lynchburg, VA 24503  
carlputnam@comcast.net

0.024"x2"x6.625" Rafter (Multispan)

Ground Snow Load	Rafter Spacing	Wind Speed and Exposure						
		Exposure C						
		120	130	140	150	160	170	170
10	24"	6'-10"	6'-10"	6'-4"	6'-4"	5'-5"	4'-2"	4'-2"
LIVE	20"	7'-10"	7'-10"	7'-10"	7'-10"	6'-7"	4'-11"	4'-11"
	16"	9'-3"	9'-3"	9'-3"	9'-3"	8'-5"	6'-2"	6'-2"
	12"	11'-2"	11'-2"	10'-10"	10'-10"	10'-1"	8'-5"	8'-5"

TABLE 1.9

0.032"x2"x6.625" Rafter (Multispan)

Ground Snow Load	Rafter Spacing	Wind Speed and Exposure						
		Exposure C						
		120	130	140	150	160	170	170
10	24"	10'-4"	10'-4"	10'-4"	10'-4"	10'-1"	8'-10"	8'-10"
LIVE	20"	11'-8"	11'-8"	11'-8"	11'-8"	11'-0"	9'-8"	9'-8"
	16"	13'-6"	13'-6"	13'-1"	13'-1"	12'-2"	10'-9"	10'-9"
	12"	16'-2"	16'-1"	14'-11"	14'-11"	13'-10"	12'-2"	12'-2"

TABLE 1.10

0.040"x2"x6.625" Rafter (Multispan)

Ground Snow Load	Rafter Spacing	Wind Speed and Exposure						
		Exposure C						
		120	130	140	150	160	170	170
10	24"	13'-11"	13'-11"	13'-9"	13'-9"	12'-9"	11'-3"	11'-3"
LIVE	20"	15'-7"	15'-7"	14'-11"	14'-11"	13'-11"	12'-3"	12'-3"
	16"	17'-10"	17'-10"	16'-7"	16'-7"	15'-5"	13'-7"	13'-7"
	12"	21'-1"	20'-4"	18'-10"	18'-10"	17'-7"	15'-5"	15'-5"


TABLE 1.11

NOTE: RAFTERS MAY OVERHANG 25% OF THEIR CLEARSPAN

0.042"x3"x8" Rafter (Multispan)

Ground Snow Load	Rafter Spacing	Wind Speed and Exposure						
		Exposure C						
		120	130	140	150	160	170	170
10	36"	11'-9"	11'-9"	11'-9"	11'-9"	11'-9"	10'-6"	10'-6"
LIVE	32"	12'-9"	12'-9"	12'-9"	12'-9"	12'-9"	12'-3"	12'-3"
	24"	15'-6"	15'-6"	15'-4"	15'-4"	14'-4"	12'-7"	12'-7"
	16"	19'-10"	19'-10"	18'-5"	18'-5"	17'-2"	15'-1"	15'-1"

TABLE 1.12

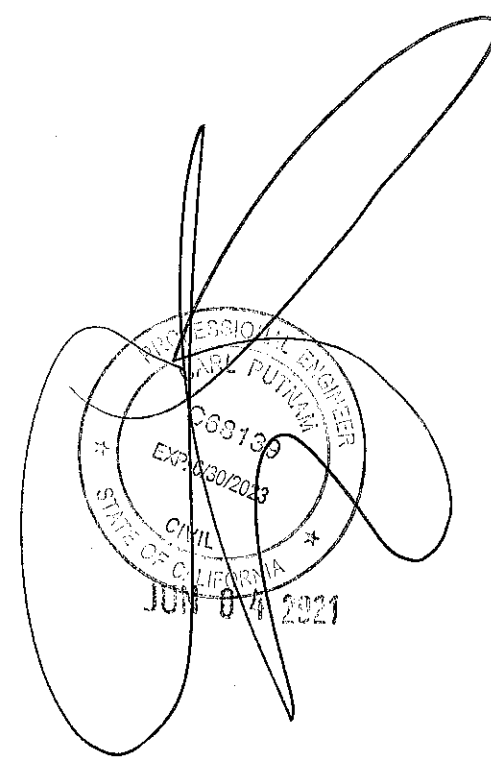







SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 11 psf

Wind Speed: 95 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.1a: Grid of data for attached structures. Columns include detail, footing type, and various dimensions for different footing sizes (e.g., 12x12, 18x18, 24x24, 30x30, 36x36).

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Iylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 11 psf

Wind Speed: 95 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.1b: Grid of data for freestanding structures. Columns include detail, footing type, and various dimensions for different footing sizes (e.g., 12x12, 18x18, 24x24, 30x30, 36x36).

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 11 psf


Wind Speed: 95 MPH EXPOSURE C or 110 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.1c: Grid of data for attached structures under different wind conditions. Columns include detail, footing type, and various dimensions for different footing sizes (e.g., 12x12, 18x18, 24x24, 30x30, 36x36).

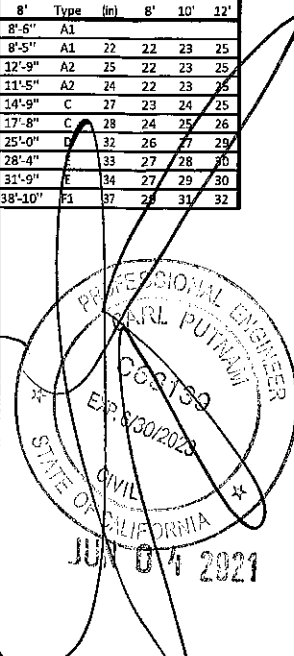

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 11 psf Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 2.2a: Engineering table for structures attached to existing buildings under specified conditions. It contains columns for various footing sizes and post types across multiple grid lines.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585


Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 11 psf Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.2b: Engineering table for freestanding structures under the same conditions as Table 2.2a. It includes detailed footing and post specifications for various grid lines.

Ground Snow Load: 0 psf Live Load: 10 psf Roof Design Load 11 psf Wind Speed: 95 MPH EXPOSURE C or 110 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 2.2c: Engineering table for freestanding structures under modified wind and seismic conditions. It provides detailed footing and post data for multiple grid lines.



JUN 04 2021



SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 11 psf

Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.3a: Grid for structures attached to existing building. Columns include On Slab, 0.042"x3"x8", Double 3"x8", Double 2"x6.625", 16 G Steel C, 14 G Steel C, 12 G Steel C, Double 16 G Steel C, Double 14 G Steel C, Double 12 G Steel C. Rows list various footing types (A1, A2, B, C, D, E, F1, F2) and their dimensions.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 11 psf

Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.3b: Grid for freestanding structures. Columns include On Slab, 0.042"x3"x8", Double 3"x8", Double 2"x6.625", 16 G Steel C, 14 G Steel C, 12 G Steel C, Double 16 G Steel C, Double 14 G Steel C, Double 12 G Steel C. Rows list various footing types and dimensions.

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 11 psf


Wind Speed: 105 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.3c: Grid for structures attached to existing building under 105 MPH wind. Columns include On Slab, 0.042"x3"x8", Double 3"x8", Double 2"x6.625", 16 G Steel C, 14 G Steel C, 12 G Steel C, Double 16 G Steel C, Double 14 G Steel C, Double 12 G Steel C. Rows list various footing types and dimensions.

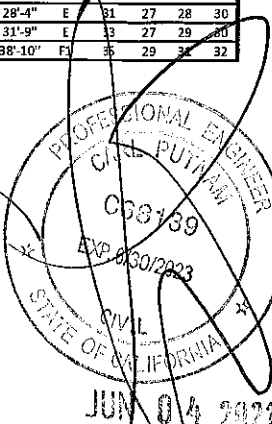

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 11 psf

Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.4a: Design table for attached structures with columns for footing types (trib, Min Post, Uplift, Footing) and post types (A1-A5, B1-B5, C1-C5, D1-D5, E1-E5, F1-F5).

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 11 psf

Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.4b: Design table for freestanding structures, similar to Table 2.4a but with different footing and post requirements.

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 11 psf


Wind Speed: 105 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.4c: Design table for freestanding structures under different wind speed conditions, including post spacing and footing details.

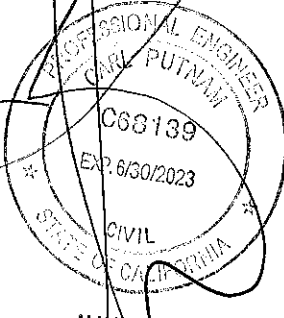

JUN 04 2021

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 11 psf

Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.5a: Grid of post spacing and footing size data for attached structures under various load conditions.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivalink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 14 psf

Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.5b: Grid of post spacing and footing size data for freestanding structures under various load conditions.

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 11 psf


Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.5c: Grid of post spacing and footing size data for attached structures under different wind and seismic conditions.

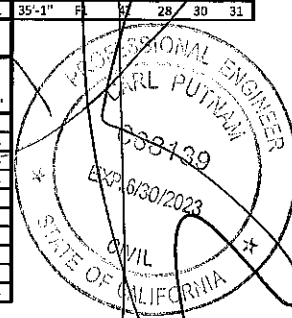

JUN 04 2021



SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 21 psf

Wind Speed: 95 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.11a: Grid of post spacing, post type, and footing size for lattice covers. Columns include tributary area (trib), minimum post spacing (Min Post), uplift footing (Uplift Footing), and footing dimensions (Footing (in) Max Post Length) for various post types (A1, A2, B, C, D, E, F1, F2, F3, F4) and footing types (A1, A2, B, C, D, E, F1, F2, F3, F4).

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92586

Carl Putnam, P. E. 3441 Ivalink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 21 psf

Wind Speed: 95 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.11b: Grid of post spacing, post type, and footing size for lattice covers. Columns include tributary area (trib), minimum post spacing (Min Post), uplift footing (Uplift Footing), and footing dimensions (Footing (in) Max Post Length) for various post types (A1, A2, B, C, D, E, F1, F2, F3, F4) and footing types (A1, A2, B, C, D, E, F1, F2, F3, F4).

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 21 psf


Wind Speed: 95 MPH EXPOSURE C or 110 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.11c: Grid of post spacing, post type, and footing size for lattice covers. Columns include tributary area (trib), minimum post spacing (Min Post), uplift footing (Uplift Footing), and footing dimensions (Footing (in) Max Post Length) for various post types (A1, A2, B, C, D, E, F1, F2, F3, F4) and footing types (A1, A2, B, C, D, E, F1, F2, F3, F4).

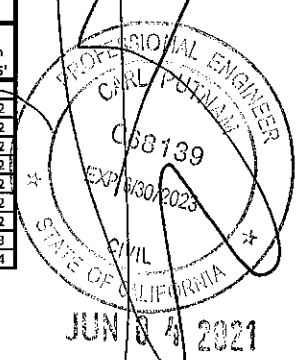

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 21 psf

Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.12a: Grid of post spacing, post type, and footing size for attached structures. Columns include details like On Slab, 0.042"x3"x8", and various steel types (L18, L14, L12, L10, L8, L6, L4, L2). Rows list different footing configurations and their corresponding post types and spacings.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P.E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 21 psf

Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.12b: Grid of post spacing, post type, and footing size for freestanding structures. Similar to Table 2.12a but with different footing and post configurations for freestanding applications.

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 21 psf


Wind Speed: 95 MPH EXPOSURE C or 110 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.12c: Grid of post spacing, post type, and footing size for freestanding structures under different wind speed conditions. Similar to Table 2.12b but with adjusted footing and post configurations.

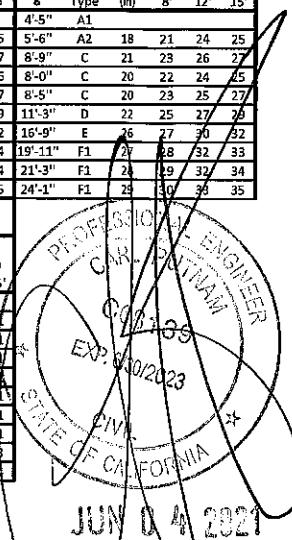

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 21 psf

Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.13a: Grid of post spacing and footing size data for attached structures. Columns include detail, on slab, and various footing types (trib, min, uplift, constrained) for different post types and lengths.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 21 psf

Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.13b: Grid of post spacing and footing size data for freestanding structures. Columns include detail, on slab, and various footing types (trib, min, uplift, constrained) for different post types and lengths.

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 21 psf


Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.13c: Grid of post spacing and footing size data for attached structures under 115 MPH wind. Columns include detail, on slab, and various footing types (trib, min, uplift, constrained) for different post types and lengths.

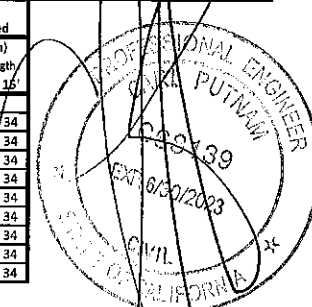

JUN 04 2021



**SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS**

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 21 psf

Roof Solidity: 60%

Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.14a		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																																					
Detail		trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)																										
On Slab		3'-11" A1				3'-5" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1																									
0.042"x3"x8"	L1	10'-5"	A1	20	19	21	22	9'-6"	A1	20	20	22	23	8'-8"	A1	20	20	23	24	8'-1"	A1	21	21	23	25	7'-7"	A1	21	22	24	25	7'-2"	A2	21	22	25	26	6'-8"	A2	21	23	25	27	6'-4"	A2	21	23	26	27	6'-1"	A2	22	24	26	28	5'-9"	A2	22	24	27	28	5'-6"	A2	22	24	27	29
Double 3"x8"	L1/L12	15'-5"	A2	22	19	21	22	14'-3"	A2	23	20	23	24	13'-1"	A2	23	21	23	25	11'-7"	B	24	22	24	25	11'-0"	C	24	22	25	26	10'-5"	C	25	23	25	27	10'-5"	C	25	23	26	27	9'-11"	C	25	24	26	28	9'-2"	C	25	24	27	28	8'-9"	C	26	24	27	29						

Amerimax Exterior Home Products  
28921 US Hwy 74  
Romoland, CA 92585

Carl Putnam, P. E.  
3441 Ivylink Place  
Lynchburg, VA 24503  
carlputnam@comcast.net

**SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS**

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 21 psf

Roof Solidity: 60%

Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.14b		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																									
Detail		trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)																		
On Slab		3'-11" A1				3'-5" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1													
0.042"x3"x8"	L1	10'-5"	A1	18	27	30	31	9'-6"	A1	18	26	29	31	8'-8"	A1	19	25	28	29	8'-1"	A1	19	25	27	29	7'-7"	A1	19	25	27	29	7'-2"	A2	20	24	27	28	6'-8"	A2	20	24	26	28	6'-4"	A2	20	24	26	28	6'-1"	A2	20	23	26	27	5'-9"	A2	20	23	26	27	5'-6"	A2	20	24	26	28
Double 3"x8"	L1/L12	15'-5"	A2	21	29	33	35	14'-3"	A2	21	29	32	34	13'-1"	A2	21	28	31	33	11'-7"	B	22	27	30	32	11'-0"	C	23	27	30	32	10'-5"	C	23	27	30	32	10'-5"	C	23	27	30	32	9'-11"	C	23	26	29	31	9'-2"	C	23	26	29	30	8'-9"	C	24	25	28	30						

**SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS**

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 21 psf

Roof Solidity: 60%


Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.14c		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																					
Detail		trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)																		
On Slab		3'-11" A1				3'-5" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1				3'-11" A1					
0.042"x3"x8"	L1	10'-5"	A1	18	27	30	31	9'-6"	A1	18	26	29	31	8'-8"	A1	19	25	28	30	8'-1"	A1	19	25	28	29	7'-7"	A1	19	25	27	29	7'-2"	A2	20	24	27	28	6'-8"	A2	20	24	26	28	6'-4"	A2	20	24	26	28	6'-1"	A2	20	23	26	27	5'-9"	A2	20	23	26	27	5'-6"	A2	20	24	26	28
Double 3"x8"	L1/L12	15'-5"	A2	21	29	33	35	14'-3"	A2	21	29	32	34	13'-1"	A2	21	28	31	33	11'-7"	B	22	27	30	32	11'-0"	C	23	27	30	32	10'-5"	C	23	27	30	32	10'-5"	C	23	27	30	32	9'-11"	C	23	26	29	31	9'-2"	C	23	26	29	30	8'-9"	C	24	25	28	30						



JUN 04 2021



SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 21 psf

Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.15a: Design table for attached structures with columns for footing size, post type, and spacing for various load and seismic conditions.

Amerimax Exterior Home Products, 28921 US Hwy 74 Romoland, CA 92585, Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 21 psf

Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.15b: Design table for freestanding structures with columns for footing size, post type, and spacing for various load and seismic conditions.

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 21 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 25%

Seismic Design Category B

Structures are Attached to Existing Building

Table 2.15c: Design table for attached structures under different seismic and wind conditions, including columns for footing size, post type, and spacing.

PROFESSIONAL ENGINEER CARL PUTNAM, CIVIL ENGINEER, STATE OF CALIFORNIA, JUN 0 4 1921

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 22 psf

Wind Speed: 95 MPH EXPOSURE C or 110 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.19a: Grid of post spacing, post type, and footing size for lattice covers. Columns include roof solidity, ground snow load, live load, roof design load, wind speed, seismic Ss, and seismic design category. Rows list various footing sizes and post types (e.g., 4x4, 4x6, 4x8).

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585
Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 22 psf

Wind Speed: 95 MPH EXPOSURE C or 110 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.19b: Grid of post spacing, post type, and footing size for lattice covers. Similar to Table 2.19a but for freestanding structures. Columns include roof solidity, ground snow load, live load, roof design load, wind speed, seismic Ss, and seismic design category. Rows list various footing sizes and post types.

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 22 psf


Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.19c: Grid of post spacing, post type, and footing size for lattice covers. Similar to Table 2.19a but for 100 MPH wind speed. Columns include roof solidity, ground snow load, live load, roof design load, wind speed, seismic Ss, and seismic design category. Rows list various footing sizes and post types.

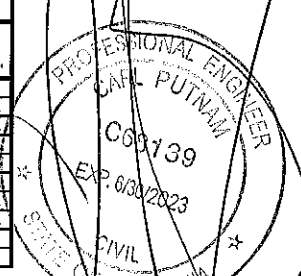

JUN 0 2021

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 22 psf

Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.20a: Detailed table for attached structures with columns for On Slab, 16 G Steel C, 14 G Steel C, 12 G Steel C, and 10 G Steel C. Includes various footing types (trib, min post, uplift) and lengths.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 22 psf

Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.20b: Detailed table for freestanding structures with columns for On Slab, 16 G Steel C, 14 G Steel C, 12 G Steel C, and 10 G Steel C. Includes various footing types and lengths.

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 22 psf


Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.20c: Detailed table for freestanding structures under different wind speed conditions. Includes various footing types and lengths.

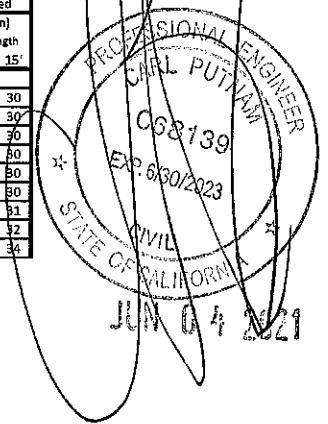



SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 22 psf

Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.21a: Grid of post spacing, post type, and footing size for lattice covers. Columns include footing type (cubic, constrained), footing length (8', 12', 15'), and post type (A1, A2, B, C, D, E, F1, F2, F3, F4).

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 22 psf

Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.21b: Grid of post spacing, post type, and footing size for lattice covers. Columns include footing type (cubic, constrained), footing length (8', 12', 15'), and post type (A1, A2, B, C, D, E, F1, F2, F3, F4).

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 22 psf


Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.21c: Grid of post spacing, post type, and footing size for lattice covers. Columns include footing type (cubic, constrained), footing length (8', 12', 15'), and post type (A1, A2, B, C, D, E, F1, F2, F3, F4).

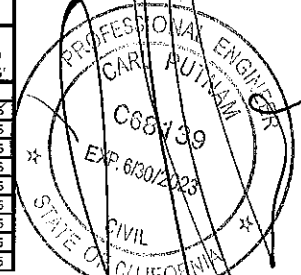

JUN 04 2021

**SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS**

Ground Snow Load: **25 psf**

Live Load: **20 psf**

Roof Design Load **22 psf**

Roof Solidity: **60%**

Wind Speed: **120 MPH EXPOSURE C or 140 MPH EXPOSURE B**

Seismic S<sub>s</sub>= **150%**

Seismic Design Category **D**

Structures are Attached to Existing Building

Table 2.2.2a

Header		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																							
Detail	On Slab	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)
On Slab	On Slab	11'-4" A1				9'-8" A1				8'-6" A1				7'-6" A1				6'-9" A1				5'-9" A1				5'-2" A1				4'-10" A1				4'-6" A1				4'-3" A1				4'-0" A1				3'-9" A1				3'-6" A1			
0.042"x3"x8"	L1	10'-0" A1	20	19	22	23	9'-3" A1	20	20	22	24	8'-5" A1	21	21	23	25	7'-11" A1	21	22	24	25	6'-11" A2	22	23	25	27	6'-2" A2	22	24	26	28	5'-10" A2	22	24	27	28	5'-7" A2	22	25	27	29	5'-4" A2	22	25	28	29	5'-1" A2	22	25	28	29		

Amerimax Exterior Home Products  
28921 US Hwy 74  
Romoland, CA 92585

Carl Putnam, P. E.  
3441 Ivylink Place  
Lynchburg, VA 24503  
carlputnam@comcast.net

Ground Snow Load: **25 psf**

Live Load: **20 psf**

Roof Design Load **22 psf**

Wind Speed: **120 MPH EXPOSURE C or 140 MPH EXPOSURE B**

Seismic S<sub>s</sub>= **150%**

Seismic Design Category **D**

Freestanding Structures

Table 2.2.2b

Header		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																							
Detail	On Slab	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)				
On Slab	On Slab	11'-4" A1				9'-8" A1				8'-6" A1				7'-6" A1				6'-9" A1				5'-9" A1				5'-2" A1				4'-10" A1				4'-6" A1				4'-3" A1				4'-0" A1				3'-9" A1				3'-6" A1				3'-3" A1			
0.042"x3"x8"	L1	10'-0" A1	18	27	30	32	9'-3" A1	19	26	29	30	8'-5" A1	19	26	29	30	7'-11" A1	19	25	28	30	6'-11" A2	20	25	27	29	6'-2" A2	20	24	26	28	5'-10" A2	20	23	26	28	5'-7" A2	20	24	26	28	5'-4" A2	20	24	26	28	5'-1" A2	20	24	26	28						

Ground Snow Load: **25 psf**

Live Load: **20 psf**

Roof Design Load **22 psf**

Wind Speed: **130 MPH EXPOSURE C or 150 MPH EXPOSURE B**

Seismic S<sub>s</sub>= **150%**

Seismic Design Category **D**

Freestanding Structures

Table 2.2.2c

Header		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																							
Detail	On Slab	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)				
On Slab	On Slab	11'-4" A1				9'-8" A1				8'-6" A1				7'-6" A1				6'-9" A1				5'-9" A1				5'-2" A1				4'-10" A1				4'-6" A1				4'-3" A1				4'-0" A1				3'-9" A1				3'-6" A1				3'-3" A1			
0.042"x3"x8"	L1	10'-0" A1	19	28	31	33	9'-3" A1	20	27	30	32	8'-5" A1	20	27	30	32	7'-11" A1	21	26	29	31	6'-11" A2	21	26	28	30	6'-2" A2	21	25	28	30	5'-10" A2	21	25	28	29	5'-7" A2	21	25	28	29	5'-4" A2	21	25	27	29	5'-1" A2	21	25	28	29						



SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf

Wind Speed: 95 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.23a: Grid for structures attached to existing building. Columns include footing type (trib, min post, uplift, constrained), footing length (8', 12', 15'), and post spacing (3', 4', 5', 6', 7', 8'). Rows list various steel and concrete configurations.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92588

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf

Wind Speed: 95 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.23b: Grid for freestanding structures. Columns include footing type (trib, min post, uplift, constrained), footing length (8', 12', 15'), and post spacing (3', 4', 5', 6', 7', 8'). Rows list various steel and concrete configurations.

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf


Wind Speed: 100 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.23c: Grid for structures attached to existing building under 100 MPH exposure. Columns include footing type (trib, min post, uplift, constrained), footing length (8', 12', 15'), and post spacing (3', 4', 5', 6', 7', 8'). Rows list various steel and concrete configurations.



JUN 04 2021



**SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS**

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf

Roof Solidity: 60%

Wind Speed: 105 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.24a		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																					
Header	Detail	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained		
On Slab	On Slab	3'	Type	Footings (in)	Max Post Length	3.5'	Type	Footings (in)	Max Post Length	4'	Type	Footings (in)	Max Post Length	4.5'	Type	Footings (in)	Max Post Length	5'	Type	Footings (in)	Max Post Length	5.5'	Type	Footings (in)	Max Post Length	6'	Type	Footings (in)	Max Post Length	6.5'	Type	Footings (in)	Max Post Length	7'	Type	Footings (in)	Max Post Length	7.5'	Type	Footings (in)	Max Post Length	8'	Type	Footings (in)	Max Post Length										
0.042"x3"x8"	L1	9'-1"	A1	16	17	18	20	8'-4"	A1	16	17	19	20	7'-7"	A1	16	18	20	21	7'-1"	A1	16	18	20	21	6'-4"	A1	16	18	20	21	5'-8"	A1	16	18	20	21	5'-2"	A1	16	18	20	21	4'-9"	A1	16	18	20	21	3'-9"	A1	16	18	20	21

Amerimax Exterior Home Products  
28921 US Hwy 74  
Romoland, CA 92585  
  
Carl Putnam, P. E.  
3441 Ivylink Place  
Lynchburg, VA 24503  
carlputnam@comcast.net

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf

Roof Solidity: 60%

Wind Speed: 105 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.24b		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																							
Header	Detail	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained
On Slab	On Slab	3'	Type	Footings (in)	Max Post Length	3.5'	Type	Footings (in)	Max Post Length	4'	Type	Footings (in)	Max Post Length	4.5'	Type	Footings (in)	Max Post Length	5'	Type	Footings (in)	Max Post Length	5.5'	Type	Footings (in)	Max Post Length	6'	Type	Footings (in)	Max Post Length	6.5'	Type	Footings (in)	Max Post Length	7'	Type	Footings (in)	Max Post Length	7.5'	Type	Footings (in)	Max Post Length	8'	Type	Footings (in)	Max Post Length												
0.042"x3"x8"	L1	9'-1"	A1	14	22	25	26	8'-4"	A1	15	21	24	25	7'-7"	A1	15	21	24	25	7'-1"	A1	15	21	24	25	6'-4"	A1	15	21	24	25	5'-8"	A1	15	21	24	25	5'-2"	A1	15	21	24	25	4'-9"	A1	15	21	24	25	3'-9"	A1	15	21	24	25		

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf

Roof Solidity: 60%


Wind Speed: 100 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.24c		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																							
Header	Detail	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained	trib	Min Post	Uplift	Constrained
On Slab	On Slab	3'	Type	Footings (in)	Max Post Length	3.5'	Type	Footings (in)	Max Post Length	4'	Type	Footings (in)	Max Post Length	4.5'	Type	Footings (in)	Max Post Length	5'	Type	Footings (in)	Max Post Length	5.5'	Type	Footings (in)	Max Post Length	6'	Type	Footings (in)	Max Post Length	6.5'	Type	Footings (in)	Max Post Length	7'	Type	Footings (in)	Max Post Length	7.5'	Type	Footings (in)	Max Post Length	8'	Type	Footings (in)	Max Post Length												
0.042"x3"x8"	L1	9'-1"	A1	14	22	24	25	8'-4"	A1	14	21	23	24	7'-7"	A1	14	21	23	24	7'-1"	A1	14	21	23	24	6'-7"	A1	14	21	23	24	5'-9"	A1	14	21	23	24	5'-4"	A1	14	21	23	24	4'-11"	A1	14	21	23	24	3'-9"	A1	14	21	23	24		

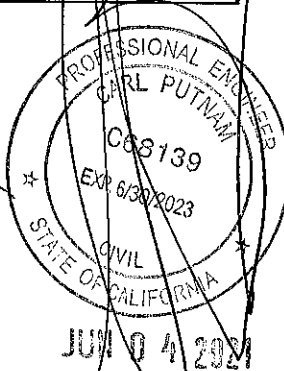



SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf

Wind Speed: 95 MPH EXPOSURE C or 110 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.25a: Grid of data for attached structures with columns for footing types (trib, Min Post, Uplift, Footing) and lengths (8', 12', 15').

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivynlink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf

Wind Speed: 95 MPH EXPOSURE C or 110 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.25b: Grid of data for freestanding structures with columns for footing types and lengths.

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf


Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.25c: Grid of data for attached structures under higher wind conditions with columns for footing types and lengths.



SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf

Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.26b: Design table for attached structures with columns for footing type, post type, and footing length for various slab and steel configurations.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf

Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.26b: Design table for freestanding structures with columns for footing type, post type, and footing length for various slab and steel configurations.

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf


Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.26c: Design table for freestanding structures under higher wind speeds with columns for footing type, post type, and footing length for various slab and steel configurations.



JUN 04 2021

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf

Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.27a: Grid for structures attached to existing building. Columns include footing size, post type, and spacing for various load conditions.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Iylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf

Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.27b: Grid for freestanding structures. Columns include footing size, post type, and spacing for various load conditions.

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf


Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.27c: Grid for structures attached to existing building under higher wind conditions. Columns include footing size, post type, and spacing for various load conditions.

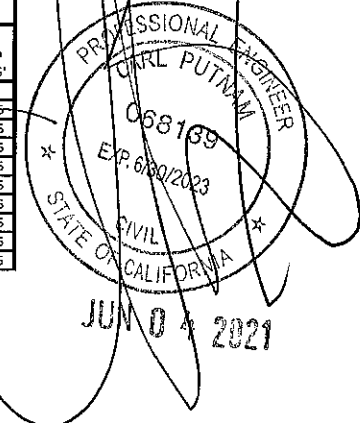

JUN 04 2021



**SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS**

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf

Roof Solidity: 60%

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.28a		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																					
Header	Detail	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)										
On Slab	On Slab	9'-6"	A1		8'-2"	A1		7'-3"	A1	4'-5"	A1		5'-2"	A1		5'-5"	A1	6'-0"	A1		6'-5"	A1		6'-8"	A1	7'-0"	A1		7'-5"	A1		8'-0"	A1		8'-4"	A1	8'-6"	A1		8'-10"	A1		8'-12"	A1	9'-0"	A1		9'-6"	A1						
0.042'x3'x8"	L1	9'-1"	A1	19	19	22	23	8'-4"	A1	20	20	22	24	7'-2"	A1	20	21	23	25	7'-1"	A2	20	22	24	25	6'-2"	A2	21	23	25	27	5'-9"	A2	21	23	26	27	5'-5"	A2	21	24	26	28	5'-2"	A2	21	24	27	29	4'-11"	A2	21	25	27	29

Amerimax Exterior Home Products  
 28921 US Hwy 74  
 Romoland, CA 92585  
 Carl Putnam, P. E.  
 3441 Ivylink Place  
 Lynchburg, VA 24503  
 carlputnam@comcast.net

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.28b		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"													
Header	Detail	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)		
On Slab	On Slab	9'-6"	A1		8'-2"	A1		7'-3"	A1	4'-5"	A1		5'-2"	A1		5'-5"	A1	6'-0"	A1		6'-5"	A1		6'-8"	A1	7'-0"	A1		7'-5"	A1		8'-0"	A1		8'-4"	A1	8'-6"	A1		8'-10"	A1		8'-12"	A1	9'-0"	A1		9'-6"	A1						
0.042'x3'x8"	L1	9'-1"	A1	18	26	29	31	8'-4"	A1	18	26	29	31	7'-2"	A1	18	25	28	29	7'-1"	A2	19	24	26	28	6'-1"	A2	19	23	26	28	5'-9"	A2	19	23	26	28	5'-5"	A2	19	23	26	27	5'-2"	A2	20	24	26	28	4'-11"	A2	20	24	26	28

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 26 psf

Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.28c		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"													
Header	Detail	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)	trib	Min Post	Uplift	Footings (in)		
On Slab	On Slab	9'-6"	A1		8'-2"	A1		7'-3"	A1	4'-5"	A1		5'-2"	A1		5'-5"	A1	6'-0"	A1		6'-5"	A1		6'-8"	A1	7'-0"	A1		7'-5"	A1		8'-0"	A1		8'-4"	A1	8'-6"	A1		8'-10"	A1		8'-12"	A1	9'-0"	A1		9'-6"	A1						
0.042'x3'x8"	L1	9'-1"	A1	19	27	30	31	8'-4"	A1	19	27	30	31	7'-2"	A1	19	26	29	31	7'-1"	A2	20	26	28	30	6'-1"	A2	20	25	27	29	5'-9"	A2	20	24	27	29	5'-5"	A2	21	24	27	28	5'-2"	A2	21	24	27	28	4'-11"	A2	21	25	27	29

PROFESSIONAL ENGINEER  
 CARL PUTNAM  
 CIVIL ENGINEER  
 No. 139  
 EXP. 6/30/2023  
 STATE OF CALIFORNIA  
 JUN 8 4 2021

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 31 psf

Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.29a: Grid for structures attached to existing buildings. Columns include footing type (trib, min, uplift, constrained), footing length (8', 12', 15'), and post type (A1-A5). Rows list various slab and steel C configurations.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivlink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 31 psf

Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.29b: Grid for freestanding structures. Columns include footing type (trib, min, uplift, constrained), footing length (8', 12', 15'), and post type (A1-A5). Rows list various slab and steel C configurations.

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 31 psf


Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.29c: Grid for freestanding structures under higher wind speeds. Columns include footing type (trib, min, uplift, constrained), footing length (8', 12', 15'), and post type (A1-A5). Rows list various slab and steel C configurations.

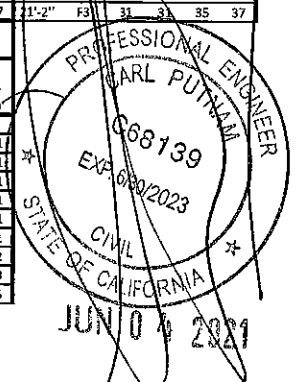





SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Ground Snow Load: 42 psf

Live Load: 20 psf

Roof Design Load 36 psf

Roof Solidity: 60%

Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 50%

Seismic Design Category C

Structures are Attached to Existing Building

Table 2.33a: Grid of tables for attached structures. Columns include footing size (trib, Min Post, Uplift, Footing), and rows include slab types (On Slab, 0.042"x3"x8", etc.) and steel grades (16 G Steel C, 14 G Steel C, etc.).

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585 Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 42 psf

Live Load: 20 psf

Roof Design Load 36 psf

Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 50%

Seismic Design Category C

Freestanding Structures

Table 2.33b: Grid of tables for freestanding structures. Columns include footing size (trib, Min Post, Uplift, Footing), and rows include slab types (On Slab, 0.042"x3"x8", etc.) and steel grades (16 G Steel C, 14 G Steel C, etc.).

Ground Snow Load: 42 psf

Live Load: 20 psf

Roof Design Load 36 psf


Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.33c: Grid of tables for freestanding structures under higher seismic conditions. Columns include footing size (trib, Min Post, Uplift, Footing), and rows include slab types (On Slab, 0.042"x3"x8", etc.) and steel grades (16 G Steel C, 14 G Steel C, etc.).



JUN 04 2021



SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 42 psf

Live Load: 20 psf

Roof Design Load 36 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.34a: Grid of post spacing, post type, and footing size for attached structures. Columns include footing dimensions (8', 12', 15') and post types (A1, A2, B, C, D, E, F1, F2, F3, F4, F5).

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 42 psf

Live Load: 20 psf

Roof Design Load 36 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.34b: Grid of post spacing, post type, and footing size for freestanding structures. Columns include footing dimensions (8', 12', 15') and post types (A1, A2, B, C, D, E, F1, F2, F3, F4, F5).

Ground Snow Load: 42 psf

Live Load: 20 psf

Roof Design Load 36 psf


Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 50%

Seismic Design Category C

Structures are Attached to Existing Building

Table 2.34c: Grid of post spacing, post type, and footing size for attached structures under different wind and seismic conditions. Columns include footing dimensions (8', 12', 15') and post types (A1, A2, B, C, D, E, F1, F2, F3, F4, F5).



JUN 8 4 2021

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Ground Snow Load: 50 psf

Live Load: 20 psf

Roof Design Load 43 psf

Roof Solidity: 60%

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.36b: Grid of columns for attached structures. Columns include footing type (trib, min, uplift, max post length), footing size (8', 12', 15'), and footing length (1', 2', 3', 4', 5', 6', 8', 10', 12', 15'). Rows list various steel and concrete slab configurations.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Iylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 50 psf

Live Load: 20 psf

Roof Design Load 43 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.36b: Grid of columns for freestanding structures. Columns include footing type (trib, min, uplift, max post length), footing size (8', 12', 15'), and footing length (1', 2', 3', 4', 5', 6', 8', 10', 12', 15'). Rows list various steel and concrete slab configurations.

Ground Snow Load: 50 psf

Live Load: 20 psf

Roof Design Load 43 psf


Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 50%

Seismic Design Category C

Structures are Attached to Existing Building

Table 2.36c: Grid of columns for attached structures under different conditions. Columns include footing type (trib, min, uplift, max post length), footing size (8', 12', 15'), and footing length (1', 2', 3', 4', 5', 6', 8', 10', 12', 15'). Rows list various steel and concrete slab configurations.

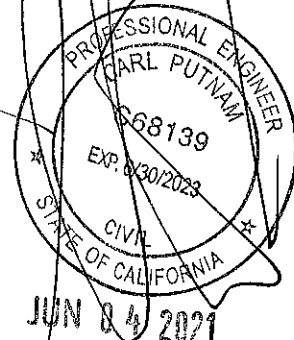

JUN 8 2021

SECTION 2.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR LATTICE COVERS

Roof Solidity: 60%

Ground Snow Load: 60 psf

Live Load: 20 psf

Roof Design Load 51 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 2.38a: Grid of post spacing and footing size data for attached structures. Columns include post type, footing length, and footing width for various load and seismic conditions.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

Ground Snow Load: 60 psf

Live Load: 20 psf

Roof Design Load 51 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 2.38b: Grid of post spacing and footing size data for freestanding structures. Columns include post type, footing length, and footing width for various load and seismic conditions.

Ground Snow Load: 60 psf

Live Load: 20 psf

Roof Design Load 51 psf


Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 115%


Seismic Design Category D

Freestanding and Attached


Table 2.38c: Grid of post spacing and footing size data for freestanding and attached structures. Columns include post type, footing length, and footing width for various load and seismic conditions.



JUN 04 2021

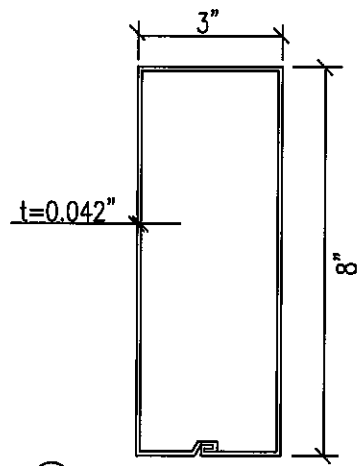

L1 HEADER (3004-H34 ALUM. ALLOY)

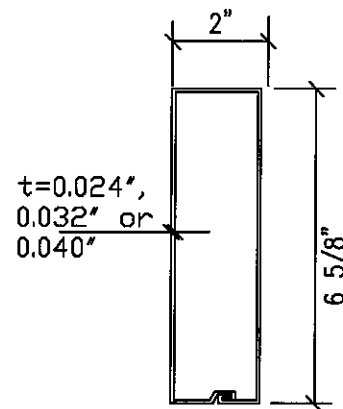


L2 RAFTER & SIDEPLATES (3004-H34 ALUM. ALLOY)


L3 LATTICE TUBES  
1.5"x1.5" @3" o/c  
2"x2" @4" o/c  
3"x3" @6" o/c DETAIL L4  
2"x3" @5" o/c




LATTICE 3105 H24 ALUM ALLOY



L4 POST/RAFTER/LATTICE TUBE (3004-H34 ALUM. ALLOY)

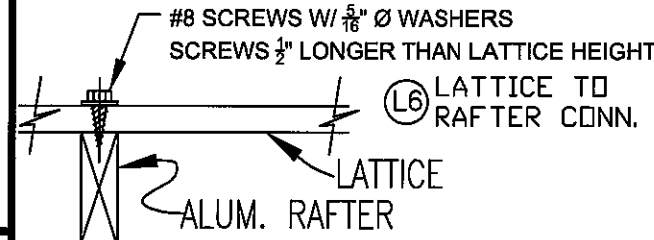


L6 LATTICE TO RAFTER CONN.

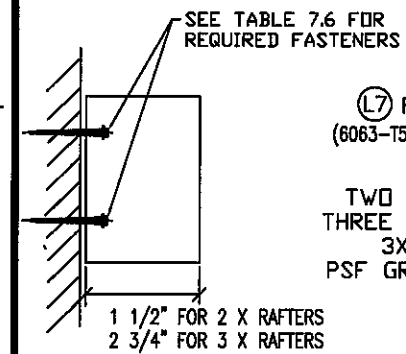


L7 RAFTER HANGER (6063-T5 ALUM. ALLOY, 't'= 0.078")

TWO #8 SMS EACH SIDE  
THREE #8 SMS EACH SIDE  
3X8 RAFTERS IN 50+ PSF GROUND SNOW LOADS

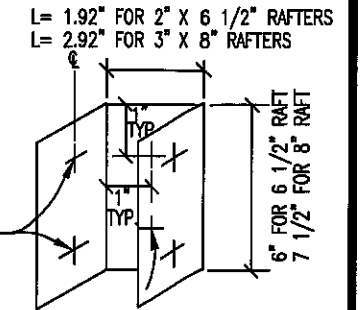

Beam Type	Required # of 1/4" Bolts (# of #14 Self Drilling Screws)				170 mph Exp C 10 psf (Live)	130 mph Exp C 10 psf (Live)	110 mph Exp C 10 psf (Live)
	60 psf	50 psf	42 psf	25 psf			
All C Beams "On Slab"	4 (4)	4 (4)	4 (4)	4 (4)	4 (4)	4 (4)	4 (4)
14g & 16G Steel 3x8	4 (4)	4 (4)	4 (4)	4 (4)	4 (4)	4 (4)	4 (4)
12G Steel 3x8	6 (8)	6 (8)	6 (8)	6 (7)	6 (7)	5 (7)	5 (6)
Double 16G Steel 3x8	5 (12)	4 (12)	4 (10)	4 (10)	4 (10)	4 (8)	4 (8)
Double 14G Steel 3x8	5 (14)	5 (14)	5 (12)	4 (12)	4 (12)	4 (10)	4 (10)
Double 12G Steel 3x8	7 (18)	6 (16)	6 (16)	5 (14)	5 (14)	5 (12)	4 (12)

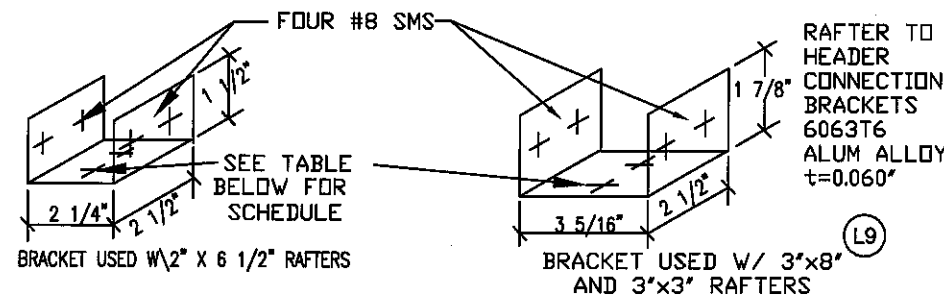


L9 RAFTER TO HEADER CONNECTION BRACKETS 6063T6 ALUM ALLOY t=0.060"


CONTINUOUS 2"x6" OR 2x8" DOUGLAS FIR LEDGER OR PROVIDE SIMPSON STRONG TIE MSTA36 (ICC ESR 2105) AT SPLICE LOCATION COVER W/ 0.019" ALUMINUM

1/4" LAG SCREW OR #14 SCREW W/ 2.5" EMBED INTO WOOD STUD SEE TABLE FOR QUANTITY

L10 ALTERNATE RAFTER TO WALL CONN.

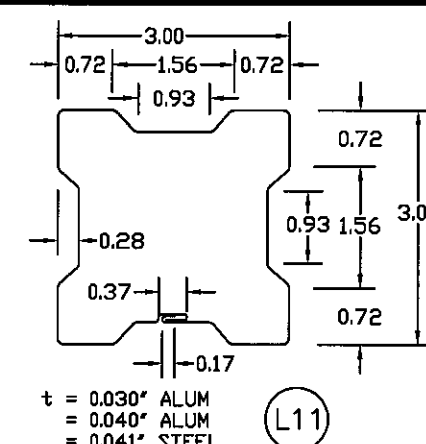


L11 3" ALTERNATE POST (3105 H25 ALUM. ALLOY OR A-653 Fy=40 KSI STEEL)

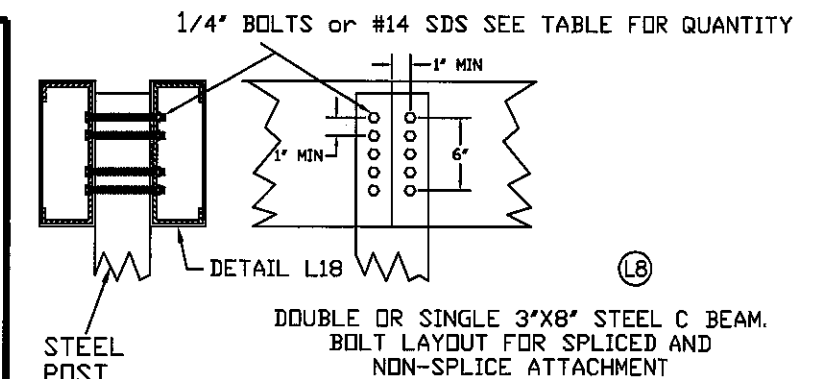


L8 DOUBLE OR SINGLE 3"x8" STEEL C BEAM. BOLT LAYOUT FOR SPLICED AND NON-SPLICE ATTACHMENT

Wind Speed	t (in)	Header	Allowable Trib Width			
			2	3	4	5
110 MPH EXPC	0.040	Double 2x6	9'	14'	18'	
	0.042	0.042"x3"x8"	5'	7'	9'	12'
	0.042	Double 3x8	9'	14'	18'	
115 MPH EXPC	0.040	Double 2x6	8'	12'	16'	18'
	0.042	0.042"x3"x8"	4'	6'	9'	11'
	0.042	Double 3x8	9'	13'	17'	18'
130 MPH EXPC	0.040	Double 2x6	10'	15'	18'	
	0.042	0.042"x3"x8"	5'	8'	10'	13'
	0.042	Double 3x8	10'	15'	18'	18'
150 MPH EXPC	16G min	8" Steel C	10'	14'	18'	
	16G min	Double Steel C	18'			
	170 MPH EXPC	18G min	8" Steel C	7'	11'	15'
	16G min	Double Steel C	15'	18'		


DOUBLE HEADERS USE ONE BRACKET PER HEADER

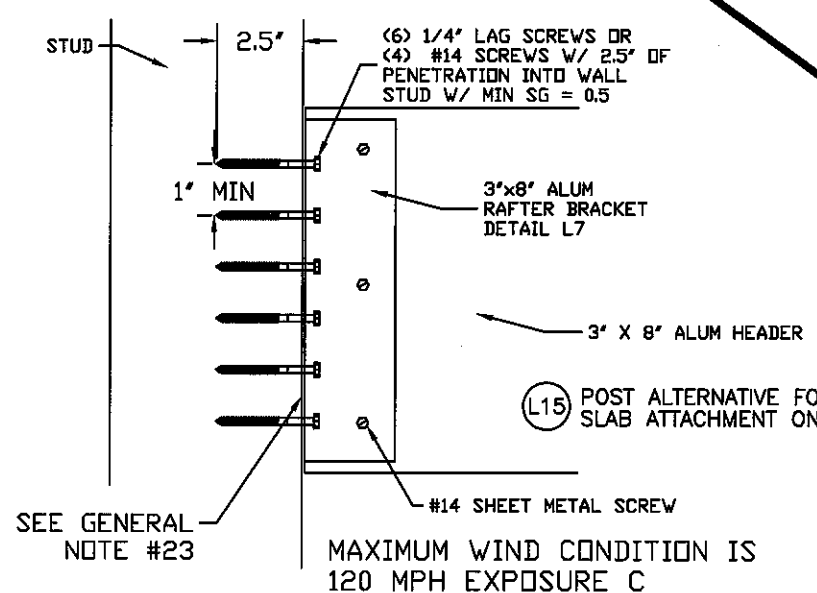

L15 POST ALTERNATIVE FOR SLAB ATTACHMENT ONLY

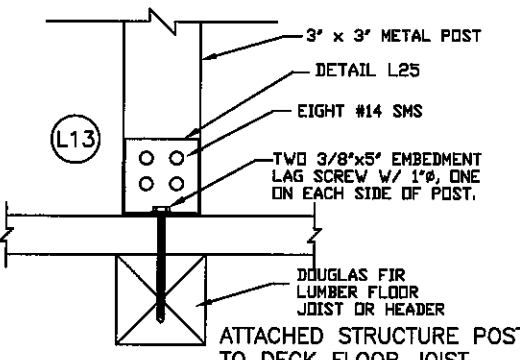


SEE GENERAL NOTE #19 AND LATTICE NOTE #3 UNITS MUST COMPLY WITH TABLES L1 AND L2 ON SHEET M5  
MAX WIND SPEED IS 130 MPH EXPOSURE C

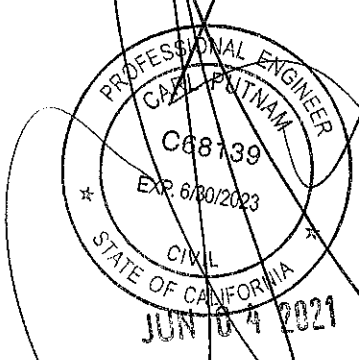

**Amerimax** 28921 US Hwy 74  
EXTERIOR HOME PRODUCTS Romoland, CA 92585

DRAWN BY: BEJ/CP TYPE:  
SCALE: NTS Component Parts & Connection Details For Patio & Commercial Lattice Structures  
DATE: FILE: LTO1-2018 SHEET: 1 of 4



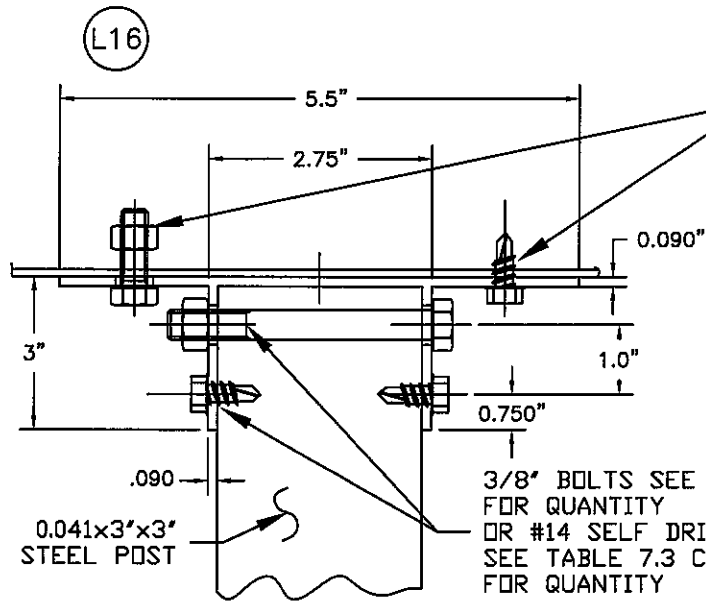


3/8" BOLTS W/ 1" DIA. x 3/32" THK. STL. WASHER TO 8" STEEL "C" BEAM SEE TABLE 7.4 COLUMN "N" FOR QUANTITY FOR #14 SELF DRILLING SCREWS SEE TABLE 7.4 COLUMN "D".

ALTERNATE 3" SQ POST CONNECTOR BRACKET (6063T6 ALUM) IF DETAIL L29 IS NOT USED ATTACH SIDE PLATES AS PER DETAIL L26

3/8" BOLTS SEE TABLE 7.3 COLUMN "J" FOR QUANTITY OR #14 SELF DRILLING SCREWS SEE TABLE 7.3 COLUMN "I" FOR QUANTITY

0.041x3"x3" STEEL POST

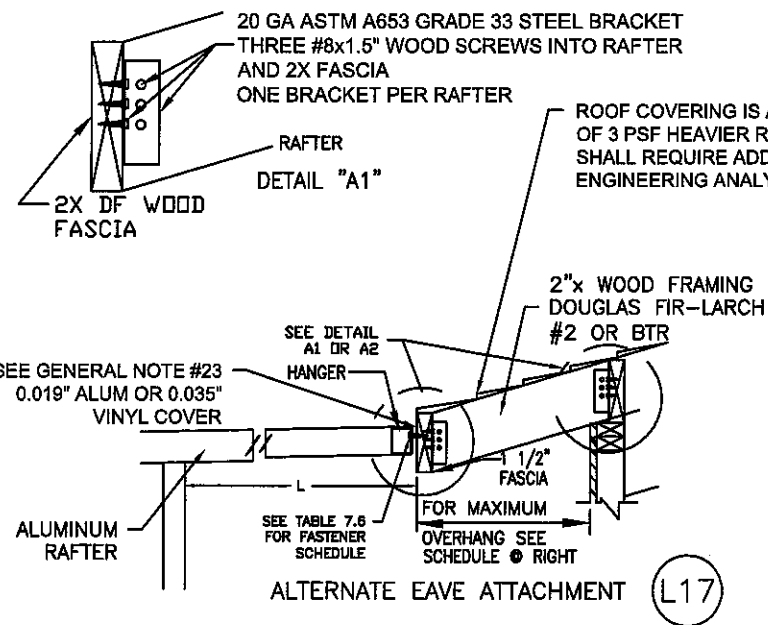

20 GA ASTM A653 GRADE 33 STEEL BRACKET THREE #8x1.5" WOOD SCREWS INTO RAFTER AND 2X FASCIA ONE BRACKET PER RAFTER


ROOF COVERING IS A MAXIMUM OF 3 PSF HEAVIER ROOF COVERING SHALL REQUIRE ADDITIONAL ENGINEERING ANALYSIS

SEE GENERAL NOTE #23 0.019" ALUM OR 0.035" VINYL COVER


SEE TABLE 7.8 FOR FASTENER SCHEDULE

FOR MAXIMUM OVERHANG SEE SCHEDULE @ RIGHT

Live Snow	RAFTER SIZE	MAX DISTANCE TO FIRST ROW OF POSTS "L"					Number of #14 Screws
		6"	12"	18"	24"	30"	
10 psf 130 mph Exp C	2x4	26'-0"	18'-7"	10'-6"	5'-11"	2'-8"	3
	2x6	26'-0"	26'-0"	26'-0"	21'-2"	14'-10"	
	2x8	26'-0"	26'-0"	26'-0"	26'-0"	26'-0"	
20 psf 130 mph Exp C	2x4	19'-0"	9'-9"	5'-6"	3'-1"	1'-4"	4
	2x6	19'-0"	19'-0"	16'-2"	11'-1"	7'-9"	
	2x8	19'-0"	19'-0"	19'-0"	19'-0"	15'-8"	
25 psf 130 mph Exp C	2x4	18'-0"	10'-7"	5'-11"	3'-3"	1'-5"	4
	2x6	18'-0"	18'-0"	17'-8"	12'-1"	8'-5"	
	2x8	18'-0"	18'-0"	18'-0"	18'-0"	17'-1"	
30 psf 130 mph Exp C	2x4	17'-0"	8'-9"	4'-8"	2'-4"	0'-8"	4
	2x6	17'-0"	17'-0"	14'-7"	9'-9"	6'-7"	
	2x8	17'-0"	17'-0"	17'-0"	17'-0"	13'-11"	
36 psf 130 mph Exp C	2x4	16'-0"	7'-2"	3'-8"	1'-8"	0'-2"	4
	2x6	16'-0"	16'-0"	12'-0"	7'-10"	5'-1"	
	2x8	16'-0"	16'-0"	16'-0"	15'-7"	11'-4"	
42 psf 130 mph Exp C	2x4	13'-11"	6'-0"	2'-11"	1'-1"	0'-0"	5
	2x6	14'-0"	14'-0"	10'-0"	6'-5"	3'-11"	
	2x8	14'-0"	14'-0"	14'-0"	13'-0"	9'-3"	
50 psf 130 mph Exp C	2x4	11'-7"	4'-10"	2'-2"	0'-6"	0'-0"	5
	2x6	13'-0"	13'-0"	8'-2"	5'-0"	2'-10"	
	2x8	13'-0"	13'-0"	13'-0"	10'-7"	7'-4"	
60 psf 130 mph Exp C	2x4	9'-7"	3'-10"	1'-6"	0'-1"	0'-0"	5
	2x6	12'-0"	11'-5"	6'-7"	3'-10"	1'-11"	
	2x8	12'-0"	12'-0"	12'-0"	8'-6"	5'-8"	

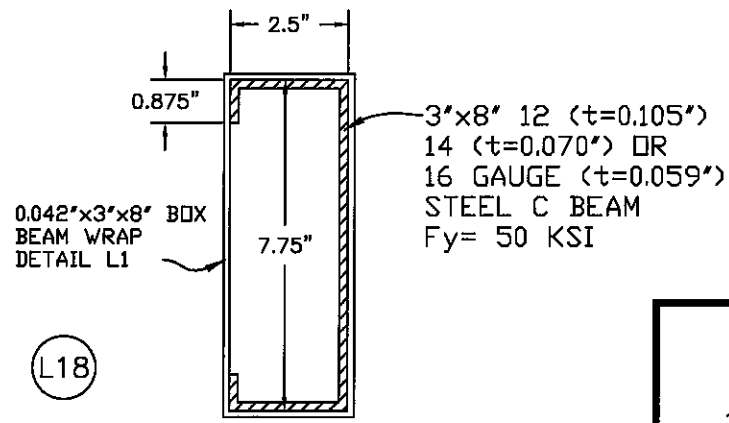


12, 14 and 16 GA 3"x8" STEEL C BEAM W/ 0.042"x3"x8" ALUM WRAP

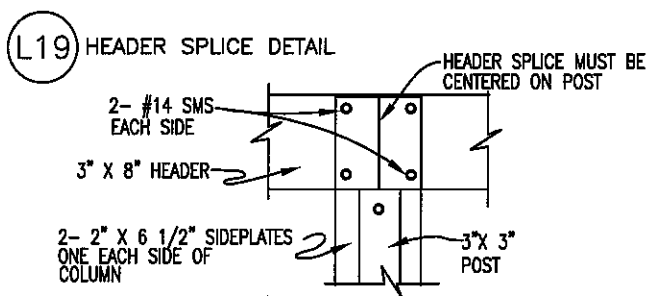

HEADER SPLICE DETAIL

HEADER SPLICE MUST BE CENTERED ON POST

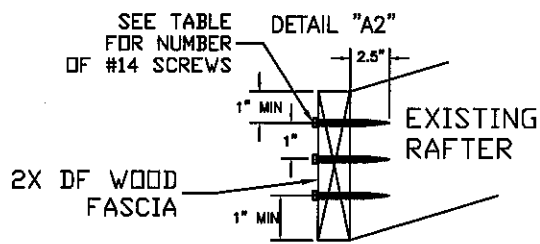


SEE TABLE FOR NUMBER OF #14 SCREWS


DETAIL "A2"

EXISTING RAFTER

2X DF WOOD FASCIA

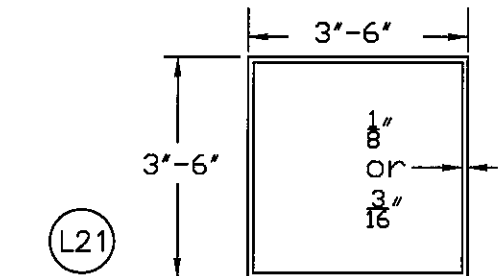


3', 4', 5' OR 6' ASTM A500 GRADE B STEEL POST SEE GENERAL NOTE #9 FOR CORROSION PROTECTION

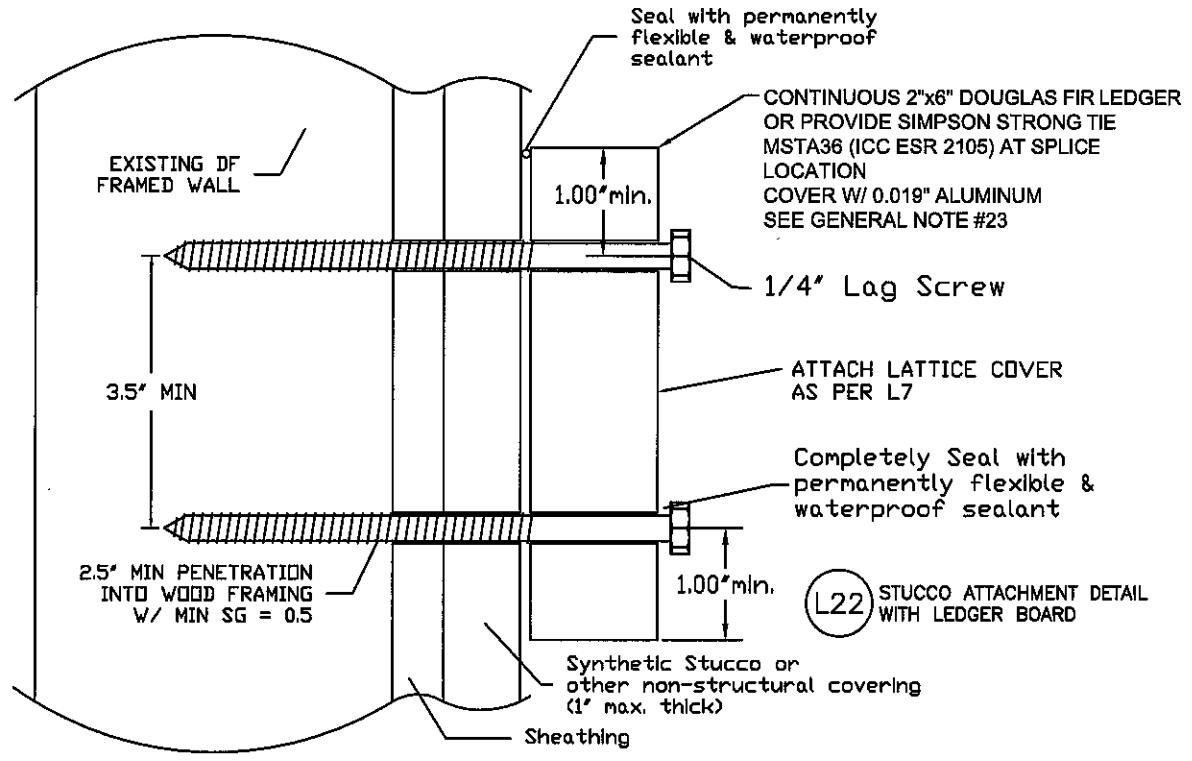

STUCCO ATTACHMENT DETAIL WITH LEDGER BOARD


SEE ALLOWABLE DISTANCE TO FIRST ROW OF POSTS IN TABLE 7.7

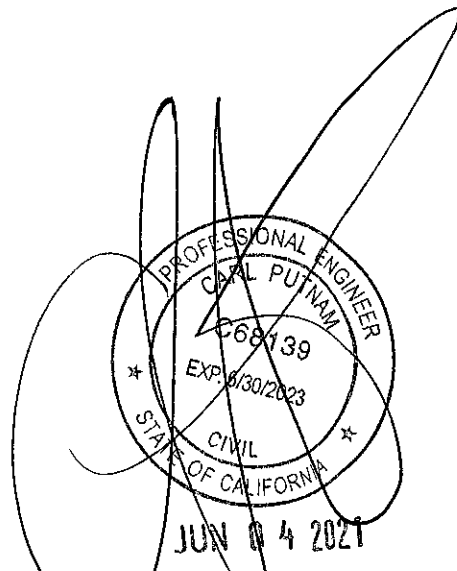


**Amerimax** 28921 US Hwy 74  
EXTERIOR HOME PRODUCTS Romoland, CA 92585

DRAWN BY: BEJ/CP	TYPE:
SCALE: NTS	Component Parts & Connection Details For Patio & Commercial Lattice Structures
DATE:	FILE: LT02-2018 SHEET: 2 of 4



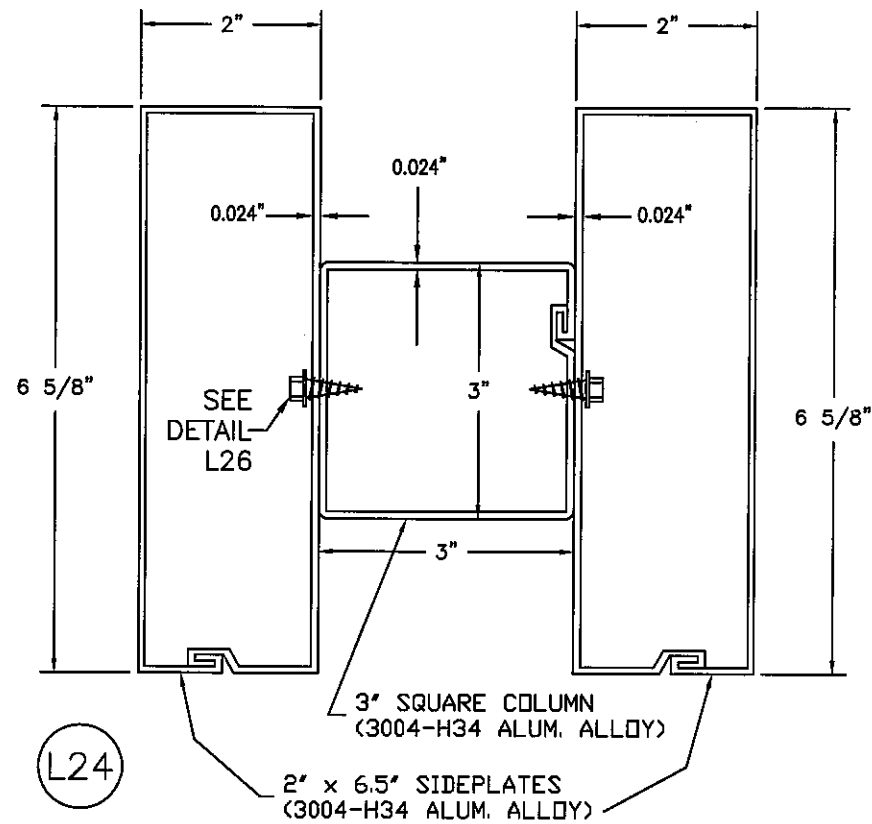


L24

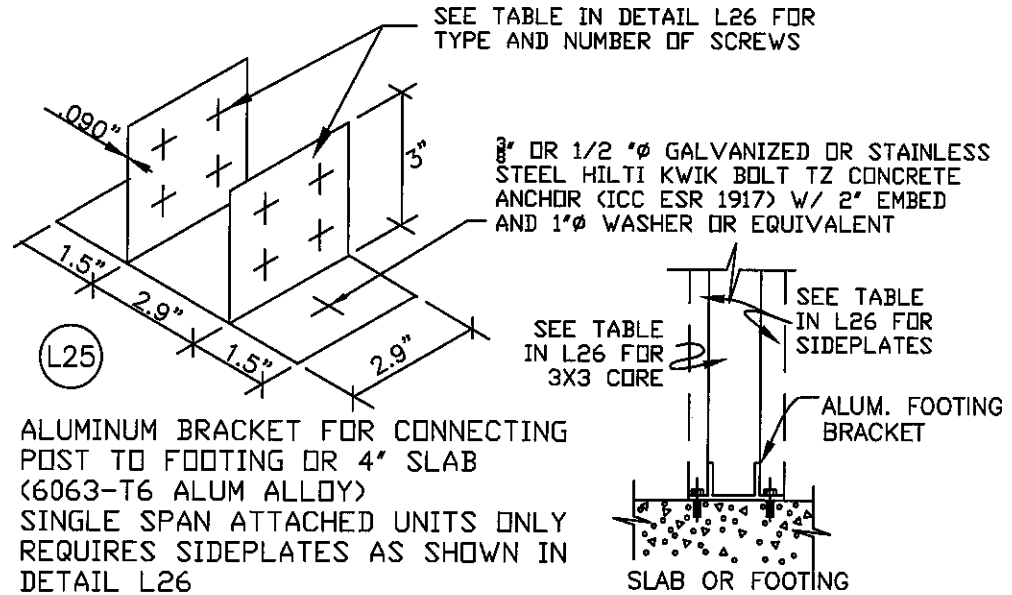


L25

ALUMINUM BRACKET FOR CONNECTING POST TO FOOTING OR 4' SLAB (6063-T6 ALUM ALLOY) SINGLE SPAN ATTACHED UNITS ONLY REQUIRES SIDEPLATES AS SHOWN IN DETAIL L26

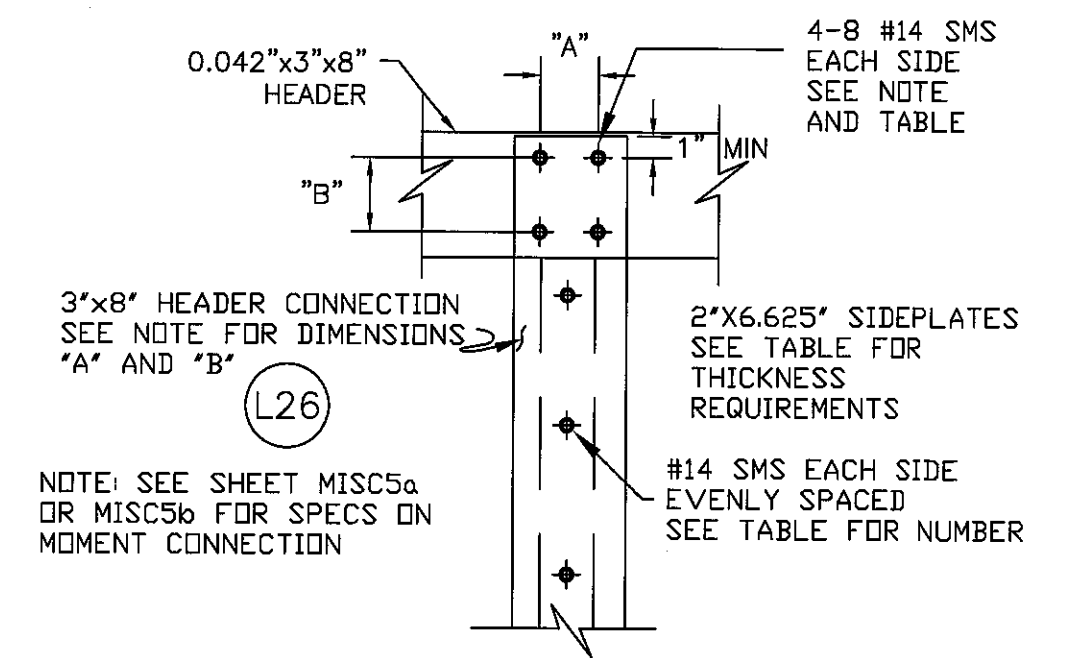


L26

FOOTING d (in)	Number of #14 SMS	Side Plates	3"x3" Core	Maximum Wind Condition for "On Slab" Attachment
26	8	0.024"x2"x6.625"	0.024"	115 mph Exp C (Lattice)
29	8	0.032"x2"x6.625"	0.032"	130 mph Exp C (Lattice)
30	12	0.024"x2"x6.625"	0.024"	130 mph Exp C (Lattice)

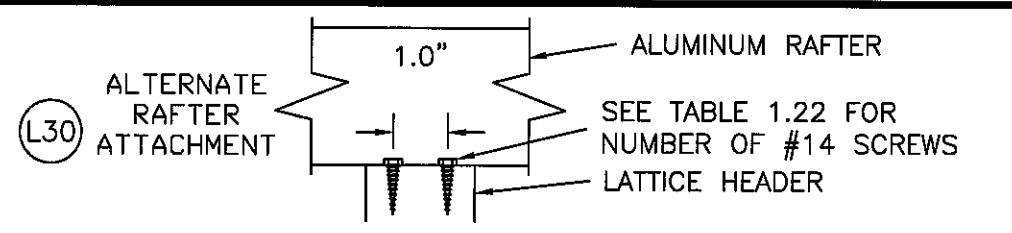


L30

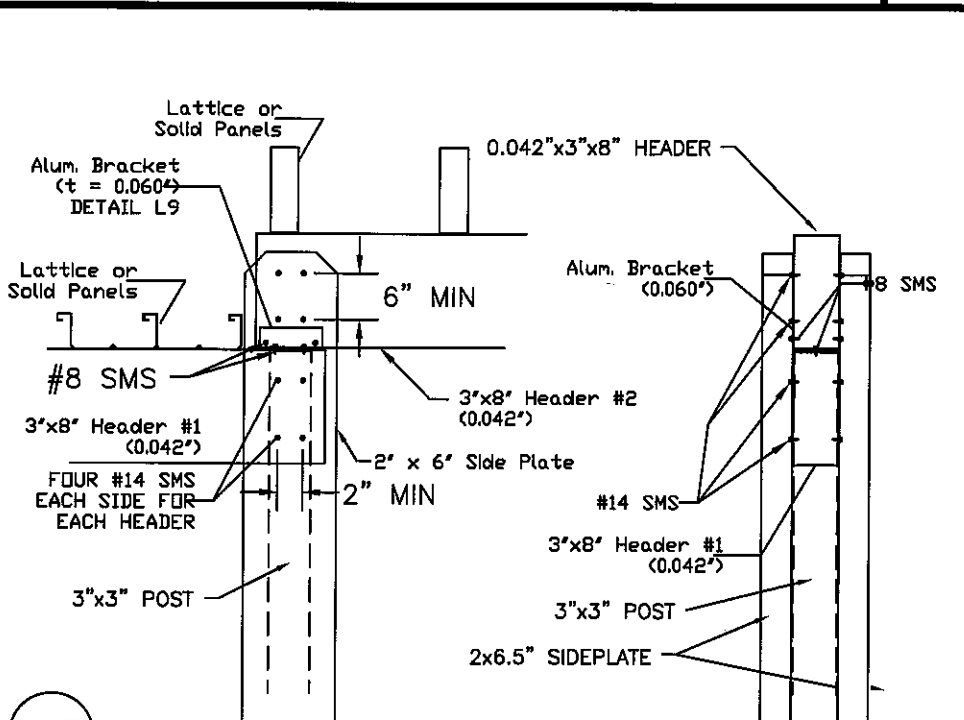


L27

ALTERNATIVE SPLICE FOR ATTACHED UNITS USE SAME TABLE IN L26 FOR FOOTING SIZES. USE TABLE IN N22 FOR "ON SLAB" CONNECTIONS

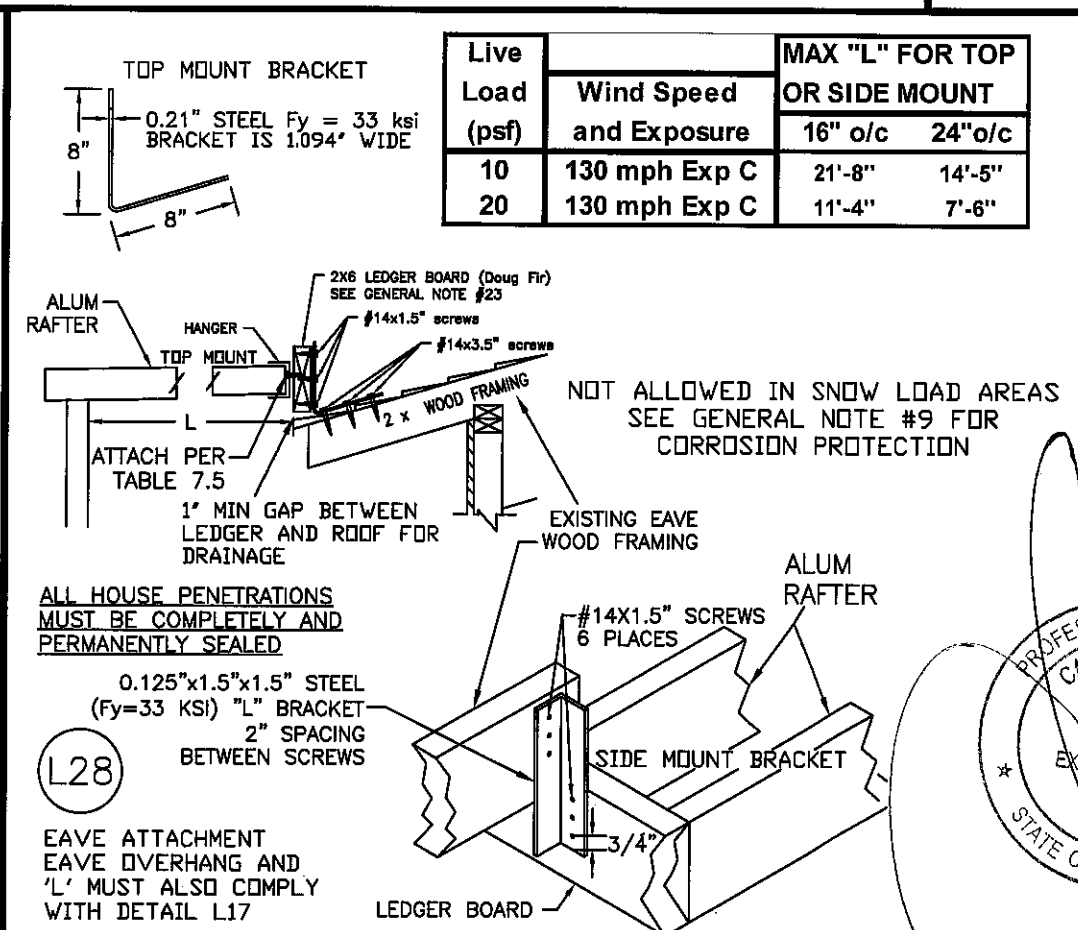


L28

EAVE ATTACHMENT EAVE OVERHANG AND 'L' MUST ALSO COMPLY WITH DETAIL L17

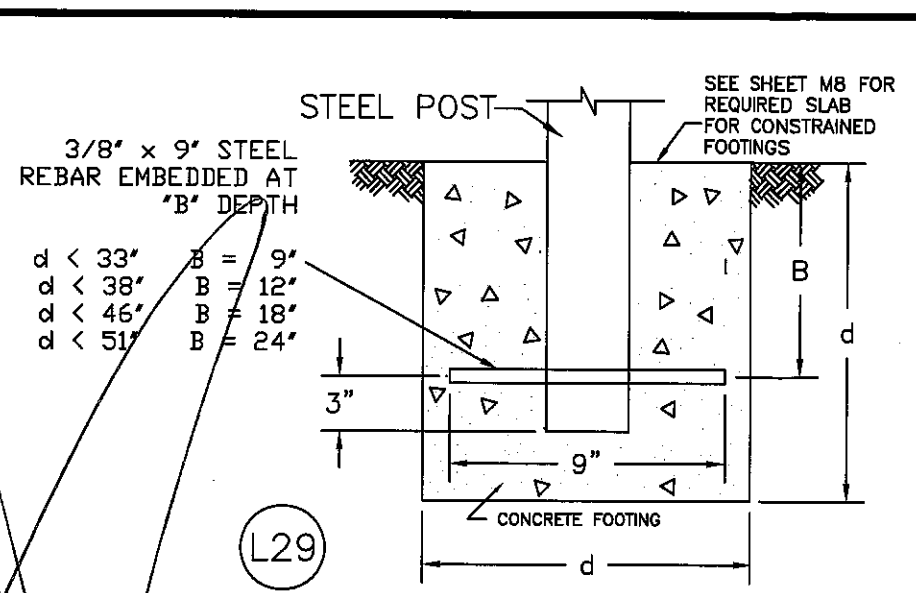

L29


FREESTANDING OR ATTACHED STRUCTURE COLUMN TO FOOTING CONNECTION DETAIL

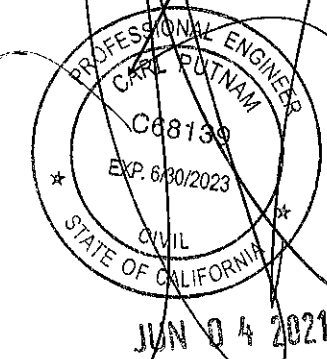


**Amerimax** 28921 US Hwy 74  
EXTERIOR HOME PRODUCTS Romoland, CA 92585

DRAWN BY: BEJ/CP TYPE: \_\_\_\_\_  
SCALE: NTS Component Parts & Connection Details For Patio & Commercial Lattice Structures  
DATE: \_\_\_\_\_ FILE: LT03-2018 SHEET: 3 of 4

**(L31) UNDERHUNG DOUBLE RAFTERS**

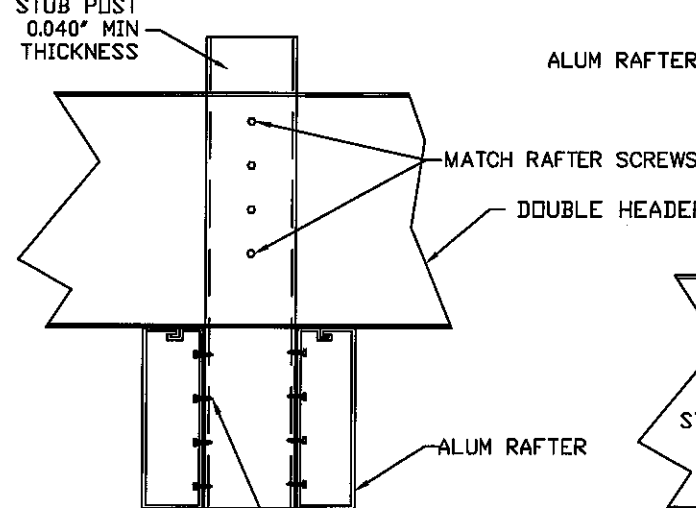


**(L32) DOUBLE RAFTERS**

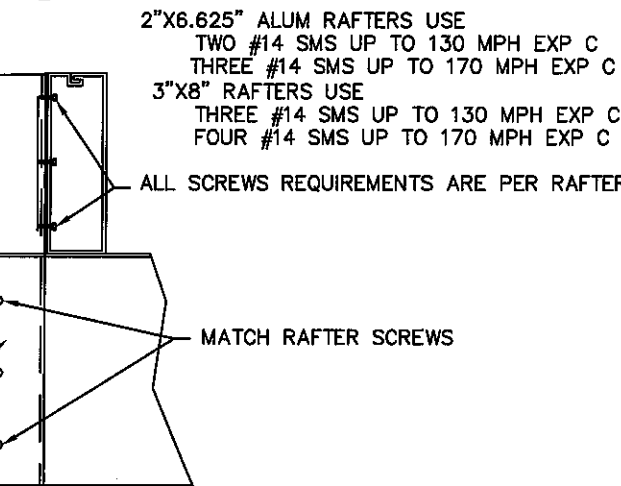

2"X6.625" RAFTERS USE  
 2 #14 SMS FOR 36 PSF GSL\* AND 170 MPH EXP C  
 3 #14 SMS FOR 60 PSF GSL AND 170 MPH EXP C  
 3"X8" RAFTERS USE  
 3 #14 SMS FOR 30 PSF GSL\* AND 170 MPH EXP C  
 4 #14 SMS FOR 60 PSF GSL\* AND 170 MPH EXP C  
 \*GSL = GROUND SNOW LOAD

2"X6.625" ALUM RAFTERS USE  
 TWO #14 SMS UP TO 130 MPH EXP C  
 THREE #14 SMS UP TO 170 MPH EXP C  
 3"X8" RAFTERS USE  
 THREE #14 SMS UP TO 130 MPH EXP C  
 FOUR #14 SMS UP TO 170 MPH EXP C  
 ALL SCREWS REQUIREMENTS ARE PER RAFTER

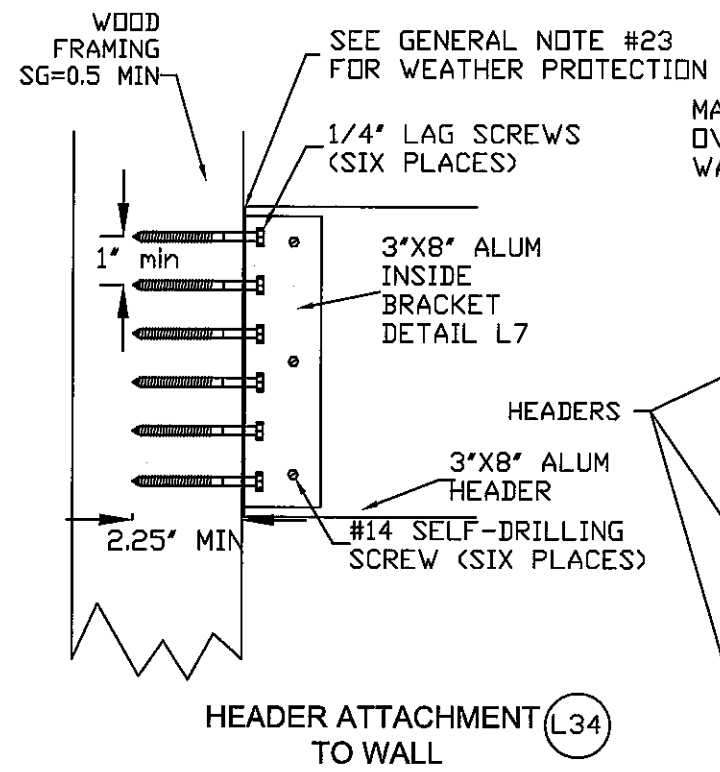

MAY NOT ATTACH HEADER OVER WINDOW OR OTHER WALL OPENING

**HEADER ATTACHMENT TO WALL (L34)**

DETAIL L29 or M5


MAX TRIBUTARY AREA

79 SQ. FT	FOR 10 PSF
62 SQ. FT	FOR 15 PSF GSL*
41 SQ. FT	FOR 20 PSF
47 SQ. FT	FOR 25 PSF GSL*
40 SQ. FT	FOR 30 PSF GSL*

\*GROUND SNOW LOAD


CHECK ALLOWABLE POST SPACING FOR HEADER IN TABLES

**(L33) CRIPPLE RESISTANT CONNECTION FOR RAFTERS**

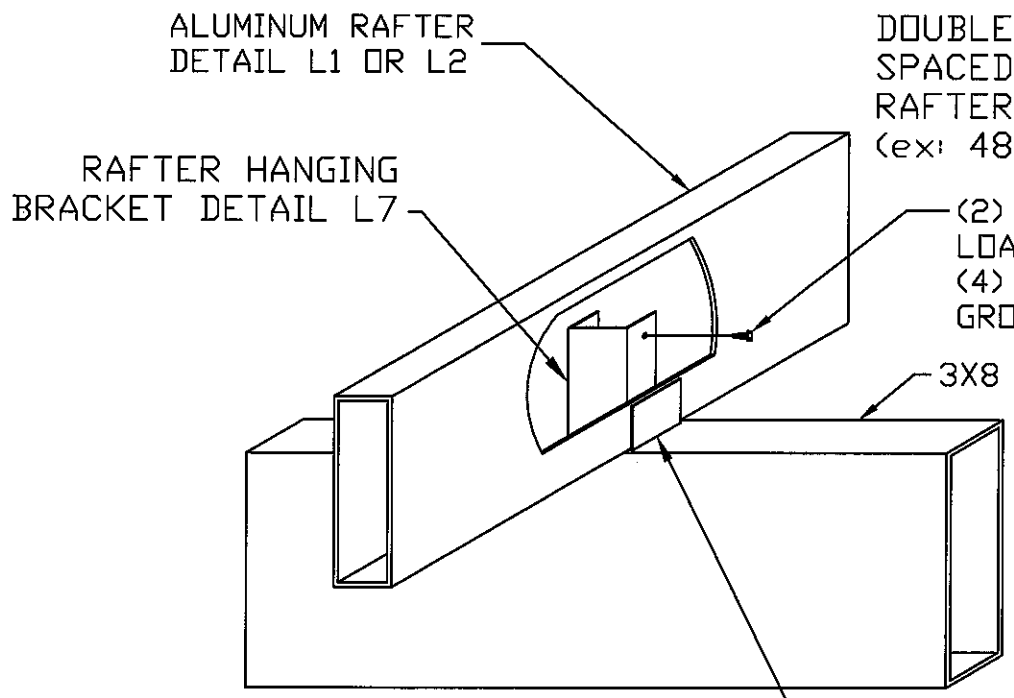

DOUBLE RAFTERS USING THIS DETAIL MAY BE SPACED AS PER TABLES 1.13-1.20 OR SINGLE RAFTERS MAY USE HALF OF THAT SPACING (ex: 48" FOR DOUBLE, 24" FOR SINGLE)


(2) #8 SCREWS FOR ALL GROUND SNOW LOADS UP TO 42 PSF  
 (4) #8 SCREWS FOR 42 to 60 PSF GROUND SNOW LOAD

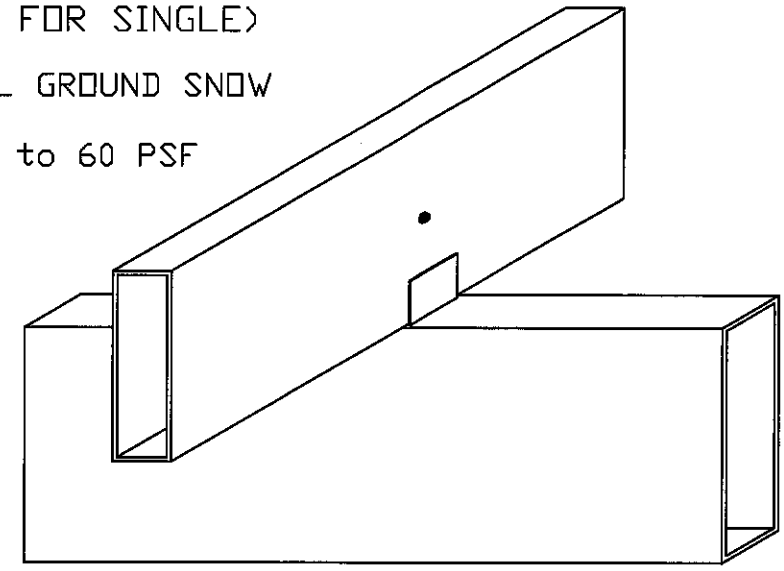

SECTIONED VIEW

ASSEMBLED VIEW

RAFTER MOUNTING BRACKET ATTACHED AS PER DETAIL L9

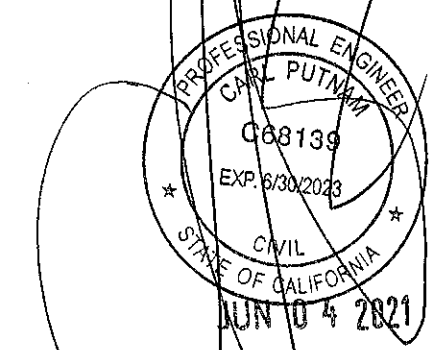

**Amerimax** 28921 US Hwy 74  
 EXTERIOR HOME PRODUCTS Romoland, CA 92585

DRAWN BY: CP	TYPE:
SCALE: NTS	Component Parts & Connection Details For Patio & Commercial Lattice Structures
DATE:	FILE: LT04-2018 SHEET: 4 of 4



**SECTION 4.0 SOLID COVER PANEL SPANS FOR ATTACHED COMMERCIAL AND PATIO STRUCTURES**

2.5" x 6" Super Six (Single Span) Detail N3, A									3.5" x 12 Super 12 (Single Span) Detail B									2.5" x 12" Mark X (Single Span) Detail E									2"x6" Flat Panel (Single Span) Detail N2, C																																																																																																																																
Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure																																																																																																																											
		Exposure B				Exposure C						Exposure B				Exposure C						Exposure B				Exposure C						Exposure B				Exposure C																																																																																																																							
		95	100	105	95	100	105	110			95	100	105	95	100	105	110			95	100	105	95	100	105	110			95	100	105	95	100	105	110			95	100	105	95	100	105	110																																																																																																															
10 LIVE	0.018	12'-6"	12'-0"	11'-4"	10'-6"	9'-11"	9'-5"	8'-11"	10	0.018	12'-9"	12'-9"	12'-9"	12'-5"	12'-0"	11'-5"	10'-10"	10	0.018	9'-9"	9'-4"	8'-10"	8'-2"	7'-9"	7'-4"	6'-11"	10	0.018	11'-0"	11'-0"	11'-0"	10'-8"	10'-4"	10'-1"	9'-10"	0.024	15'-10"	15'-5"	14'-7"	13'-6"	12'-8"	12'-0"	11'-5"	0.032	17'-4"	17'-4"	17'-4"	17'-4"	16'-7"	15'-8"	14'-10"	0.036	18'-0"	18'-0"	18'-0"	18'-0"	18'-0"	17'-5"	16'-6"	0.024	14'-7"	14'-7"	14'-7"	14'-2"	14'-2"	13'-5"	12'-8"	0.032	17'-2"	17'-2"	17'-2"	17'-2"	16'-7"	16'-2"	15'-4"	0.036	18'-4"	18'-4"	18'-4"	18'-4"	18'-4"	18'-3"	17'-4"	0.024	10'-4"	10'-4"	10'-4"	10'-0"	9'-7"	9'-3"	8'-11"	0.032	13'-11"	13'-11"	13'-11"	13'-11"	13'-11"	13'-11"	13'-11"	0.036	14'-11"	14'-11"	14'-11"	14'-11"	14'-7"	14'-4"	14'-1"	0.024	10'-4"	10'-4"	10'-4"	10'-1"	9'-11"	9'-9"	9'-4"	0.032	11'-10"	11'-10"	11'-10"	11'-8"	11'-6"	11'-5"	11'-3"	0.036	12'-4"	12'-4"	12'-4"	12'-2"	12'-0"	11'-8"	11'-8"	0.024	10'-4"	10'-4"	10'-4"	10'-1"	9'-11"	9'-9"	9'-4"	0.032	11'-10"	11'-10"	11'-10"	11'-8"	11'-6"	11'-5"	11'-3"	0.036	12'-4"	12'-4"	12'-4"	12'-2"	12'-0"	11'-8"	11'-8"

TABLE 4.4      TABLE 4.5      TABLE 4.6      TABLE 4.7


Amerimax Exterior Home Products  
 28921 US Hwy 74  
 Romoland, CA 92585

Carl Putnam, P. E.  
 3441 Ivylink Place  
 Lynchburg, VA 24503  
 (434) 384-2514  
 carlputnam@comcast.net

2.5" x 6" Super Six (Multispan) Detail N3, A									3.5" x 12 Super 12 (Multi Span) Detail B									2.5" x 12" Mark X (Multispan) Detail E									2"x6" Flat Panel (Multispan) Detail N2, C																																																																																																								
Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure																																																																																																			
		Exposure B				Exposure C						Exposure B				Exposure C						Exposure B				Exposure C						Exposure B				Exposure C																																																																																															
		95	100	105	95	100	105	110			95	100	105	95	100	105	110			95	100	105	95	100	105	110			95	100	105	95	100	105	110			95	100	105	95	100	105	110																																																																																							
10 LIVE	0.018	10'-6"	10'-6"	10'-6"	10'-6"	10'-6"	10'-0"	9'-6"	10	0.018	8'-4"	8'-4"	8'-4"	8'-4"	7'-11"	7'-7"	7'-7"	10	0.018	8'-3"	8'-3"	8'-3"	8'-3"	8'-0"	7'-9"	7'-8"	10	0.018	11'-0"	11'-0"	11'-0"	11'-0"	10'-10"	10'-4"	9'-10"	0.024	13'-0"	13'-0"	13'-0"	13'-0"	13'-0"	12'-5"	11'-10"	0.032	16'-4"	16'-4"	16'-4"	16'-4"	16'-4"	15'-10"	15'-1"	0.036	17'-11"	17'-11"	17'-11"	17'-11"	17'-11"	17'-4"	16'-7"	0.024	11'-5"	11'-5"	11'-5"	11'-5"	11'-5"	10'-11"	10'-6"	0.032	15'-8"	15'-8"	15'-8"	15'-8"	15'-8"	15'-0"	14'-6"	0.036	17'-6"	17'-6"	17'-6"	17'-6"	17'-6"	16'-10"	16'-3"	0.024	6'-7"	6'-7"	6'-7"	6'-7"	6'-5"	6'-4"	6'-2"	0.032	8'-9"	8'-9"	8'-9"	8'-9"	8'-9"	8'-7"	8'-5"	0.036	11'-4"	11'-4"	11'-4"	11'-4"	11'-4"	11'-2"	10'-11"	0.024	6'-7"	6'-7"	6'-7"	6'-7"	6'-5"	6'-4"	6'-2"	0.032	8'-9"	8'-9"	8'-9"	8'-9"	8'-9"	8'-7"	8'-5"	0.036	11'-4"	11'-4"	11'-4"	11'-4"	11'-4"	11'-2"	10'-11"

TABLE 4.8      TABLE 4.9      TABLE 4.10      TABLE 4.11

NOTE: PANELS MAY OVERHANG 25% OF THEIR CLEARSPAN

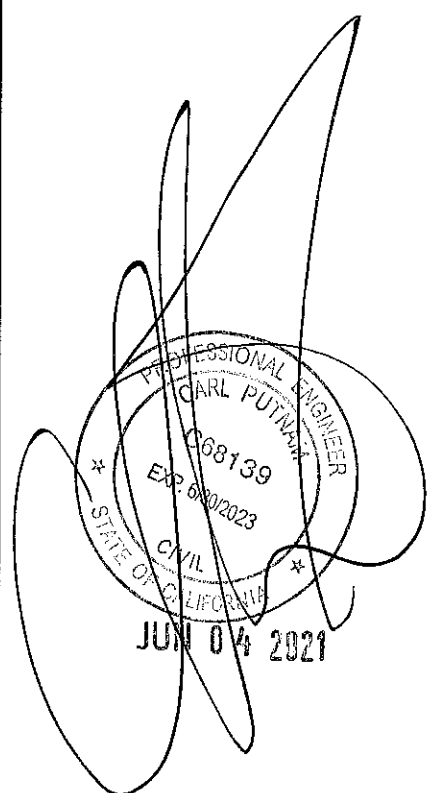



**SECTION 4.0 SOLID COVER PANEL SPANS FOR ATTACHED COMMERCIAL AND PATIO STRUCTURES**

2.5" x6" Super Six (Single Span) Detail N3, A

3.5" x12 Super 12 (Single Span) Detail B

2.5" x 12" Mark X (Single Span) Detail B

2"x6" Flat Panel (Single Span) Detail N2, C

Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure																											
		Exposure C				Exposure C						Exposure C				Exposure C						Exposure C				Exposure C						Exposure C																											
		115	120	130	140	150	160	170			115	120	130	140	150	160	170			115	120	130	140	150	160	170			115	120	130	140	150	160	170			115	120	130	140	150	160	170															
10 LIVE	0.018	8'-6"	8'-1"	7'-5"	6'-10"	6'-4"	5'-10"	5'-6"	10	0.018	10'-3"	9'-10"	9'-0"	8'-3"	7'-8"	6'-10"	6'-4"	10	0.018	6'-7"	6'-4"	5'-9"	5'-4"	5'-0"	4'-8"	4'-4"	10	0.018	9'-7"	9'-2"	8'-9"	8'-5"	7'-10"	7'-3"	6'-10"	0.024	10'-10"	10'-4"	9'-5"	8'-8"	8'-0"	7'-6"	7'-0"	0.032	14'-1"	13'-5"	12'-3"	11'-3"	10'-5"	9'-8"	9'-1"	0.036	15'-8"	14'-11"	13'-7"	12'-6"	11'-7"	10'-9"	10'-1"

TABLE 4.12

TABLE 4.13

TABLE 4.14

TABLE 4.15

NOTE: PANELS MAY OVERHANG 25% OF THEIR CLEARSPAN

2.5" x6" Super Six (Multispan) Detail N3, A

3.5" x12 Super 12 (Multi Span) Detail B

2.5" x 12" Mark X (Multispan) Detail B

2"x6" Flat Panel (Multispan) Detail N2, C


Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure																												
		Exposure C				Exposure C						Exposure C				Exposure C						Exposure C				Exposure C						Exposure C																												
		115	120	130	140	150	160	170			115	120	130	140	150	160	170			115	120	130	140	150	160	170			115	120	130	140	150	160	170			115	120	130	140	150	160	170																
10 LIVE	0.018	9'-1"	8'-8"	7'-11"	7'-4"	6'-9"	6'-3"	5'-11"	10	0.018	6'-11"	6'-7"	6'-1"	5'-4"	4'-10"	4'-5"	4'-1"	10	0.018	7'-1"	6'-9"	6'-2"	5'-8"	5'-3"	4'-11"	4'-7"	10	0.018	9'-5"	9'-0"	8'-3"	7'-7"	7'-0"	6'-6"	6'-1"	0.024	11'-4"	10'-10"	10'-0"	9'-3"	8'-8"	8'-0"	7'-6"	7'-0"	0.032	14'-5"	13'-9"	12'-8"	11'-8"	10'-11"	10'-3"	9'-8"	0.036	15'-10"	15'-2"	13'-11"	12'-11"	12'-1"	11'-3"	10'-7"

TABLE 4.16

TABLE 4.17

TABLE 4.18

TABLE 4.19

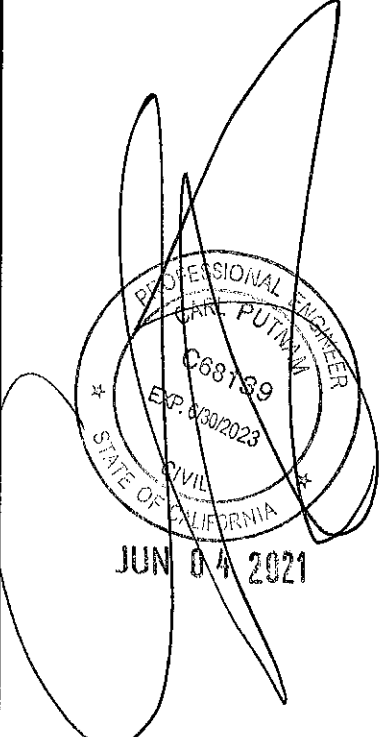

SECTION 4.0 SOLID COVER PANEL SPANS FOR FREESTANDING COMMERCIAL AND PATIO STRUCTURES

2.5" x6" Super Six (Single Span) Detail N3, A

3.5"x12" Super 12 (Single Span) Detail D

2.5" x 12" Mark X (Single Span) Detail B

2"x6" Flat Panel (Single Span) Detail N2, C

Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							
		Exposure B				Exposure C						Exposure B				Exposure C						Exposure B				Exposure C						Exposure B				Exposure C			
		100	110	115	95	100	105	110	95			100	110	115	95	100	105	110	95			100	110	115	95	100	105	110	95			100	110	115	95	100	105	110	95
10	0.018	12'-6"	12'-6"	12'-1"	12'-1"	12'-1"	11'-9"	11'-5"	10	0.018	12'-9"	12'-9"	12'-5"	12'-5"	12'-5"	12'-0"	11'-8"	10	0.018	9'-2"	8'-2"	7'-10"	8'-8"	8'-2"	7'-10"	7'-5"	10	0.018	11'-0"	11'-0"	10'-8"	10'-8"	10'-8"	10'-4"	8'-11"				
LIVE	0.024	15'-10"	15'-10"	15'-2"	15'-5"	15'-5"	15'-0"	14'-4"	LIVE	0.024	14'-7"	14'-7"	14'-2"	14'-2"	14'-2"	13'-9"	13'-5"	LIVE	0.024	12'-5"	12'-5"	12'-2"	12'-2"	12'-2"	11'-11"	11'-8"	LIVE	0.024	13'-3"	13'-3"	12'-11"	12'-11"	12'-11"	12'-8"	12'-6"				
	0.032	17'-4"	17'-4"	17'-0"	17'-0"	17'-0"	16'-8"	16'-5"		0.032	17'-2"	17'-2"	16'-7"	16'-7"	16'-7"	16'-2"	15'-8"		0.032	13'-7"	13'-7"	13'-4"	13'-4"	13'-4"	13'-1"	12'-10"		0.032	14'-6"	14'-6"	14'-2"	14'-2"	14'-2"	13'-11"	13'-8"				
	0.036	18'-0"	18'-0"	17'-8"	17'-8"	17'-8"	17'-4"	17'-0"		0.036	18'-4"	18'-4"	17'-9"	17'-9"	17'-9"	16'-9"	16'-9"		0.036	14'-1"	14'-1"	13'-10"	13'-10"	13'-10"	13'-7"	13'-4"		0.040	15'-6"	15'-6"	15'-3"	15'-3"	15'-3"	14'-11"	14'-8"				

TABLE 4.20

TABLE 4.21

TABLE 4.22

TABLE 4.23

NOTE: PANELS MAY OVERHANG 25% OF THEIR CLEARSPAN

2.5" x6" Super Six (Multispan) Detail N3, A

3.5"x12" Super 12 (Multispan) Detail D

2.5" x 12" Mark X (Multispan) Detail B

2"x6" Flat Panel (Multispan) Detail N2, C


Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure								Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							
		Exposure B				Exposure C						Exposure B				Exposure C						Exposure B				Exposure C						Exposure B				Exposure C			
		100	110	115	95	100	105	110	95			100	110	115	95	100	105	110	95			100	110	115	95	100	105	110	95			100	110	115	95	100	105	110	95
10	0.018	10'-6"	10'-6"	10'-2"	10'-2"	10'-2"	9'-10"	9'-7"	10	0.018	8'-4"	8'-4"	7'-11"	7'-11"	7'-11"	7'-7"	7'-3"	10	0.018	8'-3"	8'-3"	8'-0"	8'-0"	8'-0"	7'-9"	7'-6"	10	0.018	11'-0"	11'-0"	10'-8"	10'-8"	10'-8"	10'-4"	10'-1"				
LIVE	0.024	13'-0"	13'-0"	12'-7"	12'-7"	12'-7"	12'-3"	11'-11"	LIVE	0.024	11'-5"	11'-5"	10'-11"	10'-11"	10'-11"	10'-6"	10'-1"	LIVE	0.024	10'-11"	10'-11"	10'-7"	10'-7"	10'-7"	10'-3"	9'-11"	LIVE	0.024	13'-3"	13'-3"	12'-11"	12'-11"	12'-11"	12'-8"	12'-6"				
	0.032	16'-4"	16'-4"	15'-10"	15'-10"	15'-10"	15'-5"	15'-0"		0.032	15'-8"	15'-8"	15'-0"	15'-0"	15'-0"	14'-6"	14'-0"		0.032	13'-7"	13'-7"	13'-2"	13'-2"	13'-2"	12'-9"	12'-5"		0.032	14'-6"	14'-6"	14'-2"	14'-2"	14'-2"	13'-11"	13'-8"				
	0.036	17'-11"	17'-11"	17'-4"	17'-4"	17'-4"	16'-11"	16'-5"		0.036	17'-6"	17'-6"	16'-10"	16'-10"	16'-10"	16'-3"	15'-9"		0.036	14'-0"	14'-0"	13'-7"	13'-7"	13'-7"	13'-2"	12'-10"		0.040	15'-6"	15'-6"	15'-3"	15'-3"	15'-3"	14'-11"	14'-8"				

TABLE 4.24

TABLE 4.25

TABLE 4.26

TABLE 4.27

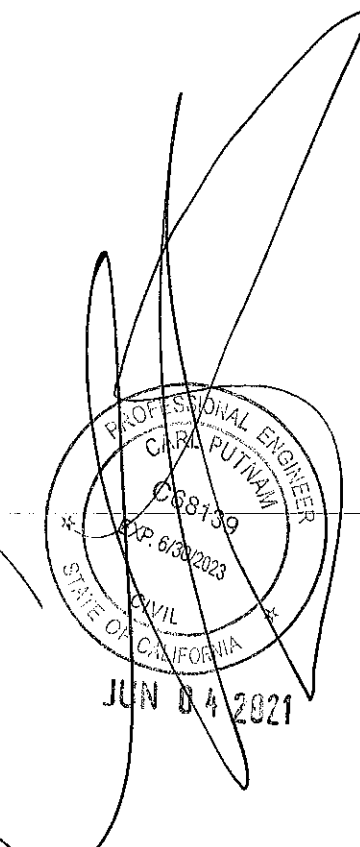

**SECTION 4.0 SOLID COVER PANEL SPANS FOR FREESTANDING COMMERCIAL AND PATIO STRUCTURES**

2.5" x6" Super Six (Single Span) Detail N3, A

3.5"x12" Super 12 (Single Span) Detail D

2.5" x 12" Mark X (Single Span) Detail E

2"x8" Flat Panel (Single Span) Detail N2, C

Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure						
		Exposure C			Exposure C						Exposure C			Exposure C						Exposure C			Exposure C												
		115	120	130	140	150	160	170			115	120	130	140	150	160	170			115	120	130	140	150	160	170			115	120	130	140	150	160	170
10	0.018	11'-0"	10'-6"	7'-10"	7'-4"	6'-10"	6'-4"	6'-0"	10	0.018	11'-5"	11'-1"	10'-7"	7'-3"	6'-8"	5'-10"	5'-4"	10	0.018	7'-1"	6'-10"	6'-3"	5'-10"	5'-5"	3'-7"	3'-4"	10	0.018	8'-7"	8'-5"	7'-10"	7'-6"	7'-1"	6'-7"	6'-3"
LIVE	0.024	13'-9"	13'-2"	12'-1"	11'-2"	10'-5"	7'-11"	7'-6"	LIVE	0.024	13'-0"	12'-9"	12'-2"	11'-5"	11'-0"	10'-5"	8'-3"	LIVE	0.024	11'-4"	11'-0"	8'-3"	7'-8"	7'-1"	6'-8"	6'-3"	LIVE	0.024	12'-3"	12'-1"	11'-8"	11'-0"	10'-7"	8'-7"	8'-0"
	0.032	16'-1"	15'-10"	15'-4"	14'-3"	13'-3"	12'-5"	11'-8"		0.032	15'-4"	14'-11"	14'-3"	13'-5"	12'-11"	12'-3"	11'-8"		0.032	12'-7"	12'-5"	12'-0"	11'-6"	10'-11"	8'-3"	7'-10"		0.032	13'-5"	13'-3"	12'-10"	12'-4"	12'-0"	11'-7"	11'-3"
	0.036	16'-9"	16'-5"	15'-4"	14'-7"	13'-8"	12'-10"			0.036	16'-4"	15'-9"	15'-3"	14'-4"	13'-10"	12'-6"	11'-8"		0.036	13'-1"	12'-11"	12'-6"	12'-0"	11'-3"	10'-7"	8'-1"		0.040	14'-5"	14'-2"	13'-9"	13'-3"	12'-11"	12'-6"	12'-1"

TABLE 4.28

TABLE 4.29

TABLE 4.30

TABLE 4.31

NOTE: PANELS MAY OVERHANG 25% OF THEIR CLEARSPAN

2.5" x6" Super Six (Multispan) Detail N3, A

3.5"x12" Super 12 (Multispan) Detail D

2.5" x 12" Mark X (Multispan) Detail E

2"x8" Flat Panel (Multispan) Detail N2, C


Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure							Ground Snow Load (psf)	Panel Gauge (in)	Wind Speed and Exposure						
		Exposure C			Exposure C						Exposure C			Exposure C						Exposure C			Exposure C												
		115	120	130	140	150	160	170			115	120	130	140	150	160	170			115	120	130	140	150	160	170			115	120	130	140	150	160	170
10	0.018	9'-4"	9'-1"	7'-5"	7'-0"	6'-8"	6'-4"	7'-0"	10	0.018	6'-11"	6'-7"	4'-8"	4'-4"	3'-11"	3'-7"	3'-3"	10	0.018	7'-4"	7'-1"	5'-9"	5'-5"	5'-1"	4'-10"	5'-5"	10	0.018	9'-10"	9'-7"	7'-10"	7'-6"	7'-1"	6'-9"	7'-6"
LIVE	0.024	11'-7"	11'-4"	9'-3"	8'-10"	8'-4"	7'-11"	8'-10"	LIVE	0.024	9'-8"	9'-4"	6'-10"	6'-4"	5'-10"	5'-4"	6'-4"	LIVE	0.024	9'-8"	9'-5"	7'-8"	7'-3"	6'-10"	6'-6"	7'-3"	LIVE	0.024	12'-3"	12'-1"	10'-1"	9'-7"	9'-1"	8'-7"	9'-7"
	0.032	14'-7"	14'-3"	11'-8"	11'-2"	10'-7"	10'-0"	11'-2"		0.032	13'-6"	13'-1"	10'-0"	9'-4"	8'-8"	8'-0"	9'-4"		0.032	12'-1"	11'-9"	9'-7"	9'-2"	8'-8"	8'-2"	9'-2"		0.032	13'-5"	13'-3"	11'-7"	11'-3"	10'-10"	10'-6"	11'-3"
	0.036	16'-0"	15'-8"	12'-10"	12'-3"	11'-7"	11'-0"	12'-3"		0.036	15'-3"	14'-9"	11'-5"	10'-9"	9'-11"	9'-3"	10'-9"		0.036	12'-6"	12'-2"	9'-11"	9'-6"	8'-11"	8'-6"	9'-6"		0.040	14'-5"	14'-2"	12'-10"	12'-6"	12'-1"	11'-8"	12'-1"

TABLE 4.32

TABLE 4.33

TABLE 4.34

TABLE 4.35

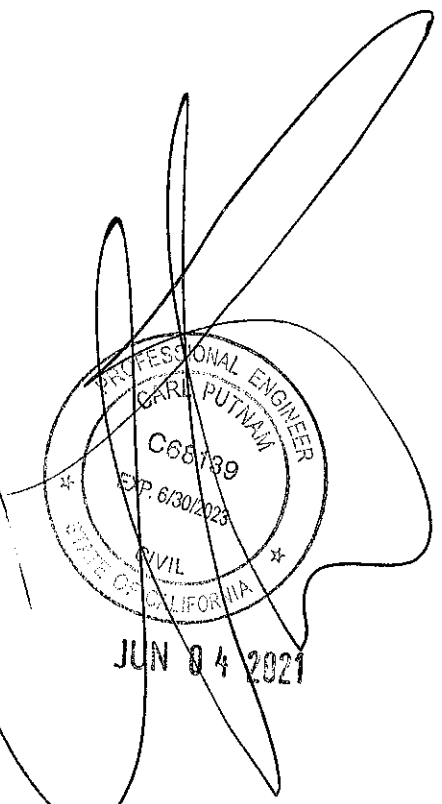

Headers	Panel Thickness (in)	100 MPH EXP B				105 MPH EXP B			110 MPH EXP B			100 MPH EXP C or 115 MPH EXP B					105 MPH EXP C or 120 MPH EXP B						110 MPH EXP C or 130 MPH EXP B						
		1	2	3	4	1	2	3	1	2	3	1	2	3	4	5	1	2	3	4	5	6	1	2	3	4	5	6	7
		Number of #10 Sheet Metal Screws Required per foot at Header/Panel Connection																											
Dble Headers	0.018	6'	12'	MAX	MAX	5'	11'	MAX	5'	10'	MAX	4'	8'	12'	MAX	MAX	4'	8'	11'	MAX	MAX	MAX	3'	7'	10'	MAX	MAX	MAX	MAX
Single 3x8	0.018	3'	6'	9'	12'	3'	5'	8'	2'	5'	7'	2'	4'	6'	8'	10'	2'	4'	6'	8'	9'	11'	2'	3'	5'	7'	9'	10'	12'
0.060" Alum	0.018	3'	6'	9'	12'	3'	5'	8'	2'	5'	7'	2'	4'	6'	8'	10'	2'	4'	6'	8'	9'	11'	2'	3'	5'	7'	9'	10'	12'
All others	0.018	3'	6'	9'	12'	3'	5'	8'	2'	5'	7'	2'	4'	6'	8'	10'	2'	4'	6'	8'	9'	11'	2'	3'	5'	7'	9'	10'	12'
Dble Headers	0.024	8'	16'	MAX	MAX	7'	14'	MAX	6'	13'	MAX	6'	11'	MAX	MAX	MAX	5'	10'	15'	MAX	MAX	MAX	5'	9'	14'	MAX	MAX	MAX	MAX
Single 3x8	0.024	4'	8'	12'	16'	4'	7'	11'	3'	6'	10'	3'	6'	8'	11'	14'	3'	5'	8'	10'	13'	15'	2'	5'	7'	9'	11'	14'	MAX
0.060" Alum	0.024	4'	8'	12'	16'	4'	7'	11'	3'	6'	10'	3'	6'	8'	11'	14'	3'	5'	8'	10'	13'	15'	2'	5'	7'	9'	11'	14'	MAX
All others	0.024	4'	8'	12'	16'	4'	7'	11'	3'	6'	10'	3'	6'	8'	11'	14'	3'	5'	8'	10'	13'	15'	2'	5'	7'	9'	11'	14'	MAX
Dble Headers	0.032	10'	MAX	MAX	MAX	9'	MAX	MAX	9'	17'	MAX	7'	15'	MAX	MAX	MAX	7'	13'	MAX	MAX	MAX	MAX	6'	12'	MAX	MAX	MAX	MAX	MAX
Single 3x8	0.032	5'	10'	16'	MAX	5'	9'	14'	4'	9'	13'	4'	7'	11'	15'	MAX	3'	7'	10'	13'	17'	MAX	3'	6'	9'	12'	15'	MAX	MAX
0.060" Alum	0.032	5'	10'	16'	MAX	5'	9'	14'	4'	9'	13'	4'	7'	11'	15'	MAX	3'	7'	10'	13'	17'	MAX	3'	6'	9'	12'	15'	MAX	MAX
All others	0.032	5'	10'	16'	MAX	5'	9'	14'	4'	9'	13'	4'	7'	11'	15'	MAX	3'	7'	10'	13'	17'	MAX	3'	6'	9'	12'	15'	MAX	MAX
Dble Headers	0.036	11'	MAX	MAX	MAX	10'	MAX	MAX	9'	17'	MAX	7'	15'	MAX	MAX	MAX	7'	14'	MAX	MAX	MAX	MAX	6'	12'	MAX	MAX	MAX	MAX	MAX
Single 3x8	0.036	6'	11'	17'	MAX	5'	10'	15'	5'	9'	14'	4'	8'	12'	16'	MAX	4'	7'	11'	14'	18'	MAX	3'	6'	10'	13'	16'	MAX	MAX
0.060" Alum	0.036	6'	12'	18'	MAX	5'	11'	16'	5'	10'	15'	4'	8'	12'	17'	MAX	4'	8'	11'	15'	MAX	MAX	3'	7'	10'	14'	17'	MAX	MAX
All others	0.036	6'	12'	18'	MAX	5'	11'	16'	5'	10'	15'	4'	8'	12'	17'	MAX	4'	8'	11'	15'	MAX	MAX	3'	7'	10'	14'	17'	MAX	MAX


Table 4.36a Maximum Tributary Width for Each Header/Panel and Number of #10 Screw Combination

Headers	Panel Thickness (in)	100 MPH EXP B			105 MPH EXP B			110 MPH EXP B			100 MPH EXP C or 115 MPH EXP B					105 MPH EXP C or 120 MPH EXP B						110 MPH EXP C or 130 MPH EXP B							
		1	2	3	1	2	3	1	2	3	1	2	3	4	5	1	2	3	4	5	6	1	2	3	4	5	6		
		Number of #14 Sheet Metal Screws Required per foot at Header/Panel Connection																											
Dble Headers	0.018	11'	MAX	MAX	10'	MAX	MAX	9'	MAX	MAX	8'	MAX	MAX	MAX	MAX	7'	MAX	MAX	MAX	MAX	MAX	6'	MAX	MAX	MAX	MAX	MAX		
Single 3x8	0.018	6'	11'	MAX	5'	10'	MAX	5'	9'	MAX	4'	8'	12'	MAX	MAX	4'	7'	11'	MAX	MAX	MAX	3'	6'	10'	MAX	MAX	MAX		
0.060" Alum	0.018	6'	11'	MAX	5'	10'	MAX	5'	9'	MAX	4'	8'	12'	MAX	MAX	4'	7'	11'	MAX	MAX	MAX	3'	6'	10'	MAX	MAX	MAX		
All others	0.018	6'	11'	MAX	5'	10'	MAX	5'	9'	MAX	4'	8'	12'	MAX	MAX	4'	7'	11'	MAX	MAX	MAX	3'	6'	10'	MAX	MAX	MAX		
Dble Headers	0.024	14'	MAX	MAX	13'	MAX	MAX	11'	MAX	MAX	10'	MAX	MAX	MAX	MAX	9'	MAX	MAX	MAX	MAX	MAX	8'	MAX	MAX	MAX	MAX	MAX		
Single 3x8	0.024	7'	15'	MAX	7'	13'	MAX	6'	12'	MAX	5'	10'	16'	MAX	MAX	5'	9'	14'	MAX	MAX	MAX	4'	9'	13'	MAX	MAX	MAX		
0.060" Alum	0.024	7'	15'	MAX	7'	13'	MAX	6'	12'	MAX	5'	10'	16'	MAX	MAX	5'	9'	14'	MAX	MAX	MAX	4'	9'	13'	MAX	MAX	MAX		
All others	0.024	7'	15'	MAX	7'	13'	MAX	6'	12'	MAX	5'	10'	16'	MAX	MAX	5'	9'	14'	MAX	MAX	MAX	4'	9'	13'	MAX	MAX	MAX		
Dble Headers	0.032	14'	MAX	MAX	13'	MAX	MAX	11'	MAX	MAX	10'	MAX	MAX	MAX	MAX	9'	MAX	MAX	MAX	MAX	MAX	8'	16'	MAX	MAX	MAX	MAX		
Single 3x8	0.032	7'	15'	MAX	7'	13'	MAX	6'	12'	MAX	5'	10'	16'	MAX	MAX	5'	9'	14'	MAX	MAX	MAX	4'	9'	13'	17'	MAX	MAX		
0.060" Alum	0.032	10'	MAX	MAX	9'	MAX	MAX	8'	16'	MAX	7'	14'	MAX	MAX	MAX	6'	13'	MAX	MAX	MAX	MAX	6'	11'	17'	MAX	MAX	MAX		
All others	0.032	10'	MAX	MAX	9'	MAX	MAX	8'	16'	MAX	7'	14'	MAX	MAX	MAX	6'	13'	MAX	MAX	MAX	MAX	6'	11'	17'	MAX	MAX	MAX		
Dble Headers	0.036	14'	MAX	MAX	13'	MAX	MAX	11'	MAX	MAX	10'	MAX	MAX	MAX	MAX	9'	18'	MAX	MAX	MAX	MAX	8'	16'	MAX	MAX	MAX	MAX		
Single 3x8	0.036	7'	15'	MAX	7'	13'	MAX	6'	12'	MAX	5'	10'	16'	MAX	MAX	5'	9'	14'	MAX	MAX	MAX	4'	9'	13'	17'	MAX	MAX		
0.060" Alum	0.036	10'	MAX	MAX	9'	18'	MAX	8'	16'	MAX	7'	14'	MAX	MAX	MAX	6'	13'	MAX	MAX	MAX	MAX	6'	11'	17'	MAX	MAX	MAX		
All others	0.036	11'	MAX	MAX	10'	MAX	MAX	9'	MAX	MAX	8'	16'	MAX	MAX	MAX	7'	14'	MAX	MAX	MAX	MAX	6'	13'	MAX	MAX	MAX	MAX		

Table 4.37a Maximum Tributary Width for Each Header/Panel and Number of #14 Screw Combination

Amerimax Exterior Home Products  
 28921 US Hwy 74  
 Romoland, CA 92585

Carl Putnam, P. E.  
 3441 Ivylink Place  
 Lynchburg, VA 24503  
 (434) 384-2514  
[carlputnam@comcast.net](mailto:carlputnam@comcast.net)

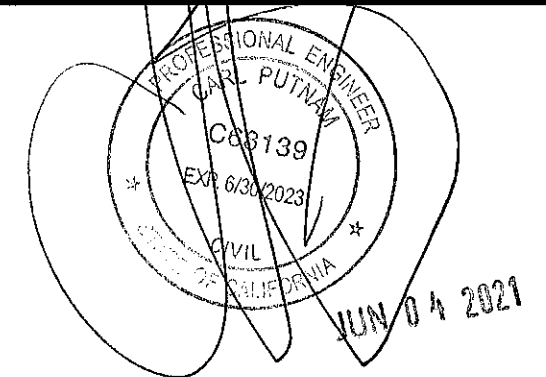



Headers	Panel Thickness (in)	115 MPH EXP C or 130 MPH EXP B				120 MPH EXP C or 140 MPH EXP B			130 MPH EXP C or 150 MPH EXP B			140 MPH EXP C or 160 MPH EXP B					150 MPH EXP C or 170 MPH EXP B						160 MPH EXP C or 170 MPH EXP B						
		1	2	3	4	1	2	3	1	2	3	1	2	3	4	5	1	2	3	4	5	6	1	2	3	4	5	6	7
		Number of #10 Sheet Metal Screws Required per foot at Header/Panel Connection																											
Dble Headers	0.018	3'	6'	9'	12'	3'	6'	9'	2'	5'	7'	2'	4'	6'	8'	10'	2'	4'	5'	7'	9'	11'	2'	3'	5'	6'	8'	10'	11'
Single 3x8	0.018	2'	3'	5'	6'	1'	3'	4'	1'	2'	4'	1'	2'	3'	4'	5'	1'	2'	3'	4'	5'	5'	1'	2'	2'	3'	4'	5'	6'
0.060" Alum	0.018	2'	3'	5'	6'	1'	3'	4'	1'	2'	4'	1'	2'	3'	4'	5'	1'	2'	3'	4'	5'	5'	1'	2'	2'	3'	4'	5'	6'
All others	0.018	2'	3'	5'	6'	1'	3'	4'	1'	2'	4'	1'	2'	3'	4'	5'	1'	2'	3'	4'	5'	5'	1'	2'	2'	3'	4'	5'	6'
Dble Headers	0.024	4'	8'	12'	MAX	4'	8'	11'	3'	6'	10'	3'	6'	8'	11'	14'	2'	5'	7'	10'	12'	15'	2'	4'	6'	8'	11'	13'	15'
Single 3x8	0.024	2'	4'	6'	8'	2'	4'	6'	2'	3'	5'	1'	3'	4'	6'	7'	1'	2'	4'	5'	6'	7'	1'	2'	3'	4'	5'	6'	7'
0.060" Alum	0.024	2'	4'	6'	8'	2'	4'	6'	2'	3'	5'	1'	3'	4'	6'	7'	1'	2'	4'	5'	6'	7'	1'	2'	3'	4'	5'	6'	7'
All others	0.024	2'	4'	6'	8'	2'	4'	6'	2'	3'	5'	1'	3'	4'	6'	7'	1'	2'	4'	5'	6'	7'	1'	2'	3'	4'	5'	6'	7'
Dble Headers	0.032	6'	11'	17'	MAX	5'	10'	15'	4'	9'	13'	4'	7'	11'	15'	MAX	3'	6'	10'	13'	16'	MAX	3'	6'	8'	11'	14'	17'	MAX
Single 3x8	0.032	3'	6'	8'	11'	3'	5'	8'	2'	4'	6'	2'	4'	6'	7'	9'	2'	3'	5'	6'	8'	10'	1'	3'	4'	6'	7'	8'	10'
0.060" Alum	0.032	3'	6'	8'	11'	3'	5'	8'	2'	4'	6'	2'	4'	6'	7'	9'	2'	3'	5'	6'	8'	10'	1'	3'	4'	6'	7'	8'	10'
All others	0.032	3'	6'	8'	11'	3'	5'	8'	2'	4'	6'	2'	4'	6'	7'	9'	2'	3'	5'	6'	8'	10'	1'	3'	4'	6'	7'	8'	10'
Dble Headers	0.036	6'	11'	17'	MAX	5'	10'	15'	4'	9'	13'	4'	8'	11'	15'	MAX	3'	7'	10'	13'	16'	MAX	3'	6'	9'	11'	14'	17'	MAX
Single 3x8	0.036	3'	6'	9'	12'	3'	5'	8'	2'	5'	7'	2'	4'	6'	8'	10'	2'	3'	5'	7'	9'	10'	2'	3'	5'	6'	8'	9'	11'
0.060" Alum	0.036	3'	6'	9'	12'	3'	6'	9'	2'	5'	7'	2'	4'	6'	8'	10'	2'	4'	5'	7'	9'	11'	2'	3'	5'	6'	8'	10'	11'
All others	0.036	3'	6'	9'	12'	3'	6'	9'	2'	5'	7'	2'	4'	6'	8'	10'	2'	4'	5'	7'	9'	11'	2'	3'	5'	6'	8'	10'	11'


Table 4.36b Maximum Tributary Width for Each Header/Panel and Number of #10 Screw Combination

Headers	Panel Thickness (in)	115 MPH EXP C or 130 MPH EXP B			120 MPH EXP C or 140 MPH EXP B			130 MPH EXP C or 150 MPH EXP B			140 MPH EXP C or 160 MPH EXP B					150 MPH EXP C or 170 MPH EXP B						160 MPH EXP C or 170 MPH EXP B							
		1	2	3	1	2	3	1	2	3	1	2	3	4	5	1	2	3	4	5	6	1	2	3	4	5	6		
		Number of #14 Sheet Metal Screws Required per foot at Header/Panel Connection																											
Dble Headers	0.018	6'	12'	MAX	5'	11'	MAX	5'	9'	MAX	4'	8'	12'	MAX	MAX	3'	7'	10'	MAX	MAX	MAX	3'	6'	9'	12'	MAX	MAX		
Single 3x8	0.018	3'	6'	9'	3'	5'	8'	2'	5'	7'	2'	4'	6'	8'	10'	2'	3'	5'	7'	9'	10'	2'	3'	5'	6'	8'	9'		
0.060" Alum	0.018	3'	6'	9'	3'	5'	8'	2'	5'	7'	2'	4'	6'	8'	10'	2'	3'	5'	7'	9'	10'	2'	3'	5'	6'	8'	9'		
All others	0.018	3'	6'	9'	3'	5'	8'	2'	5'	7'	2'	4'	6'	8'	10'	2'	3'	5'	7'	9'	10'	2'	3'	5'	6'	8'	9'		
Dble Headers	0.024	7'	15'	MAX	7'	14'	MAX	6'	12'	MAX	5'	10'	15'	MAX	MAX	4'	9'	13'	MAX	MAX	MAX	4'	8'	11'	15'	MAX	MAX		
Single 3x8	0.024	4'	8'	12'	4'	7'	11'	3'	6'	9'	3'	5'	8'	10'	13'	2'	5'	7'	9'	11'	14'	2'	4'	6'	8'	10'	12'		
0.060" Alum	0.024	4'	8'	12'	4'	7'	11'	3'	6'	9'	3'	5'	8'	10'	13'	2'	5'	7'	9'	11'	14'	2'	4'	6'	8'	10'	12'		
All others	0.024	4'	8'	12'	4'	7'	11'	3'	6'	9'	3'	5'	8'	10'	13'	2'	5'	7'	9'	11'	14'	2'	4'	6'	8'	10'	12'		
Dble Headers	0.032	7'	15'	MAX	7'	14'	MAX	6'	12'	17'	5'	10'	15'	MAX	MAX	4'	9'	13'	17'	MAX	MAX	4'	8'	11'	15'	MAX	MAX		
Single 3x8	0.032	4'	8'	12'	4'	7'	11'	3'	6'	9'	3'	5'	8'	10'	13'	2'	5'	7'	9'	11'	14'	2'	4'	6'	8'	10'	12'		
0.060" Alum	0.032	5'	10'	16'	5'	10'	14'	4'	8'	12'	3'	7'	10'	14'	MAX	3'	6'	9'	12'	15'	MAX	3'	5'	8'	11'	13'	16'		
All others	0.032	5'	10'	16'	5'	10'	14'	4'	8'	12'	3'	7'	10'	14'	MAX	3'	6'	9'	12'	15'	MAX	3'	5'	8'	11'	13'	16'		
Dble Headers	0.036	7'	15'	MAX	7'	14'	MAX	6'	12'	17'	5'	10'	15'	MAX	MAX	4'	9'	13'	17'	MAX	MAX	4'	8'	11'	15'	MAX	MAX		
Single 3x8	0.036	4'	8'	12'	4'	7'	11'	3'	6'	9'	3'	5'	8'	10'	13'	2'	5'	7'	9'	11'	14'	2'	4'	6'	8'	10'	12'		
0.060" Alum	0.036	5'	10'	16'	5'	10'	14'	4'	8'	12'	3'	7'	10'	14'	17'	3'	6'	9'	12'	15'	MAX	3'	5'	8'	11'	13'	16'		
All others	0.036	6'	12'	18'	5'	11'	16'	5'	9'	14'	4'	8'	12'	16'	MAX	3'	7'	10'	14'	17'	MAX	3'	6'	9'	12'	15'	MAX		

Table 4.37b Maximum Tributary Width for Each Header/Panel and Number of #14 Screw Combination

Amerimax Exterior Home Products  
28921 US Hwy 74  
Romoland, CA 92585

Carl Putnam, P. E.  
3441 Ivylink Place  
Lynchburg, VA 24503  
(434) 384-2514  
[carlputnam@comcast.net](mailto:carlputnam@comcast.net)

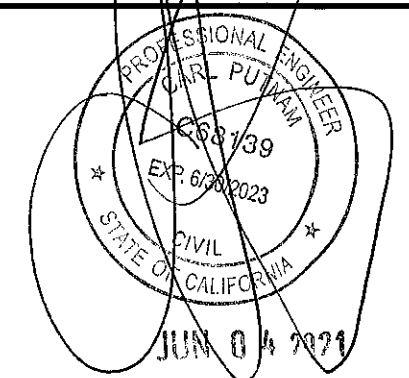

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 16 psf

Roof Solidity: 100%

Wind Speed: 95 MPH EXPOSURE C or 110 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.1a: Roof Solidity: 100% grid of post spacing and footing size data for various roof types and materials.

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 17 psf

Wind Speed: 95 MPH EXPOSURE C or 115 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.1b: Freestanding Structures grid of post spacing and footing size data for various roof types and materials.

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92885

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

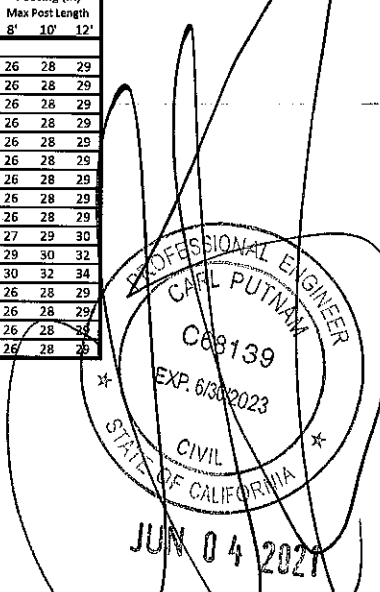



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 16 psf

Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.3a: Detailed table for attached structures showing post spacing, footing size, and material specifications for various roof and wall types under different load conditions.

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 18 psf

Wind Speed: 100 MPH EXPOSURE C or 120 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.3b: Detailed table for freestanding structures showing post spacing, footing size, and material specifications for various roof and wall types under different load conditions.

Amerimax Exterior Home Products, 28921 US Hwy 74, Romoland, CA 92585

Carl Putnam, P. E., 3441 Ivylink Place, Lynchburg, VA 24503, carlputnam@comcast.net

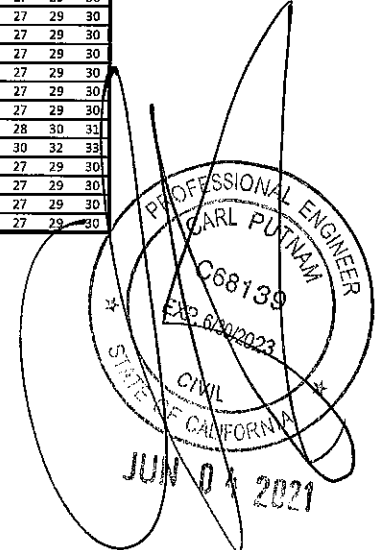



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 16 psf

Wind Speed: 105 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.4a: Detailed table for attached structures showing post spacing, footing size, and uplift requirements for various materials and configurations under the specified loading conditions.

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 16 psf

Wind Speed: 105 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.4b: Detailed table for freestanding structures showing post spacing, footing size, and uplift requirements for various materials and configurations under the specified loading conditions.

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

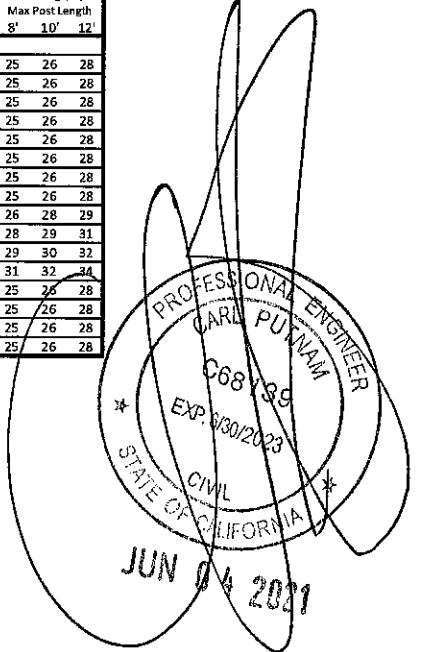

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 18 psf

Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.5a: Post spacing and footing size data for attached structures. Columns include material type (e.g., On Slab, N30, N25), post type, and footing dimensions (trib, min, uplift, max post length) for various load conditions.

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 20 psf

Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.5b: Post spacing and footing size data for freestanding structures. Columns include material type (e.g., On Slab, N30, N25), post type, and footing dimensions (trib, min, uplift, max post length) for various load conditions.

Amerimax Exterior Home Products  
28921 US Hwy 74  
Romoland, CA 92585

Carl Putnam, P. E.  
3441 Ivylink Place  
Lynchburg, VA 24503  
carlputnam@comcast.net

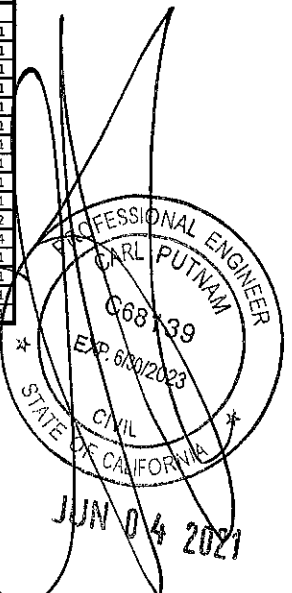

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 18 psf

Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.6a: Detailed table for attached structures with columns for roof type (On Slab, Double 3"x8", etc.), footing type (trib, min, uplift), and footing size (8', 10', 12').

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 21 psf

Wind Speed: 115 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.6b: Detailed table for freestanding structures with columns for roof type (On Slab, Double 3"x8", etc.), footing type (trib, min, uplift), and footing size (8', 10', 12').

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

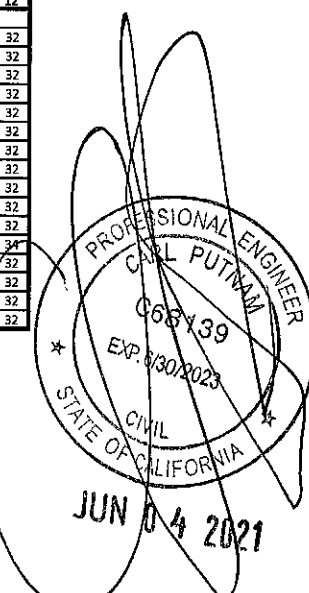

JUN 04 2021



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 19 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.7a: Post spacing and footing size data for attached structures. Columns include post type (trib, Min, Uplift, Footing), footing size (trib, Min, Uplift, Footing), and various material specifications (e.g., On Slab, N30, N25, N12.5, L, N10, G, H, N9, T, N9, T, N9, T, N9, T, N9, N25, T, N9, N25, T, W, AA, Y, Q).

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 23 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.7b: Post spacing and footing size data for freestanding structures. Columns include post type (trib, Min, Uplift, Footing), footing size (trib, Min, Uplift, Footing), and various material specifications (e.g., On Slab, N30, N25, N12.5, L, N10, G, H, N9, T, N9, T, N9, T, N9, T, N9, N25, T, W, AA, Y, Q).

Amerimax Exterior Home Products  
28921 US Hwy 74  
Romoland, CA 92585

Carl Putnam, P. E.  
3441 Ivylink Place  
Lynchburg, VA 24503  
carlputnam@comcast.net

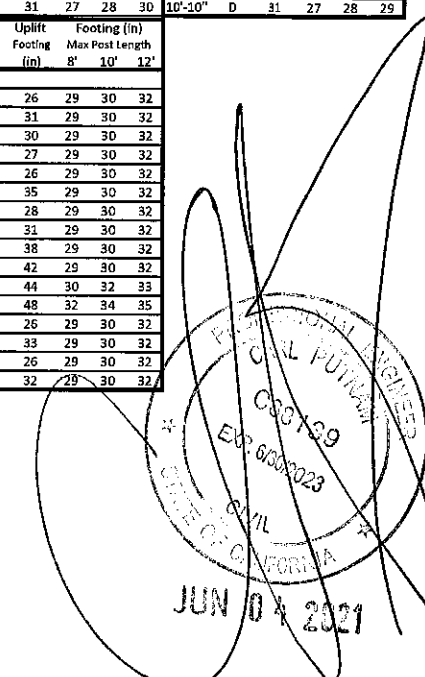



**SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS**

Roof Solidity: 100%

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 21 psf

Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.8a		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																			
Header	Detail	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)								
		3'	Type	(in)	8' 10' 12'	3.5'	Type	(in)	8' 10' 12'	4'	Type	(in)	8' 10' 12'	4.5'	Type	(in)	8' 10' 12'	5'	Type	(in)	8' 10' 12'	5.5'	Type	(in)	8' 10' 12'	6'	Type	(in)	8' 10' 12'	6.5'	Type	(in)	8' 10' 12'	7'	Type	(in)	8' 10' 12'	7.5'	Type	(in)	8' 10' 12'	8'	Type	(in)	8' 10' 12'				
On Slab	On Slab	22'-8"	C			19'-5"	C			17'-0"	C			15'-3"	C			13'-7"	C			12'-4"	C			11'-4"	C			10'-5"	A1			9'-8"	C			9'-1"	C			8'-6"	C						
0.042"x3"x8"	N30	8'-11"	A1	24	20	21	22	8'-11"	A1	25	22	23	24	6'-11"	A1	25	22	23	24	6'-5"	A1	26	23	24	25	6'-0"	A1	26	24	25	26	5'-8"	A1	26	24	26	27	5'-4"	A1	26	25	27	28	4'-9"	A1	27	26	27	28

Table 5.8b		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																			
Header	Detail	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)
		8.5'	Type	(in)	8' 10' 12'	9'	Type	(in)	8' 10' 12'	10'	Type	(in)	8' 10' 12'	10.5'	Type	(in)	8' 10' 12'	11'	Type	(in)	8' 10' 12'	11.5'	Type	(in)	8' 10' 12'	12'	Type	(in)	8' 10' 12'	13'	Type	(in)	8' 10' 12'	14'	Type	(in)	8' 10' 12'	15'	Type	(in)	8' 10' 12'	16'	Type	(in)	8' 10' 12'				
On Slab	On Slab	8'-0"	C			7'-6"	C			6'-9"	C			6'-5"	C			5'-11"	C			5'-8"	C			5'-2"	C			4'-10"	C			4'-6"	C			4'-5"	C			4'-1"	C			3'-8"	C		
0.042"x3"x8"	N30	4'-4"	A1	27	26	28	29	4'-2"	A1	27	27	28	30	3'-10"	A1	27	28	30	31	3'-8"	A1	27	28	30	31	3'-5"	A1	27	29	30	32	3'-3"	A1	27	29	31	33	2'-10"	A1	28	30	32	34	2'-8"	A1	28	31	32	34

Ground Snow Load: 0 psf

Live Load: 10 psf

Roof Design Load 25 psf

Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D


Freestanding Structures

Table 5.8b		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																			
Header	Detail	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)
		8.5'	Type	(in)	8' 10' 12'	9'	Type	(in)	8' 10' 12'	10'	Type	(in)	8' 10' 12'	10.5'	Type	(in)	8' 10' 12'	11'	Type	(in)	8' 10' 12'	11.5'	Type	(in)	8' 10' 12'	12'	Type	(in)	8' 10' 12'	13'	Type	(in)	8' 10' 12'	14'	Type	(in)	8' 10' 12'	15'	Type	(in)	8' 10' 12'	16'	Type	(in)	8' 10' 12'				
On Slab	On Slab	22'-8"	D			19'-5"	D			17'-0"	D			15'-3"	D			13'-7"	D			12'-4"	D			11'-4"	D			10'-5"	D			9'-8"	D			9'-1"	D			8'-6"	D						
0.042"x3"x8"	N30	9'-4"	A1	23	28	31	34	8'-7"	A1	23	27	29	30	7'-9"	A1	23	26	28	29	7'-3"	A1	24	25	27	28	6'-4"	A1	24	25	26	28	5'-11"	A1	25	26	27	28	5'-8"	A1	25	24	26	27	5'-4"	A1	25	24	26	27

Table 5.8b		cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																			
Header	Detail	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)
		8.5'	Type	(in)	8' 10' 12'	9'	Type	(in)	8' 10' 12'	10'	Type	(in)	8' 10' 12'	10.5'	Type	(in)	8' 10' 12'	11'	Type	(in)	8' 10' 12'	11.5'	Type	(in)	8' 10' 12'	12'	Type	(in)	8' 10' 12'	13'	Type	(in)	8' 10' 12'	14'	Type	(in)	8' 10' 12'	15'	Type	(in)	8' 10' 12'	16'	Type	(in)	8' 10' 12'				
On Slab	On Slab	8'-0"	D			7'-6"	D			6'-9"	D			6'-5"	D			5'-11"	D			5'-8"	D			5'-2"	D			4'-10"	D			4'-6"	D			4'-5"	D			4'-1"	D			3'-8"	D		
0.042"x3"x8"	N30	4'-7"	A2	25	26	27	28	4'-5"	A2	25	26	27	29	4'-1"	A2	26	27	28	30	3'-11"	A2	26	27	28	30	3'-9"	A2	26	28	29	31	3'-6"	A2	26	28	29	31	3'-3"	A2	26	28	30	32	2'-11"	A2	26	29	31	33

Amerimax Exterior Home Products

Carl Putnam, P. E.  
28921 US Hwy 74  
Romoland, CA 92585  
carlputnam@comcast.net

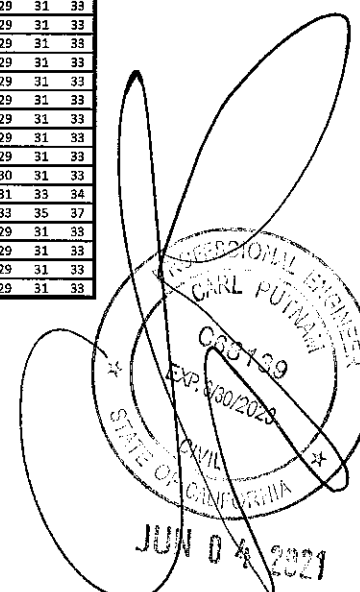

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 23 psf

Wind Speed: 95 MPH EXPOSURE C or 110 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.13a: Footing and post specifications for attached structures under various load conditions. Columns include member details, footing types, and dimensions for different load cases.

Table 5.13b: Footing and post specifications for attached structures under various load conditions, continuing from Table 5.13a.

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 25 psf

Wind Speed: 95 MPH EXPOSURE C or 115 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.13c: Footing and post specifications for freestanding structures under various load conditions. Columns include member details, footing types, and dimensions for different load cases.

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

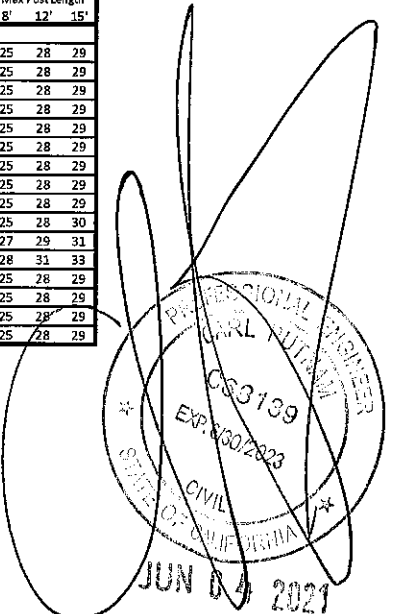

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 23 psf

Wind Speed: 100 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.14a: Detailed table for attached structures showing post spacing, footing size, and material specifications for various roof types and materials.

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 23 psf

Wind Speed: 100 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.14b: Detailed table for freestanding structures showing post spacing, footing size, and material specifications for various roof types and materials.

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

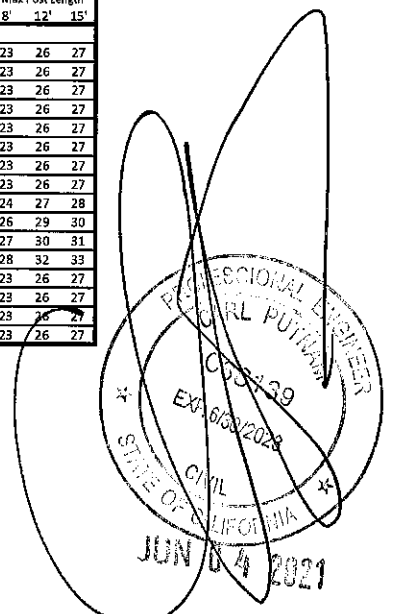



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 23 psf

Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.15a: A detailed grid of engineering data for attached structures. Columns include member type (e.g., On Slab, Double 3"x8", Double 2"x6.625"), post spacing (3', 4', 5', 6', 7', 8', 9', 10'), post type (A1, A2, B, C, D, E, F1, F2, F3, F4), and footing size (e.g., 8"x8", 10"x10", 12"x12").

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 26 psf

Wind Speed: 100 MPH EXPOSURE C or 120 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.15b: A detailed grid of engineering data for freestanding structures. Columns include member type (e.g., On Slab, Double 3"x8", Double 2"x6.625"), post spacing (3', 4', 5', 6', 7', 8', 9', 10'), post type (A1, A2, B, C, D, E, F1, F2, F3, F4), and footing size (e.g., 8"x8", 10"x10", 12"x12").

Amerimax Exterior Home Products  
28921 US Hwy 74  
Romoland, CA 92585

Carl Putnam, P. E.  
3441 Ivylink Place  
Lynchburg, VA 24503  
carlputnam@comcast.net

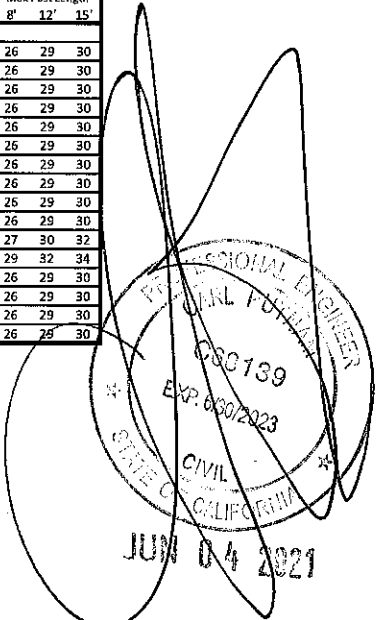



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 23 psf

Wind Speed: 105 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.16a: Detailed table for attached structures with columns for material, post type, footing size, and length. Includes rows for On Slab, Double 3"x8", Double 2"x6.625", 5.5" Extruded Fascia, California Fascia, Classic Fascia, 16 G Steel C, 14 G Steel C, 12 G Steel C, Double 16 G Steel C, Double 14 G Steel C, Double 12 G Steel C, Steel Cloverleaf, DBL Steel Cloverleaf, 4x3 I Beam, and 7x4 I Beam.

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 24 psf

Wind Speed: 105 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.16b: Detailed table for freestanding structures with columns for material, post type, footing size, and length. Includes rows for On Slab, Double 3"x8", Double 2"x6.625", 5.5" Extruded Fascia, California Fascia, Classic Fascia, 16 G Steel C, 14 G Steel C, 12 G Steel C, Double 16 G Steel C, Double 14 G Steel C, Double 12 G Steel C, Steel Cloverleaf, DBL Steel Cloverleaf, 4x3 I Beam, and 7x4 I Beam.

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

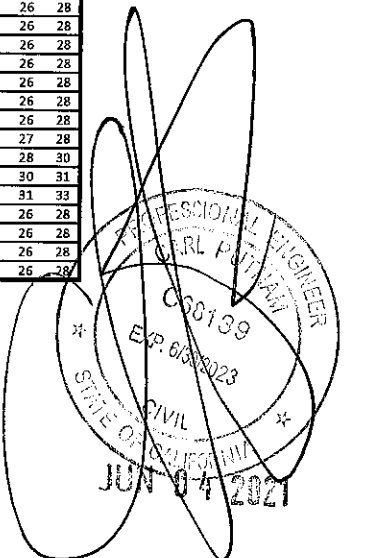

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 25 psf

Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.17a: Detailed table for attached structures showing post spacing, post type, and footing size for various roof configurations under specified loads.

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 28 psf

Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B


Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 5.17b: Detailed table for freestanding structures showing post spacing, post type, and footing size for various roof configurations under specified loads.

Amerimax Exterior Home Products, 28921 US Hwy 74, Lynchburg, VA 24503, cariputnam@comcast.net

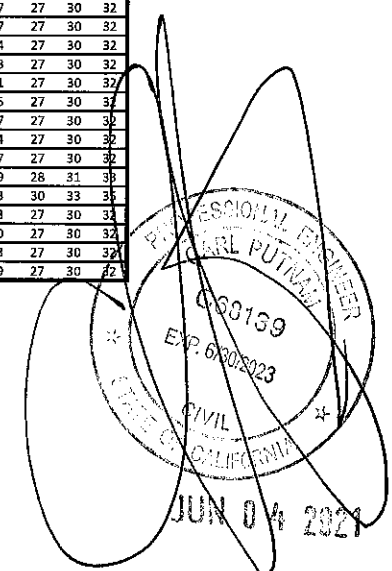

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 26 psf

Roof Solidity: 100%

Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 100%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.18a: A large grid table with columns for 'trib', 'Min Post', 'Uplift Footing', 'Constrained Footing (in)', and 'Max Post Length'. It lists various materials like On Slab, Double 3"x8", 5.5" Extruded Fascia, California Fascia, Classic Fascia, 16 G Steel C, 14 G Steel C, 12 G Steel C, Double 16 G Steel C, Double 14 G Steel C, Double 12 G Steel C, Steel Cloverleaf, DBL Steel Cloverleaf, 4x3 I Beam, and 7x4 I Beam. Each material is evaluated for different footing sizes (3.5', 4', 4.5', 5', 5.5', 6', 6.5', 7', 7.5', 8', 8.5', 9', 9.5', 10', 10.5', 11', 11.5', 12', 12.5', 13', 13.5', 14', 14.5', 15') and post types (A1, A2, B, C, D, E, F1, F2, F3, F4).

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 29 psf

Wind Speed: 115 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 100%


Seismic Design Category D

Freestanding Structures

Table 5.18b: A large grid table similar to Table 5.18a, but for freestanding structures. It follows the same layout with columns for footing and post specifications, and lists the same materials and footing/post options as Table 5.18a.

Amerimax Exterior Home Products  
28921 US Hwy 74  
Romoland, CA 92585

Carl Putnam, P. E.  
3441 Ivylink Place  
Lynchburg, VA 24503  
carlputnam@comcast.net

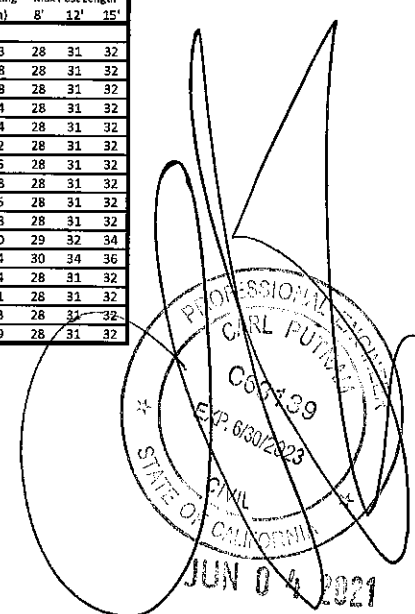



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 27 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.19a: Detailed table for attached structures with columns for various footing types (trib, min, uplift, constrained) and post lengths (8', 12', 15').

Ground Snow Load: 0 psf

Live Load: 20 psf

Roof Design Load 30 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.19b: Detailed table for freestanding structures with columns for various footing types (trib, min, uplift, constrained) and post lengths (8', 12', 15').

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

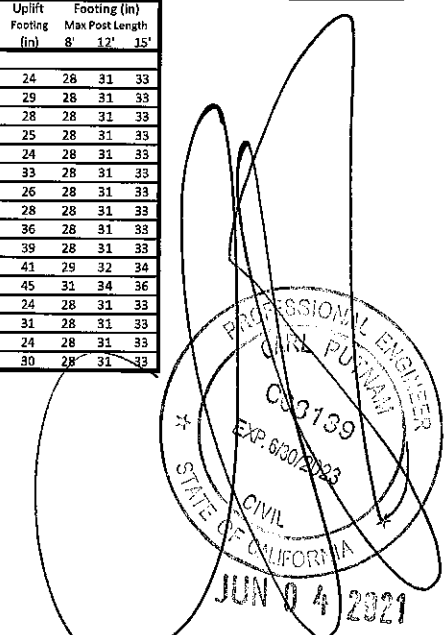



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 29 psf Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Structures are Attached to Existing Building

Table 5.20a

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																									
		trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length										
On Slab	On Slab	11'-10" A2				10'-2" A2				8'-11" A2				7'-11" A2				6'-5" A2			5'-5" A2				6'-5" A1				5'-1" A2				4'-10" A2				4'-9" A2				4'-5" A2										
0.042"x3"x8"	N30	8'-8" A1	24	20	22	24	7'-9" A1	24	21	23	25	7'-2" A1	25	22	24	26	6'-8" A1	25	22	25	26	6'-2" A2	25	23	26	27	5'-9" A2	26	24	26	28	5'-5" A2	26	25	27	29	4'-10" A2	26	25	28	30	4'-7" A2	26	26	28	30	4'-4" A2	26	26	29	31


Ground Snow Load: 0 psf Live Load: 20 psf Roof Design Load 33 psf Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B Seismic Ss= 150% Seismic Design Category D Freestanding Structures

Table 5.20b

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																									
		trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length		
On Slab	On Slab	11'-10" A2				10'-2" A2				8'-11" A2				7'-11" A2				6'-5" A2			5'-5" A2				6'-5" A2				5'-1" A2				4'-10" A2				4'-9" A2				4'-5" A2										
0.042"x3"x8"	N30	8'-8" A1	21	27	29	31	7'-3" A1	22	26	29	30	6'-7" A1	22	25	28	30	6'-1" A2	22	25	27	29	5'-8" A2	23	24	27	28	5'-3" A2	23	24	26	28	4'-11" A2	23	23	26	28	4'-8" A2	23	24	27	29	4'-5" A2	23	25	27	29	4'-2" A2	23	25	28	30

Amerimax Exterior Home Products  
 28921 US Hwy 74  
 Romoland, CA 92585

Carl Putnam, P. E.  
 3441 Ivylink Place  
 Lynchburg, VA 24503  
 carlputnam@comcast.net

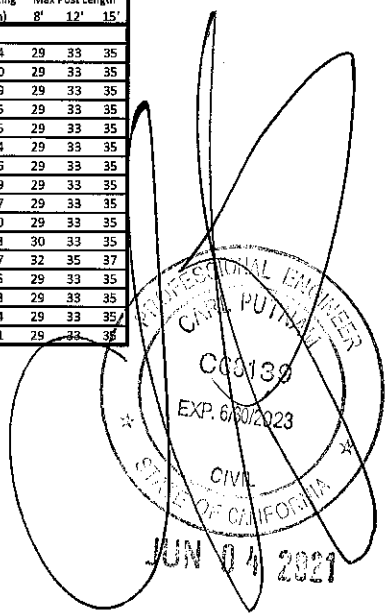

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 24 psf

Wind Speed: 100 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.25a: Grid for existing buildings with columns for tributary area (trib), min post spacing (Min Post), uplift footing (Uplift Footing), and constrained footing (Constrained Footing) for various footing sizes (8', 10', 12', 15').

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 24 psf

Wind Speed: 100 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.25b: Grid for freestanding structures with columns for tributary area (trib), min post spacing (Min Post), uplift footing (Uplift Footing), and constrained footing (Constrained Footing) for various footing sizes (8', 10', 12', 15').

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92588

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

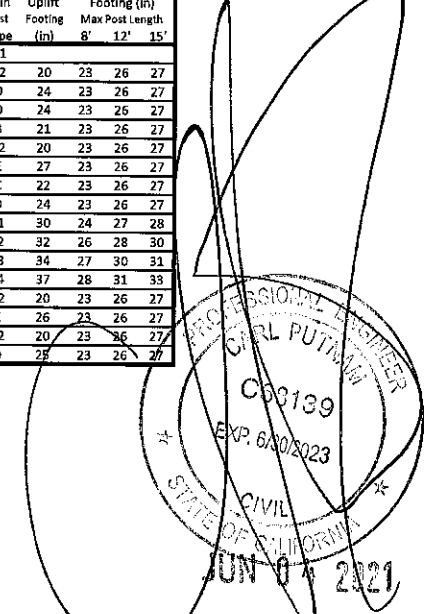

**SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS**

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 24 psf

Roof Solidity: 100%

Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.26a

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																			
		trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length				
On Slab	On Slab	11'-4" A1				9'-8" A1				8'-6" A1				7'-6" A1				6'-9" A1				6'-2" A1				5'-8" A1				5'-2" A1				4'-10" A1				4'-6" A1				4'-3" A1							
0.042"x3"x8"	N30	9'-6" A1	21	18	20	21	18	20	22	8'-8" A1	21	18	20	22	8'-0" A1	21	19	21	22	7'-5" A1	22	20	22	24	6'-11" A1	22	21	23	24	6'-1" A2	23	22	24	25	5'-9" A2	23	22	24	25	5'-6" A2	23	22	25	26	5'-0" A2	23	23	25	27

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 27 psf

Wind Speed: 100 MPH EXPOSURE C or 120 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Freestanding Structures

Table 5.26b

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"													
		trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post
On Slab	On Slab	11'-4" A1				9'-8" A1				8'-6" A1				7'-6" A1				6'-9" A1				6'-2" A1				5'-8" A1				5'-2" A1				4'-10" A1				4'-6" A1				4'-3" A1									
0.042"x3"x8"	N30	9'-6" A1	21	18	20	21	18	20	22	8'-8" A1	21	18	20	22	8'-0" A1	21	19	21	22	7'-5" A1	22	20	22	24	6'-11" A1	22	21	23	24	6'-1" A2	23	22	24	25	5'-9" A2	23	22	24	25	5'-6" A2	23	22	25	26	5'-0" A2	23	23	25	27		

Amerimax Exterior Home Products

28921 US Hwy 74


Romoland, CA 92585

Carl Putnam, P. E.

3441 Ivylink Place

Lynchburg, VA 24503

carlputnam@comcast.net

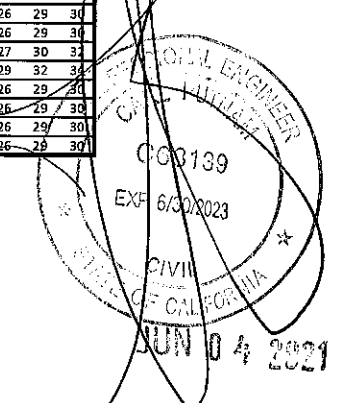



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 24 psf

Wind Speed: 105 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.27a: Detailed table for attached structures showing footing dimensions and post types for various load conditions and materials.

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 24 psf

Wind Speed: 105 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.27b: Detailed table for freestanding structures showing footing dimensions and post types for various load conditions and materials.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

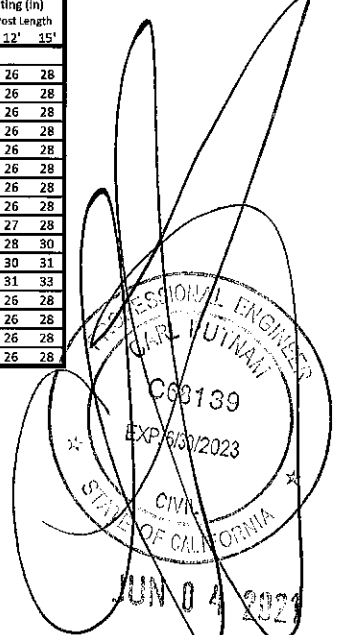

JUN 04 2023



**SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS**

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 26 psf

Roof Solidity: 100%

Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.28a


Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																																														
		trib		Min Post		Uplift		Constrained Footing (in)		trib		Min Post		Uplift		Constrained Footing (in)		trib		Min Post		Uplift		Constrained Footing (in)		trib		Min Post		Uplift		Constrained Footing (in)		trib		Min Post		Uplift		Constrained Footing (in)																																
		3'	Type	Post	Length	8'	12'	15'	8'	12'	15'	4'	Type	Post	Length	8'	12'	15'	4.5'	Type	Post	Length	8'	12'	15'	5'	Type	Post	Length	8'	12'	15'	5.5'	Type	Post	Length	8'	12'	15'	6'	Type	Post	Length	8'	12'	15'	6.5'	Type	Post	Length	8'	12'	15'	7'	Type	Post	Length	8'	12'	15'	7.5'	Type	Post	Length	8'	12'	15'	8'	Type	Post	Length	8'
On Slab	On Slab	3.1' A2	A2	22	19	21	22	9.8" A2	A2	22	19	21	23	7.8" A1	A1	23	20	22	24	7.1" A1	A1	23	21	23	24	6.8" A1	A1	23	21	24	25	6.3" A2	A2	23	22	24	26	5.10" A2	A2	24	22	25	26	5.6" A2	A2	24	23	25	27	4.10" A2	A2	24	23	26	27	4.9" A2	A2	24	24	26	28	4.3" A2	A2	24	24	27	28					
0.042"x3"x8"	N30	9'-3" A1	A1	22	19	21	22	12'-7" A2	A2	25	19	21	23	11'-9" B	B	26	20	22	24	10'-11" C	C	26	21	23	24	10'-4" C	C	27	21	24	25	9'-9" C	C	27	22	24	26	9'-3" C	C	27	22	25	26	8'-10" C	C	28	23	25	27	8'-1" C	C	28	24	26	28	7'-8" C	C	28	24	27	28											
Double 3"x8"	N25	13'-10" A2	A2	25	19	21	22	12'-7" A2	A2	25	19	21	23	11'-9" B	B	26	20	22	24	10'-11" C	C	26	21	23	24	10'-4" C	C	27	21	24	25	9'-9" C	C	27	22	24	26	9'-3" C	C	27	22	25	26	8'-10" C	C	28	23	25	27	8'-1" C	C	28	24	26	28	7'-8" C	C	28	24	27	28											

Table 5.28b

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"																															
		trib		Min Post		Uplift		Constrained Footing (in)		trib		Min Post		Uplift		Constrained Footing (in)		trib		Min Post		Uplift		Constrained Footing (in)		trib		Min Post		Uplift		Constrained Footing (in)		trib		Min Post		Uplift		Constrained Footing (in)		trib		Min Post		Uplift		Constrained Footing (in)		trib		Min Post		Uplift		Constrained Footing (in)					
		8.5'	Type	Post	Length	8'	12'	15'	8'	12'	15'	9'	Type	Post	Length	8'	12'	15'	10'	Type	Post	Length	8'	12'	15'	10.5'	Type	Post	Length	8'	12'	15'	11'	Type	Post	Length	8'	12'	15'	11.5'	Type	Post	Length	8'	12'	15'	12'	Type	Post	Length	8'	12'	15'	13'	Type	Post	Length	8'	12'	15'	
On Slab	On Slab	4'-0" A2	A2	24	24	27	29	3'-9" A2	A2	24	25	27	29	3'-11" A2	A2	25	25	28	30	3'-10" A2	A2	25	26	28	30	3'-10" A2	A2	25	26	29	30	3'-8" A2	A2	25	26	29	30	3'-6" A2	A2	25	26	29	31	3'-5" A2	A2	25	27	30	32	2'-10" A2	A2	25	28	31	32	2'-5" A2	A2	25	28	31	33
0.042"x3"x8"	N30	4'-0" A2	A2	24	24	27	29	4'-4" A2	A2	24	25	27	29	3'-11" A2	A2	25	25	28	30	3'-10" A2	A2	25	26	28	30	3'-10" A2	A2	25	26	29	30	3'-8" A2	A2	25	26	29	30	3'-6" A2	A2	25	26	29	31	3'-5" A2	A2	25	27	30	32	2'-10" A2	A2	25	28	31	32	2'-5" A2	A2	25	28	31	33
Double 3"x8"	N25	7'-5" C	C	29	24	27	29	7'-1" C	C	29	25	27	29	6'-8" D	D	29	25	28	30	6'-5" D	D	29	26	28	30	6'-3" D	D	29	26	29	30	6'-0" D	D	29	26	29	30	5'-10" D	D	29	27	29	31	5'-6" D	D	29	27	30	32	4'-11" D	D	30	28	31	32	4'-9" D	D	30	28	31	33

Amerimax Exterior Home Products  
28921 US Hwy 74  
Romoland, CA 92586

Carl Putnam, P. E.  
3441 Ivylink Place  
Lynchburg, VA 24503  
carlputnam@comcast.net

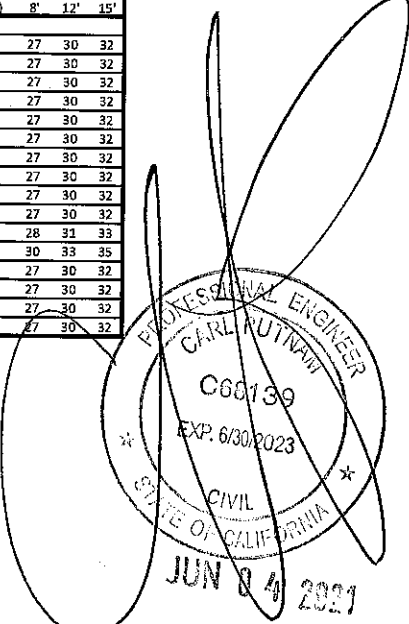



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 28 psf

Roof Solidity: 100%

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.30a: Post spacing and footing size data for structures attached to existing buildings. Columns include product, details, and footing dimensions for various roof and load conditions.

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 31 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.30b: Post spacing and footing size data for freestanding structures. Columns include product, details, and footing dimensions for various roof and load conditions.

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

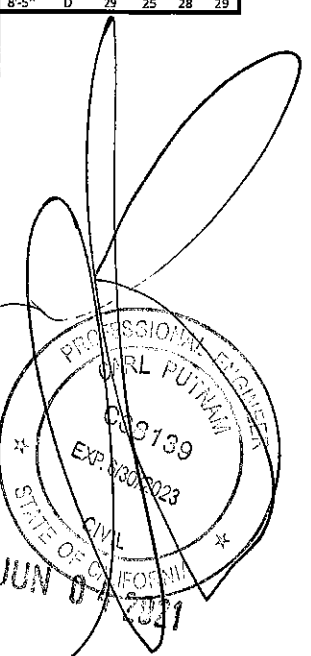



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Roof Solidity: 100%

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 29 psf

Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.31a: Engineering table for attached structures with columns for various footing types (trib, min, uplift, constrained) and sizes (8', 12', 15', 18', 24', 30', 36').

Ground Snow Load: 25 psf

Live Load: 20 psf

Roof Design Load 33 psf

Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.31b: Engineering table for freestanding structures with columns for various footing types and sizes, similar to Table 5.31a.

Amirmax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

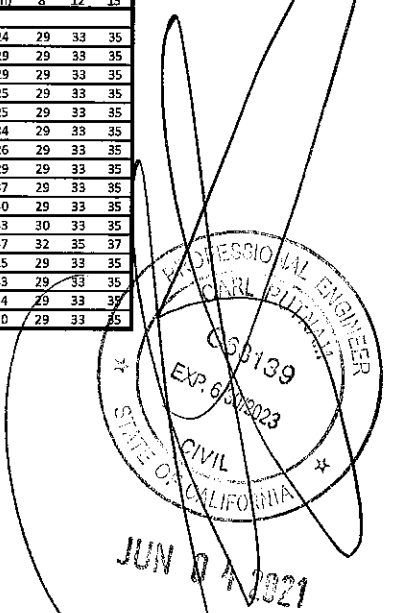

JUN 8 2021



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 27 psf

Roof Solidity: 100%

Wind Speed: 100 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.32a: Detailed table for attached structures with columns for material (On Slab, Double 3"x8", etc.), footing type (A1, A2, etc.), and footing dimensions (8', 12', 15', 18', 20', 24', 28', 32').

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 27 psf

Roof Solidity: 100%

Wind Speed: 100 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.32b: Detailed table for freestanding structures with columns for material (On Slab, Double 3"x8", etc.), footing type (A1, A2, etc.), and footing dimensions (8', 12', 15', 18', 20', 24', 28', 32').

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

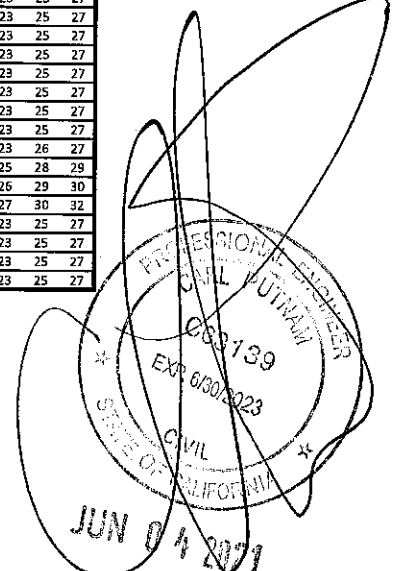

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 27 psf

Roof Solidity: 100%

Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.33a: Detailed table for roof design load 27 psf, showing post spacing, footing size, and footing length for various materials and conditions.

Table 5.33b: Detailed table for roof design load 30 psf, showing post spacing, footing size, and footing length for various materials and conditions.

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 30 psf

Wind Speed: 100 MPH EXPOSURE C or 120 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.33c: Detailed table for roof design load 30 psf, showing post spacing, footing size, and footing length for various materials and conditions.

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

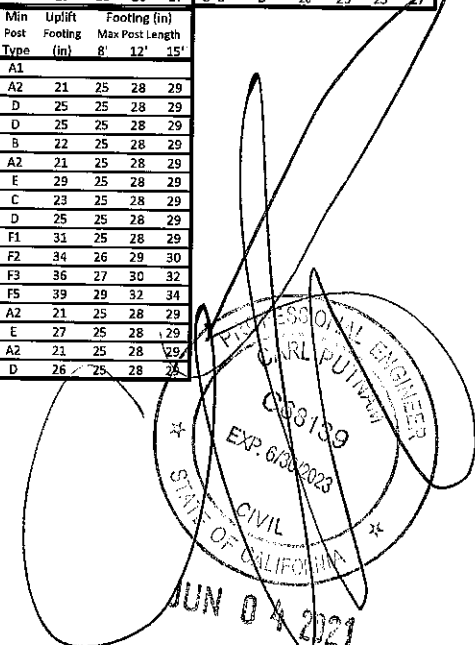

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 27 psf

Roof Solidity: 100%

Wind Speed: 105 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.34a: Detailed table for attached structures with columns for footing type, min post, uplift, and footing length for various materials and conditions.

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 28 psf

Wind Speed: 105 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.34b: Detailed table for freestanding structures with columns for footing type, min post, uplift, and footing length for various materials and conditions.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

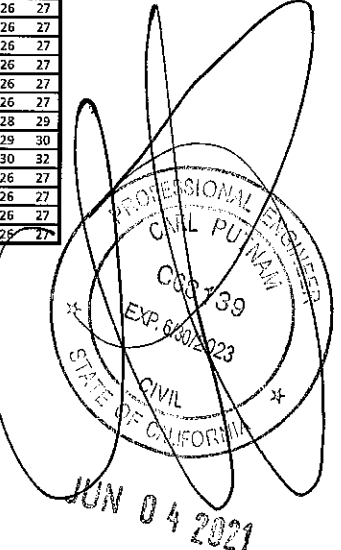



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 29 psf

Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B

Roof Solidity: 100%

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.35a: Post spacing and footing size data for attached structures. Columns include member type (e.g., On Slab, Double 3"x8", 5.5" Extruded Fascia), detail, and various footing dimensions (trib, min post, uplift, constrained footing) for different load and exposure conditions.

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 32 psf

Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.35b: Post spacing and footing size data for freestanding structures. Columns include member type (e.g., On Slab, Double 3"x8", 5.5" Extruded Fascia), detail, and various footing dimensions for different load and exposure conditions.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

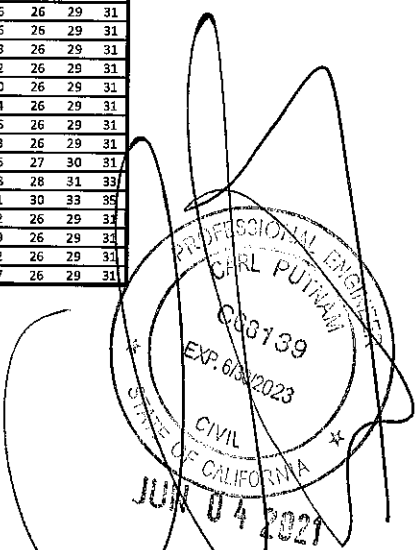



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 30 psf

Roof Solidity: 100%

Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.36a: Post spacing, post type, and footing size for solid covers. Columns include material (On Slab, N30, N25, L, N10, G, H, N9, T, N9, N25, T, W, AA, Y, Q), post type (A1, A2, B, C, D, E, F1, F2, F3, F4), and footing dimensions (trib, min post, uplift, constrained footing, max post length) for various post sizes (3', 3.5', 4', 4.5', 5', 5.5', 6', 6.5', 7', 7.5', 8').

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 33 psf

Wind Speed: 115 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.36b: Post spacing, post type, and footing size for freestanding structures. Columns include material (On Slab, N30, N25, L, N10, G, H, N9, T, N9, N25, T, W, AA, Y, Q), post type (A2, B, C, D, E, F1, F2, F3, F4), and footing dimensions (trib, min post, uplift, constrained footing, max post length) for various post sizes (3', 3.5', 4', 4.5', 5', 5.5', 6', 6.5', 7', 7.5', 8').

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92588

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

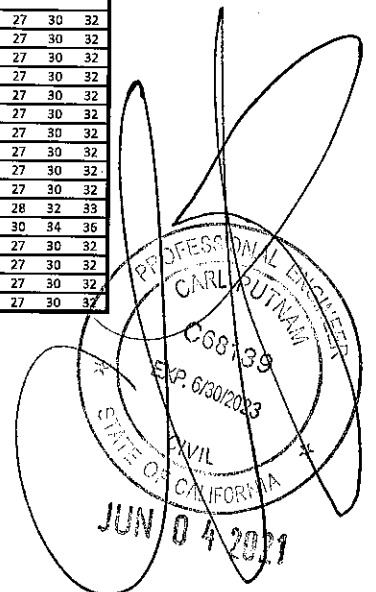



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 33 psf

Roof Solidity: 100%

Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"									
		trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length		
On Slab	On Slab	9'-6" A2				8'-2" A2				7'-3" A2				6'-4" A2				5'-2" A2				4'-9" A2				3'-9" A2				2'-8" A2					
0.042"x3"x8"	N30	8'-0" A1	23	20	22	24	7'-3" A1	24	21	23	25	6'-7" A1	24	22	24	26	6'-1" A2	24	22	25	26	5'-8" A2	25	23	26	27	4'-9" A2	25	24	27	28	3'-6" A2	25	24	27

Ground Snow Load: 30 psf

Live Load: 20 psf

Roof Design Load 36 psf

Wind Speed: 130 MPH EXPOSURE C or 150 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"									
		trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length	trib	Min Post	Uplift Footing	Constrained Footing (in) Max Post Length		
On Slab	On Slab	9'-6" A2				8'-2" A2				7'-3" A2				6'-4" A2				5'-2" A2				4'-9" A2				3'-9" A2				2'-8" A2					
0.042"x3"x8"	N30	7'-5" A1	21	26	29	31	6'-8" A1	21	25	28	30	6'-1" A2	22	25	27	29	5'-8" A2	22	24	26	28	4'-10" A2	22	23	26	27	4'-3" A2	23	24	26	28	3'-6" A2	23	25	27

Amerimax Exterior Home Products

Carl Putnam, P.E.  
3441 Ivylink Place  
Lynchburg, VA 24503  
carlputnam@comcast.net

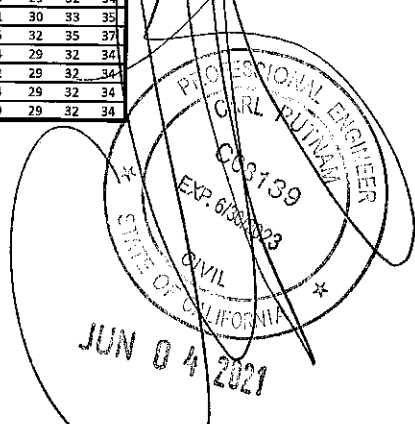



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS  
Ground Snow Load: 36 psf

Roof Solidity: 100%  
Wind Speed: 100 MPH EXPOSURE B

Seismic S<sub>s</sub> = 150%  
Seismic Design Category D  
Structures are Attached to Existing Building

Table 5.39a  
Live Load: 20 psf  
Roof Design Load 31 psf

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"								
		trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	
On Slab	On Slab	8'-0"	A1		8'-0"	A1		6'-0"	A1		6'-0"	A1		5'-4"	A1		5'-4"	A1		4'-10"	A1		4'-10"	A1		3'-8"	A1		3'-8"	A1		3'-0"	A1	
0.042'x3'x8"	N30	8'-2"	A1	17	16	18	19	20	17-5"	A1	18	17	19	20	6'-10"	A1	18	17	19	21	6'-4"	A2	18	18	20	21	5'-10"	A2	18	19	21	22	5'-5"	A2
Double 3'x8"	N25	12'-5"	A2	20	17	19	20	21	11'-4"	B	20	17	19	20	10'-7"	C	21	17	19	21	9'-3"	C	21	18	20	21	8'-10"	C	22	19	21	22	8'-8"	C
Double 2'x6.625"	N25	11'-2"	A2	18	16	18	19	20	10'-3"	A2	18	17	19	20	9'-7"	A2	20	17	19	21	8'-11"	B	20	18	20	21	8'-5"	C	21	19	21	22	7'-11"	C
5.5' Extruded Fascia	L	9'-2"	A1	18	16	18	19	20	8'-3"	A2	18	17	19	20	7'-7"	A2	19	17	19	21	7'-0"	A2	19	18	20	21	6'-6"	A2	19	19	21	22	6'-0"	A2
California Fascia	N10, G	9'-1"	A1	17	19	21	22	23	8'-2"	A2	17	18	20	21	7'-6"	A2	17	18	20	22	7'-0"	A2	18	18	20	21	6'-6"	A2	18	18	20	21	6'-0"	A2
Classic Fascia	H	12'-7"	A2	20	17	19	20	21	11'-11"	C	19	21	23	24	11'-5"	C	20	21	23	25	10'-11"	C	20	21	23	24	10'-5"	C	21	21	23	24	9'-9"	C
16 G Steel C	N9, T	14'-3"	C	21	17	19	20	21	12'-9"	C	21	18	20	21	11'-7"	C	21	18	20	21	10'-3"	C	21	18	20	21	9'-2"	C	21	19	21	22	8'-4"	C
14 G Steel C	N9, T	17'-2"	C	22	18	20	21	22	15'-4"	D	23	18	20	21	14'-1"	D	23	19	21	22	12'-11"	D	23	19	21	22	11'-11"	D	23	19	21	22	10'-5"	D
12 G Steel C	N9, T	23'-3"	D	25	20	22	23	24	22'-0"	E	25	20	22	24	20'-6"	E	26	21	23	24	19'-0"	E	27	21	23	25	17'-8"	E	27	21	23	25	15'-9"	E
Double 16 G Steel C	N9, N25, T	24'-2"	E	25	20	22	23	24	22'-11"	E	26	20	23	24	22'-0"	E	27	21	23	25	21'-1"	E	27	21	23	25	19'-9"	E	27	21	23	25	18'-3"	E
Double 14 G Steel C	N9, N25, T	25'-10"	E	25	20	22	24	25	24'-5"	E	26	21	23	24	23'-5"	E	27	21	23	25	22'-6"	E	27	21	23	25	21'-0"	F1	29	22	25	26	19'-9"	F1
Double 12 G Steel C	N9, N25, T	29'-4"	E	27	21	23	25	26	27'-9"	E	27	21	24	25	26'-8"	F1	28	22	24	26	25'-7"	F1	29	22	25	26	24'-9"	F1	30	23	25	27	23'-11"	F1
Steel Cloverleaf	W	8'-0"	A1	17	16	18	19	20	7'-2"	A1	18	17	19	20	6'-2"	A1	18	18	20	21	5'-8"	A2	18	18	20	21	5'-4"	A2	18	19	21	22	5'-0"	A2
DBL Steel Cloverleaf	AA	11'-4"	A2	19	16	18	19	20	10'-9"	A2	20	17	19	20	10'-4"	C	21	17	19	21	9'-11"	C	21	18	20	21	9'-7"	C	22	19	21	22	9'-3"	C
4x3 I Beam	Y	9'-10"	A2	18	16	18	19	20	8'-8"	A2	19	17	19	20	7'-11"	A2	19	17	19	21	7'-3"	A2	19	18	20	21	6'-6"	A2	19	19	21	22	6'-0"	A2
7x4 I Beam	Q	16'-7"	C	22	18	20	21	22	15'-9"	D	23	19	21	22	14'-7"	D	23	19	21	22	13'-3"	D	23	19	21	22	12'-3"	D	24	19	21	22	11'-4"	D


Ground Snow Load: 36 psf Live Load: 20 psf Roof Design Load 31 psf Wind Speed: 100 MPH EXPOSURE B Seismic S<sub>s</sub> = 150% Seismic Design Category D Freestanding Structures

Table 5.39b

Header	Detail	cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"				cubic footing "d"							
		trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)	trib	Min Post	Uplift Footing	Constrained Footing (in)
On Slab	On Slab	8'-0"	A1		8'-0"	A1		6'-0"	A1		6'-0"	A1		5'-4"	A1		5'-4"	A1		4'-10"	A1		4'-10"	A1		3'-8"	A1		3'-8"	A1		3'-0"	A1
0.042'x3'x8"	N30	8'-2"	A1	16	21	23	28	7'-5"	A1	17	21	23	24	6'-10"	A1	17	20	22	24	6'-4"	A2	17	20	22	23	5'-10"	A2	17	19	21	22	5'-5"	A2
Double 3'x8"	N25	12'-5"	A2	19	23	26	28	11'-4"	B	19	23	25	27	10'-7"	C	19	22	25	26	9'-10"	C	20	22	24	25	8'-8"	C	20	21	23	24	8'-3"	C
Double 2'x6.625"	N25	11'-2"	A2	18	22	24	25	10'-3"	A2	18	21	24	25	9'-7"	A2	19	21	23	25	8'-11"	B	19	21	23	24	8'-5"	C	20	20	22	23	7'-11"	C
5.5' Extruded Fascia	L	9'-2"	A1	17	20	22	23	8'-3"	A2	17	19	21	22	7'-7"	A2	17	19	21	22	7'-0"	A2	18	18	20	21	6'-6"	A2	18	18	20	21	6'-0"	A2
California Fascia	N10, G	9'-1"	A1	17	19	21	22	8'-2"	A2	17	18	20	21	7'-6"	A2	17	18	20	21	7'-0"	A2	18	18	20	21	6'-6"	A2	18	18	20	21	6'-0"	A2
Classic Fascia	H	12'-7"	A2	19	22	24	25	11'-11"	C	19	21	24	25	11'-5"	C	20	21	23	25	10'-11"	C	20	21	23	24	10'-5"	C	21	21	23	24	9'-9"	C
16 G Steel C	N9, T	14'-3"	C	20	24	27	28	12'-9"	C	20	24	26	28	11'-7"	C	20	23	26	27	10'-3"	C	20	22	24	25	9'-2"	C	20	21	23	24	8'-4"	C
14 G Steel C	N9, T	17'-2"	C	21	25	28	29	15'-4"	D	21	25	27	29	14'-1"	D	21	24	27	28	13'-9"	D	22	24	26	27	12'-11"	D	22	23	25	26	11'-11"	D
12 G Steel C	N9, T	23'-3"	D	23	27	30	32	22'-0"	E	24	27	30	32	20'-6"	E	24	27	29	31	19'-0"	E	25	26	28	30	17'-8"	E	25	26	28	30	16'-7"	E
Double 16 G Steel C	N9, N25, T	24'-2"	E	23	28	31	33	22'-11"	E	24	27	30	32	22'-0"	E	25	27	30	32	21'-1"	E	25	27	30	31	20'-5"	F1	26	27	29	31	19'-9"	F1
Double 14 G Steel C	N9, N25, T	25'-10"	E	24	28	31	33	24'-5"	E	25	28	31	33	23'-5"	F1	26	28	31	33	22'-6"	F1	26	27	30	32	21'-9"	F1	27	27	30	32	21'-0"	F1
Double 12 G Steel C	N9, N25, T	29'-4"	E	25	29	32	34	27'-9"	E	26	29	32	34	26'-8"	F1	26	28	31	33	25'-7"	F1	27	28	31	33	24'-9"	F1	28	28	31	33	23'-11"	F1
Steel Cloverleaf	W	8'-0"	A1	16	16	18	19	7'-2"	A1	16	16	18	19	6'-2"	A1	17	17	19	20	6'-2"	A1	17	17	19	20	5'-8"	A2	17	18	20	21	5'-4"	A2
DBL Steel Cloverleaf	AA	11'-4"	A2	18	18	20	21	10'-9"	A2	19	18	19	21	10'-4"	C	19	17	19	20	9'-11"	C	20	18	20	21	9'-7"	C	20	18	20	21	9'-3"	C
4x3 I Beam	Y	9'-10"	A2	17	16	18	20	8'-8"	A2	17	16	18	20	7'-11"	A2	18	17	19	21	7'-2"	A2	18	17	19	20	6'-6"	A2	18	18	20	21	6'-0"	A2
7x4 I Beam	Q	16'-7"	C	21	24	27	29	15'-9"	D	21	24	27	28	14'-7"	D	22	24	26	28	13'-3"	D	22	23	25	26	12'-3"	D	22	23	25	26	11'-4"	D

Amerimax Exterior Home Products  
28921 US Hwy 74  
Romoland, CA 92585

Carl Putnam, P. E.  
3441 Ivylink Place  
Lynchburg, VA 24503  
carlputnam@comcast.net

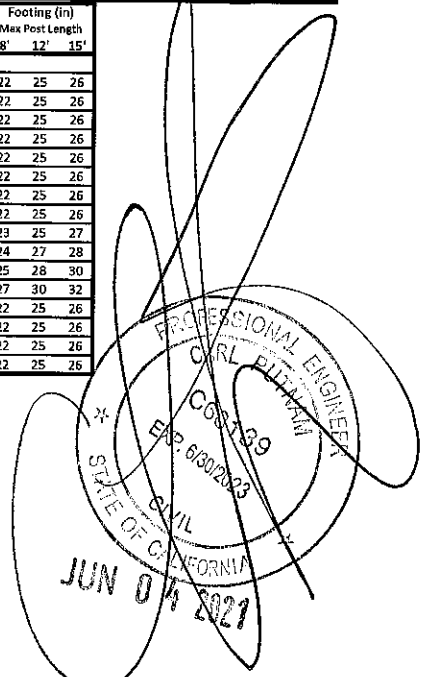



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 31 psf

Roof Solidity: 100%

Wind Speed: 100 MPH EXPOSURE C or 115 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.40a: Post spacing, post type, and footing size for solid covers. Includes columns for Detail, On Slab, and various footing sizes (e.g., 3', 3.5', 4', 4.5', 5', 5.5', 6', 6.5', 7', 7.5') for different materials like Steel C, Steel T, Steel F, Steel D, Steel E, Steel F1, Steel F2, Steel F3, Steel F4.

Table 5.40b: Post spacing, post type, and footing size for solid covers. Similar to Table 5.40a but with a Roof Design Load of 33 psf and Seismic Design Category D. Includes columns for Detail, On Slab, and various footing sizes for different materials.

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 33 psf

Wind Speed: 100 MPH EXPOSURE C or 120 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D


Freestanding Structures

Table 5.40c: Post spacing, post type, and footing size for solid covers. Similar to Table 5.40a but with a Roof Design Load of 33 psf and Seismic Design Category D. Includes columns for Detail, On Slab, and various footing sizes for different materials.

Table 5.40d: Post spacing, post type, and footing size for solid covers. Similar to Table 5.40a but with a Roof Design Load of 33 psf and Seismic Design Category D. Includes columns for Detail, On Slab, and various footing sizes for different materials.

Amerimax Exterior Home Products  
28921 US Hwy 74  
Romoland, CA 92586

Carl Putnam, P. E.  
3441 Iylink Place  
Lynchburg, VA 24503  
carlputnam@comcast.net

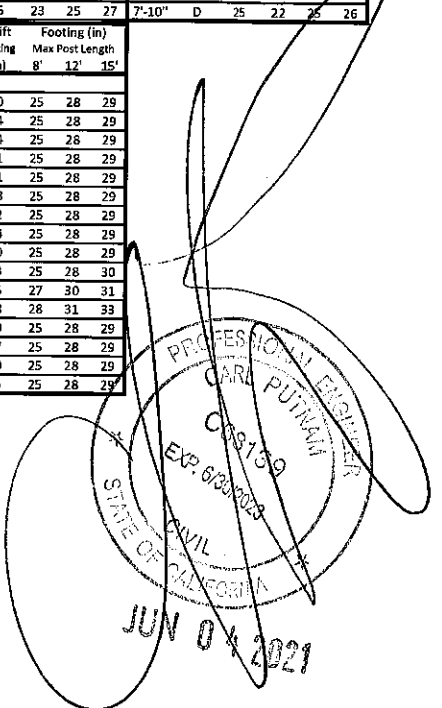

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 32 psf

Roof Solidity: 100%

Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.41a: A large table with 20 columns and 20 rows, detailing footing specifications for various materials and conditions. Columns include material type (e.g., On Slab, Double 3"x8", 5.5" Extruded Fascia), footing size (e.g., 8'-0" x 1'-0"), and footing length (e.g., 8', 12', 15').

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 34 psf

Wind Speed: 105 MPH EXPOSURE C or 120 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.41b: A large table with 20 columns and 20 rows, detailing footing specifications for various materials and conditions. Columns include material type (e.g., On Slab, Double 3"x8", 5.5" Extruded Fascia), footing size (e.g., 8'-0" x 1'-0"), and footing length (e.g., 8', 12', 15').

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

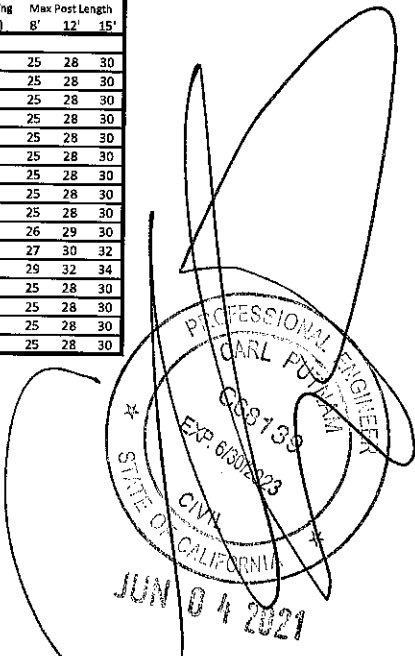

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 33 psf

Roof Solidity: 100%

Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.42a: Design table for attached structures with columns for various footing dimensions and material types.

Table 5.42b: Design table for attached structures with columns for various footing dimensions and material types.

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 35 psf

Wind Speed: 110 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D


Freestanding Structures

Table 5.42c: Design table for freestanding structures with columns for various footing dimensions and material types.

Table 5.42d: Design table for freestanding structures with columns for various footing dimensions and material types.

Amerimax Exterior Home Products
28921 US Hwy 74
Romoland, CA 92585

Carl Putnam, P. E.
3441 Ivylink Place
Lynchburg, VA 24503
carlputnam@comcast.net

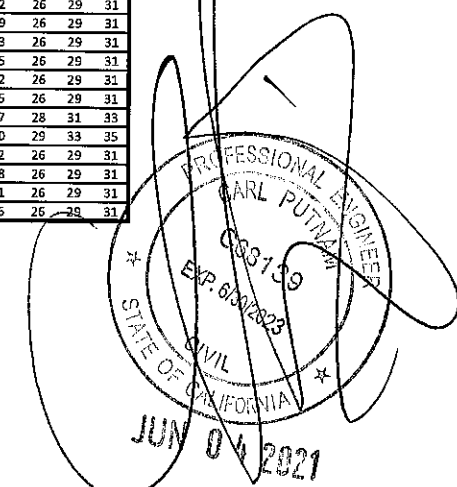



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 33 psf

Roof Solidity: 100%

Wind Speed: 115 MPH EXPOSURE C or 130 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.43a: Post spacing, post type, and footing size for solid covers. Columns include product type (e.g., On Slab, Double 3"x8", 5.5" Extruded Fascia), post size (trib, Min Post, Uplift Footing, Footing (in)), and footing size (trib, Min Post, Uplift Footing, Footing (in)).

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 36 psf

Wind Speed: 115 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.43b: Post spacing, post type, and footing size for freestanding structures. Columns include product type (e.g., On Slab, Double 3"x8", 5.5" Extruded Fascia), post size (trib, Min Post, Uplift Footing, Footing (in)), and footing size (trib, Min Post, Uplift Footing, Footing (in)).

Amerimax Exterior Home Products  
28921 US Hwy 74  
Romoland, CA 92585

Carl Putnam, P. E.  
3441 Ivylink Place  
Lynchburg, VA 24503  
carlputnam@comcast.net

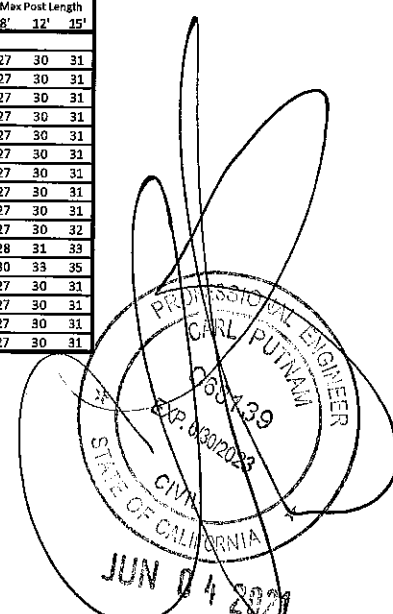



**SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS**

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 34 psf

Roof Solidity: 100%

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic S<sub>s</sub> = 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table S.4.4a

Header		cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"																							
Detail	On Slab	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)						
		3'	4'	5'	6'	3.5'	4'	5'	6'	4'	5'	6'	7'	4'	5'	6'	7'	5'	6'	7'	8'	6'	7'	8'	9'	6'	7'	8'	9'	7'	8'	9'	10'	7'	8'	9'	10'	8'	9'	10'	11'	8'	9'	10'	11'	9'	10'	11'	12'						
0.042"x3"x8"	N30	8'-0"	A1	22	19	22	23	6'-10"	A1	22	20	22	24	6'-0"	A1	22	20	22	24	5'-4"	A1	22	20	22	24	4'-10"	A1	22	20	22	24	4'-4"	A1	22	20	22	24	4'-0"	A1	22	20	22	24	3'-8"	A1	22	20	22	24	3'-2"	A1	22	20	22	24
Double 3"x8"	N25	11'-2"	B	23	25	28	30	10'-10"	C	26	20	22	24	9'-11"	C	26	21	23	25	8'-9"	C	26	22	24	25	8'-2"	C	27	23	25	27	7'-9"	C	27	23	25	27	7'-3"	C	27	23	25	27	6'-9"	C	27	23	25	27	6'-4"	C	28	25	27	29
Double 2"x6.625"	N25	10'-0"	A2	22	26	28	30	7'-3"	A2	22	26	28	30	6'-6"	A2	22	26	28	30	6'-0"	A2	22	26	28	30	5'-4"	A2	22	26	28	30	4'-10"	A2	22	26	28	30	4'-5"	A2	22	26	28	30	4'-0"	A2	22	26	28	30	3'-6"	A2	22	26	28	30

Ground Snow Load: 36 psf

Live Load: 20 psf

Roof Design Load 38 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic S<sub>s</sub> = 150%

Seismic Design Category D


Freestanding Structures

Table S.4.4b

Header		cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"					cubic footing "d"																							
Detail	On Slab	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)	trib	Min Post	Uplift	Constrained Footing (in)		
		8.5'	9'	10'	11'	8.5'	9'	10'	11'	9.5'	10'	11'	12'	10'	11'	12'	13'	11'	12'	13'	11'	12'	13'	14'	12'	13'	14'	12'	13'	14'	12'	13'	14'	15'	13'	14'	15'	16'	14'	15'	16'	17'	15'	16'	17'	18'	16'	17'	18'	19'					
0.042"x3"x8"	N30	7'-3"	A1	20	25	28	29	6'-7"	A1	20	24	27	28	5'-11"	A2	20	24	26	28	5'-5"	A2	21	23	25	27	4'-9"	A2	21	23	25	26	4'-5"	A2	21	23	25	26	4'-2"	A2	21	23	25	27	3'-11"	A2	21	23	26	27	3'-8"	A2	21	24	26	28
Double 3"x8"	N25	11'-2"	B	23	28	31	32	10'-2"	C	23	27	30	32	9'-4"	C	24	26	29	31	8'-2"	C	24	26	29	31	7'-8"	C	25	28	30	31	7'-3"	C	25	28	29	30	6'-11"	D	25	28	29	30	6'-7"	D	25	28	29	30	6'-3"	D	25	28	29	30
Double 2"x6.625"	N25	10'-0"	A2	22	26	28	30	7'-3"	A2	22	26	28	30	6'-6"	A2	22	26	28	30	6'-0"	A2	22	26	28	30	5'-4"	A2	22	26	28	30	4'-10"	A2	22	26	28	30	4'-5"	A2	22	26	28	30	4'-0"	A2	22	26	28	30	3'-6"	A2	22	26	28	30

Amerimax Exterior Home Products

Carl Putnam, P. E.  
 3441 Ivylink Place  
 Lynchburg, VA 24503  
 carlputnam@comcast.net

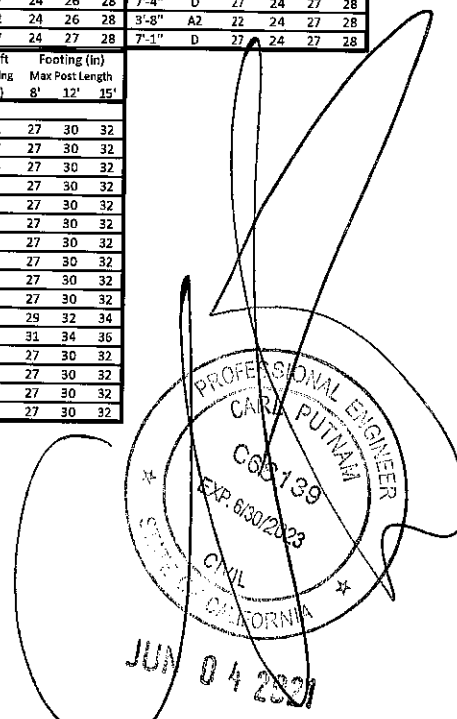

JUN 04 2021

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Ground Snow Load: 42 psf

Live Load: 20 psf

Roof Design Load 38 psf

Roof Solidity: 100%

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.47a: Grid of footing sizes (trib, Min Post, Uplift, Constrained Footing) for various materials and configurations under the specified load conditions.

Ground Snow Load: 42 psf

Live Load: 20 psf

Roof Design Load 42 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.47b: Grid of footing sizes (trib, Min Post, Uplift, Constrained Footing) for various materials and configurations under the specified load conditions for freestanding structures.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P.E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

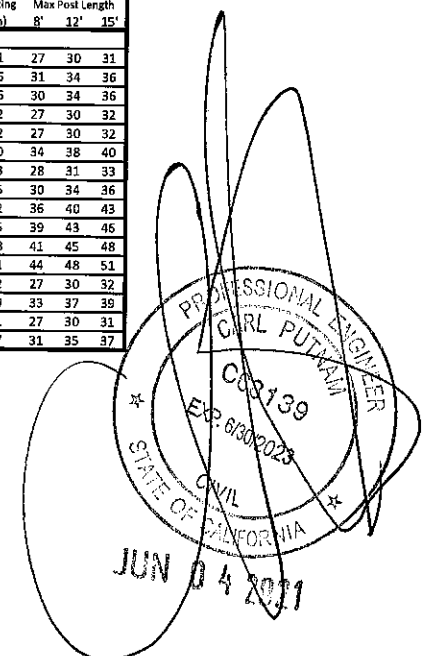

JUN 04 2021

SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Ground Snow Load: 50 psf

Live Load: 20 psf

Roof Design Load 43 psf

Roof Solidity: 100%

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.49a: Detailed table for attached structures with columns for footing type, min post, uplift, and constrained footing for various roof and wind conditions.

Ground Snow Load: 50 psf

Live Load: 20 psf

Roof Design Load 47 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.49b: Detailed table for freestanding structures with columns for footing type, min post, uplift, and constrained footing for various roof and wind conditions.

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

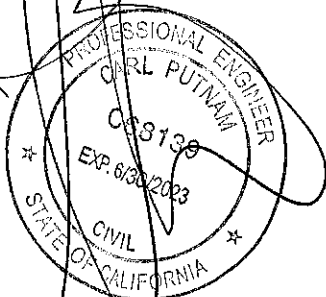

JUN 04 2021



SECTION 5.0 POST SPACING, POST TYPE AND FOOTING SIZE FOR SOLID COVERS

Ground Snow Load: 60 psf

Live Load: 20 psf

Roof Design Load 51 psf

Roof Solidity: 100%

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%

Seismic Design Category D

Structures are Attached to Existing Building

Table 5.51a: Grid of footing specifications for attached structures. Columns include member type (e.g., On Slab, Double 3"x8", 5.5" Extruded Fascia), footing dimensions (trib, Min Post, Uplift, Footing, Max Post Length), and design parameters (trib, Min Post, Uplift, Footing, Max Post Length).

Ground Snow Load: 60 psf

Live Load: 20 psf

Roof Design Load 53 psf

Wind Speed: 120 MPH EXPOSURE C or 140 MPH EXPOSURE B

Seismic Ss= 150%


Seismic Design Category D

Freestanding Structures

Table 5.51b: Grid of footing specifications for freestanding structures. Columns include member type (e.g., On Slab, Double 3"x8", 5.5" Extruded Fascia), footing dimensions (trib, Min Post, Uplift, Footing, Max Post Length), and design parameters (trib, Min Post, Uplift, Footing, Max Post Length).

Amerimax Exterior Home Products 28921 US Hwy 74 Romoland, CA 92585

Carl Putnam, P. E. 3441 Ivylink Place Lynchburg, VA 24503 carlputnam@comcast.net

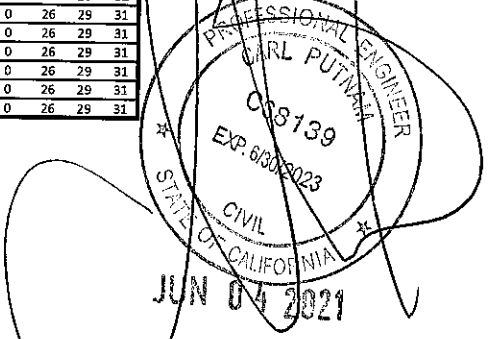


JUN 04 2021







USE OF FOAM CORE SANDWICH PANELS WILL REQUIRE THE USE OF A REGISTERED DESIGN PROFESSIONAL TO COMPLY WITH EXISTING ICC ESR


FOAM CORE SANDWICH PANEL W/ CURRENT ICC ESR

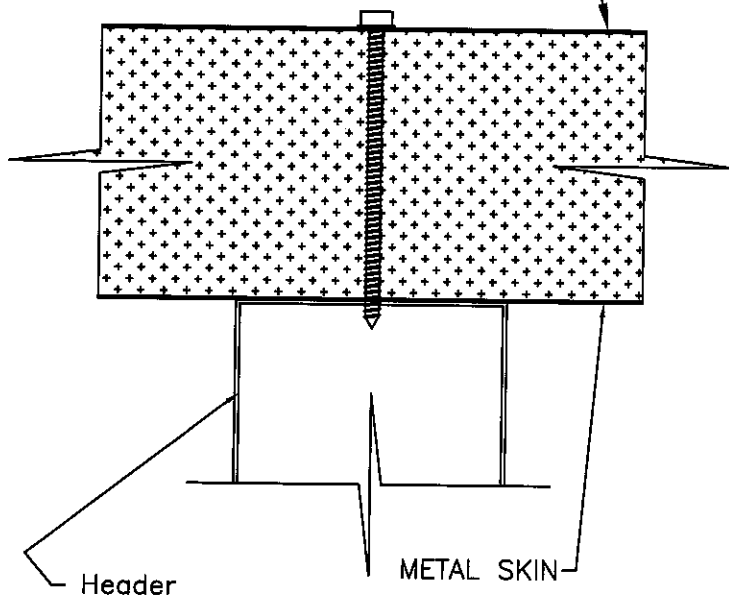

(N1) SANDWICH PANEL TO HEADER CONNECTION

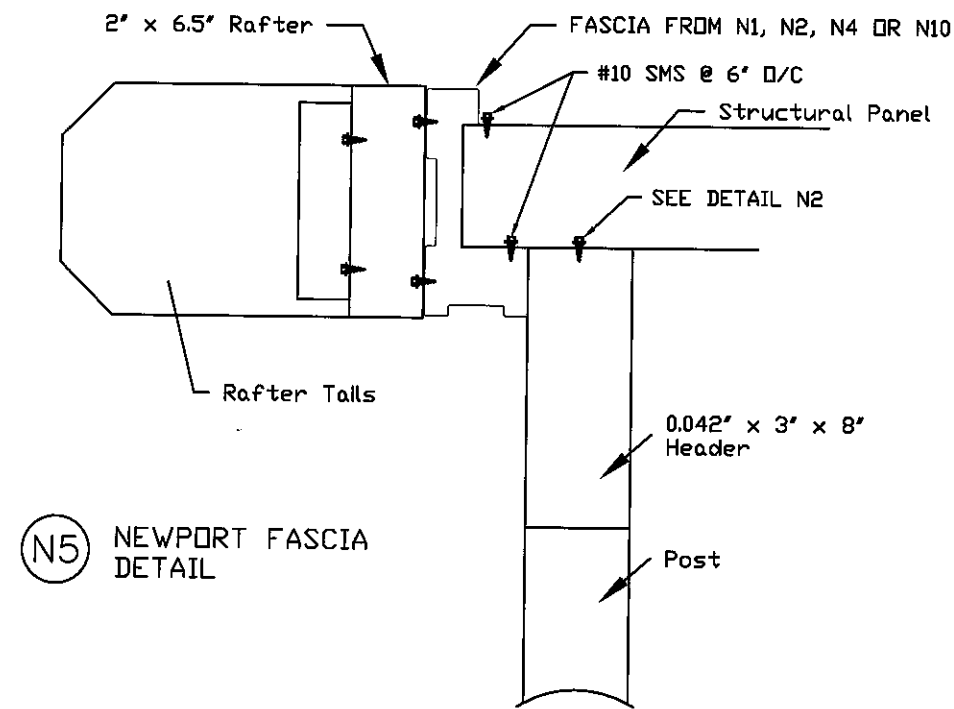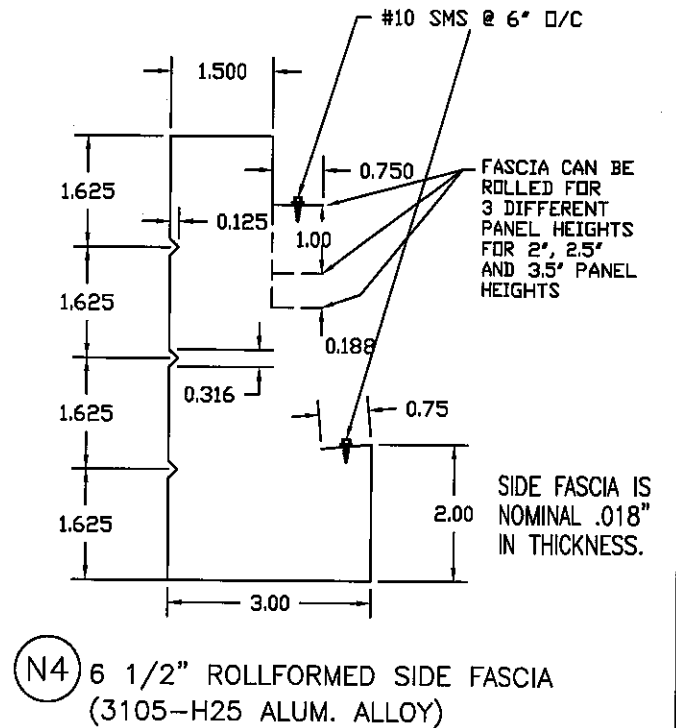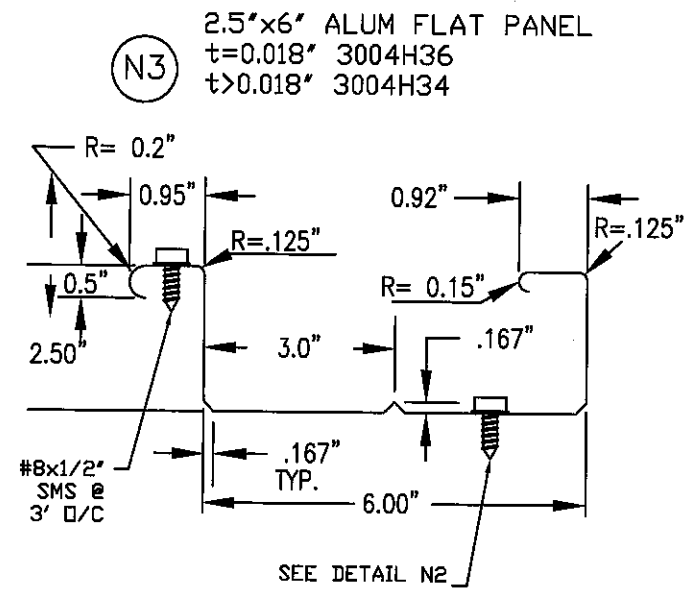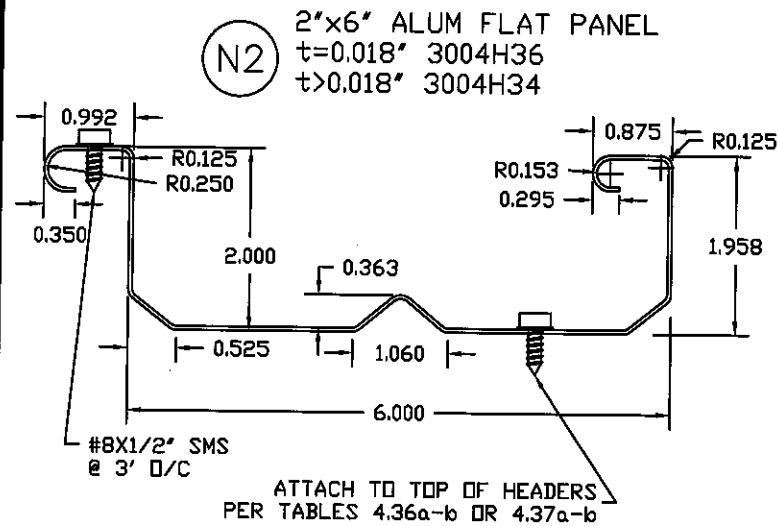

(N5) NEWPORT FASCIA DETAIL

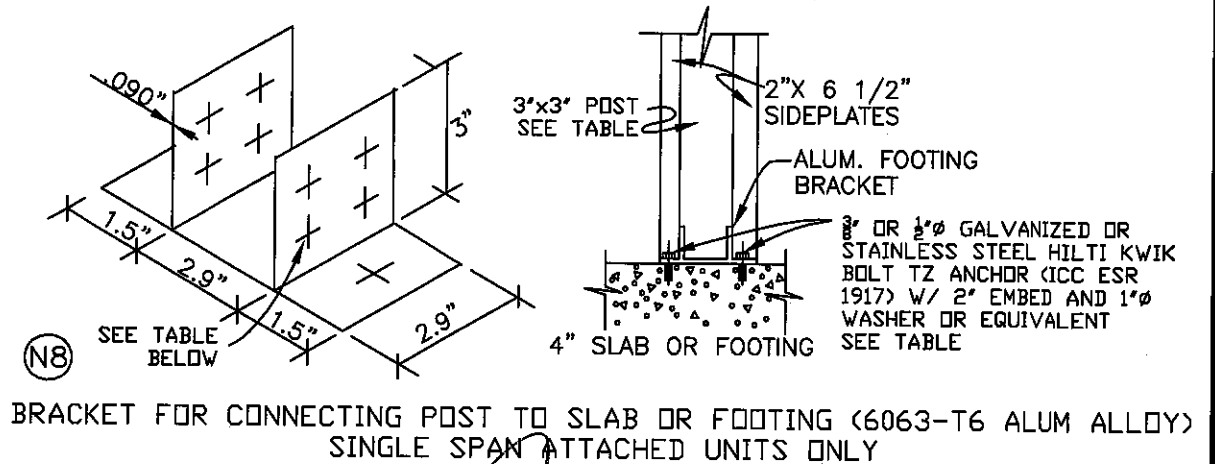


BRACKET FOR CONNECTING POST TO SLAB OR FOOTING (6063-T6 ALUM ALLOY) SINGLE SPAN ATTACHED UNITS ONLY

Footing d (in)	Number Of #14 SMS	3"x3" Post	Concrete Anchors	Maximum Wind Condition for "On Slab" Attachment
26	8	0.024" Alum	3/8"	110 mph Exp B
29	8	0.032" Alum	3/8"	105 mph Exp C / 130 mph Exp B
30	12	0.024" Alum	1/2"	115 mph Exp C
3B	12	0.032" Alum	1/2"	130 mph Exp C
3B	8	0.041" Steel	1/2"	150 mph Exp C


PROFESSIONAL ENGINEER  
 STATE OF CALIFORNIA  
 C68139  
 EXP 6/30/2023  
 CIVIL  
 JUN 04 2021

**Amerimax** 28921 US Hwy 74  
 EXTERIOR HOME PRODUCTS Romoland, CA 92585


DRAWN BY: BEJ/CP TYPE:  
 SCALE: NTS NAME: Component Parts & Connection Details for Newport Patio Structures  
 DATE: FILE: NP01-2018 SHEET: 1 of 4

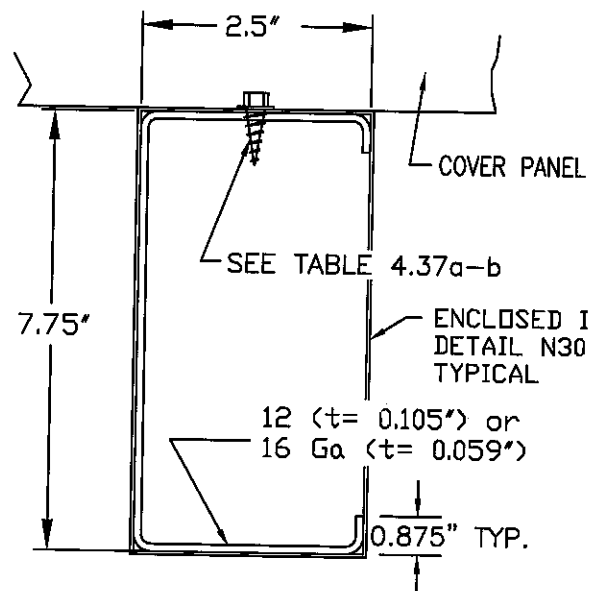

**N9** STEEL "C" - CHANNEL HEADER  
(STEEL A-653 Fy=50 KSI)

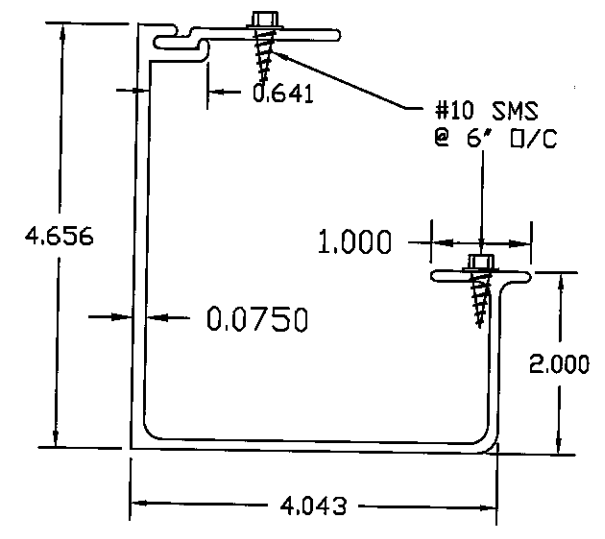


**N10** CALIFORNIA FASCIA  
(ALUM 6063 T6)

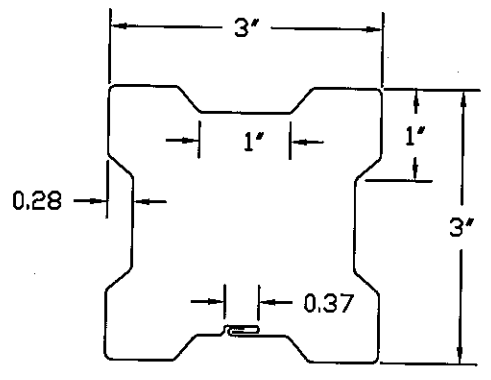


**N11** 3" ALTERNATE POST  
(3105-H25 ALUM. ALLOY OR A-653 Fy=40 KSI STEEL)

NOTE:  
POSTS MAY BE TRIMMED w/FLEX ALUM. FACING.

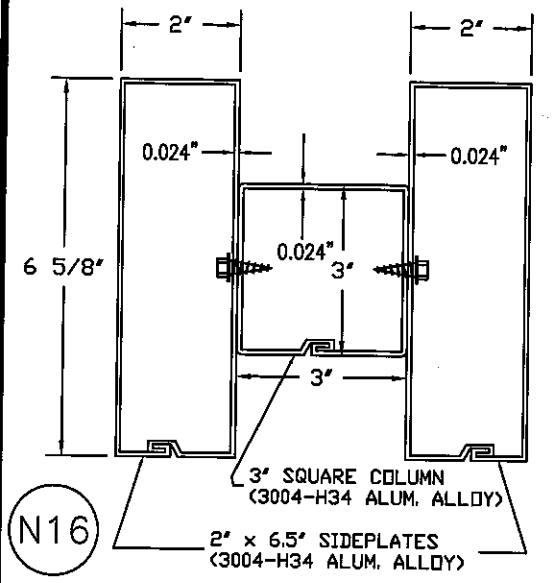


**N16** SIDEPLATE CONNECTION DETAIL


Live Load (psf)	Wind Speed and Exposure	MAX "L" FOR TOP OR SIDE MOUNT	
		16" o/c	24" o/c
10	115 mph Exp B	15'-2"	10'-1"
	130 mph Exp B	13'-7"	9'-1"
	100 mph Exp C	15'-2"	10'-1"
	110 mph Exp C	14'-7"	9'-8"
	115 mph Exp C	13'-10"	9'-3"
20	130 mph Exp C	12'-2"	8'-2"
	115 mph Exp B	10'-3"	6'-9"
	100 mph Exp C	10'-3"	6'-9"
	110 mph Exp C	10'-0"	6'-8"
	115 mph Exp C	9'-8"	6'-6"
	130 mph Exp C	8'-9"	5'-10"

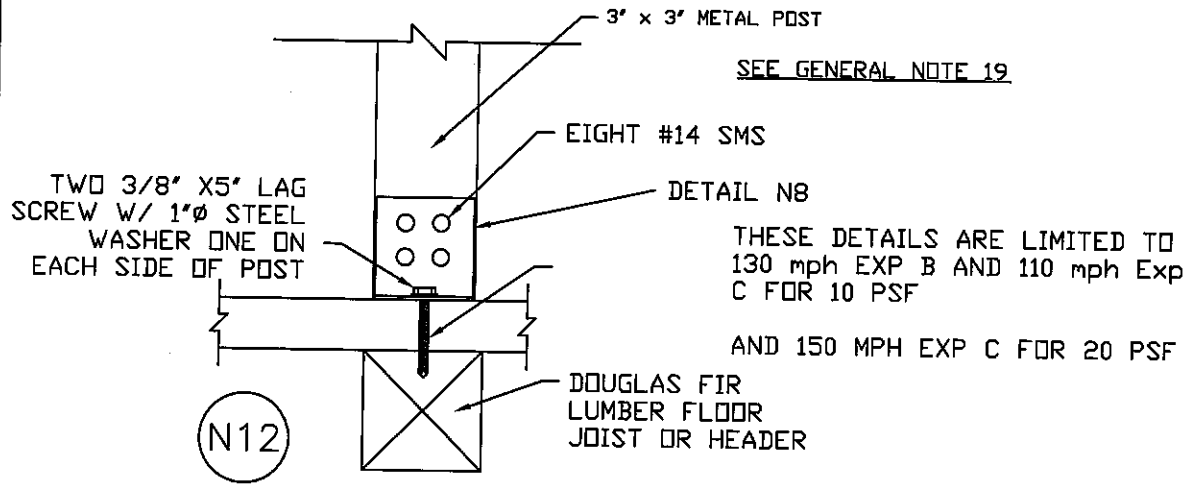

**N12** ATTACHED STRUCTURE POST TO DECK FLOOR JOIST

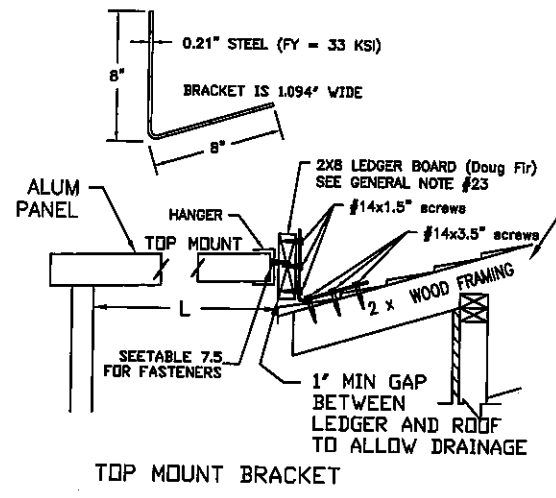


**N17** TOP MOUNT BRACKET

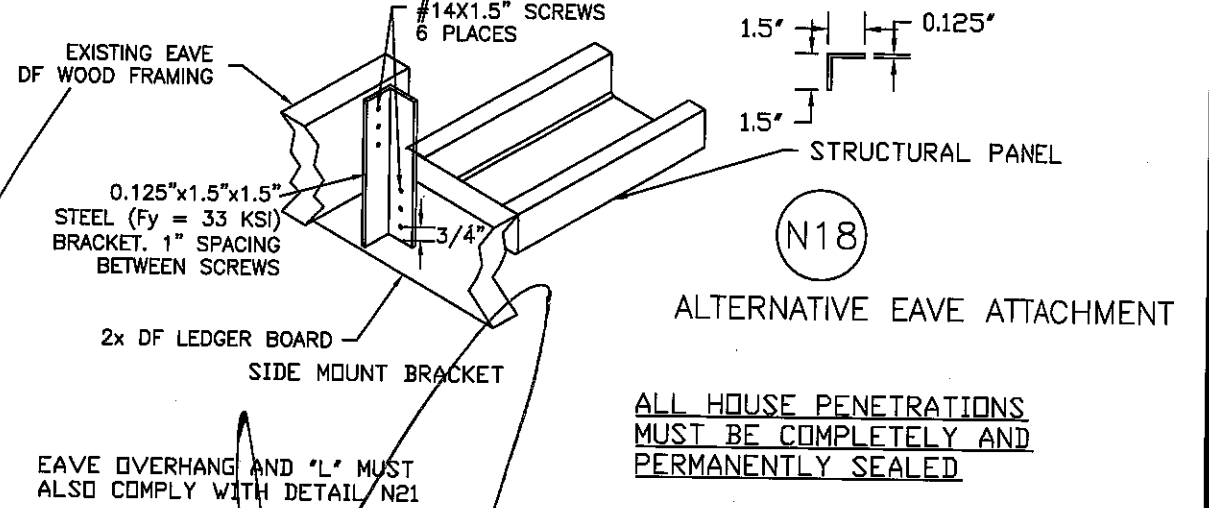


**N18** ALTERNATIVE EAVE ATTACHMENT

TOP MOUNT BRACKET NOT ALLOWED IN SNOW LOAD AREAS  
SEE GENERAL NOTE #9 FOR CORROSION PROTECTION


ALL HOUSE PENETRATIONS MUST BE COMPLETELY AND PERMANENTLY SEALED

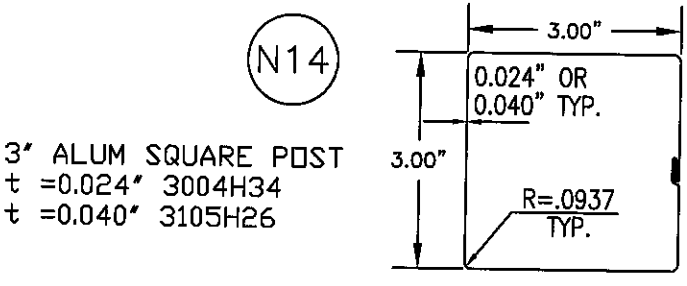

**N14** 3" ALUM SQUARE POST  
t = 0.024" 3004H34  
t = 0.040" 3105H26


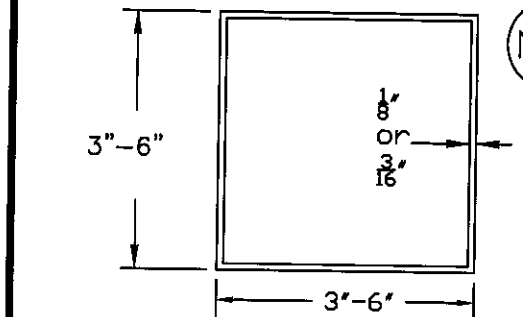


**N17** ASTM A500 GRADE B STEEL POST  
SEE GENERAL NOTE #9 FOR CORROSION PROTECTION

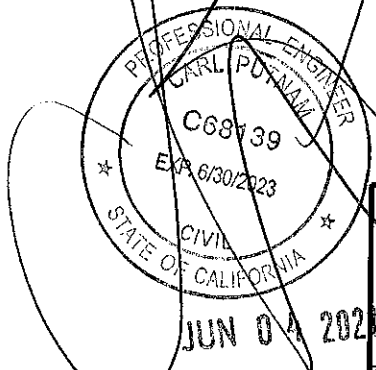


**Amerimax** 28921 US Hwy 74  
EXTERIOR HOME PRODUCTS Romoland, CA 92585

DRAWN BY: BEJ/CP TYPE:  
SCALE: NTS NAME: Component Parts & Connection Details for Newport Patio Structures  
DATE: FILE#: NP02-2018 SHEET: 2 of 4

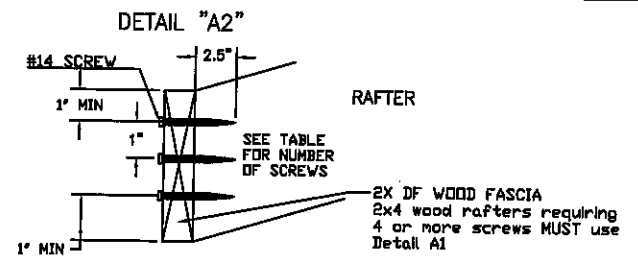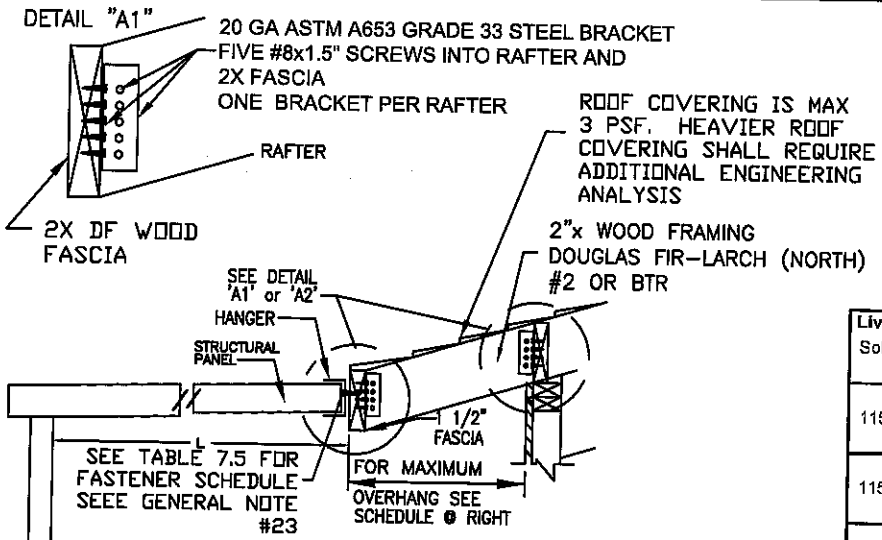


(N21) ALTERNATE EAVE ATTACHMENT


Live/Snow Load Solid Cover Wind (psf)	RAFTER SIZE (24" O/C)	MAX DISTANCE TO FIRST ROW OF POSTS "L"						# of #14 Screws
		EAVE OVERHANG						
		6"	12"	18"	24"	30"	36"	
10 115 MPH EXP B	2x4	21'-0"	20'-5"	11'-6"	6'-4"	2'-10"	2	
	2x6	21'-0"	21'-0"	21'-0"	21'-0"	16'-3"		
	2x8	21'-0"	21'-0"	21'-0"	21'-0"	21'-0"		
10 115 MPH EXP C	2x4	21'-0"	20'-3"	11'-5"	6'-4"	2'-9"	2	
	2x6	21'-0"	21'-0"	21'-0"	21'-0"	16'-2"		
	2x8	21'-0"	21'-0"	21'-0"	21'-0"	21'-0"		
10 130 MPH EXP C	2x4	21'-0"	17'-8"	9'-11"	5'-6"	2'-5"	3	
	2x6	21'-0"	21'-0"	21'-0"	20'-1"	14'-1"		
	2x8	21'-0"	21'-0"	21'-0"	21'-0"	21'-0"		
20 110 MPH EXP C	2x4	18'-0"	10'-2"	5'-9"	3'-2"	1'-5"	3	
	2x6	18'-0"	16'-0"	16'-0"	11'-7"	8'-1"		
	2x8	18'-0"	16'-0"	16'-0"	16'-0"	16'-0"		
20 115 MPH EXP C	2x4	18'-0"	10'-2"	5'-9"	3'-2"	1'-5"	3	
	2x6	18'-0"	16'-0"	16'-0"	11'-7"	8'-1"		
	2x8	18'-0"	16'-0"	16'-0"	16'-0"	16'-0"		
20 130 MPH EXP C	2x4	18'-0"	10'-2"	5'-9"	3'-2"	1'-5"	3	
	2x6	18'-0"	16'-0"	16'-0"	11'-7"	8'-1"		
	2x8	18'-0"	16'-0"	16'-0"	16'-0"	16'-0"		
25 110 MPH EXP C	2x4	18'-0"	11'-2"	6'-3"	3'-6"	1'-6"	3	
	2x6	18'-0"	16'-0"	16'-0"	12'-8"	8'-10"		
	2x8	18'-0"	16'-0"	16'-0"	16'-0"	16'-0"		
25 130 MPH EXP C	2x4	16'-0"	11'-2"	6'-3"	3'-6"	1'-6"	3	
	2x6	16'-0"	16'-0"	16'-0"	12'-8"	8'-10"		
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"		
30 130 MPH EXP C	2x4	15'-0"	9'-2"	5'-1"	2'-9"	1'-0"	4	
	2x6	15'-0"	15'-0"	15'-0"	10'-5"	7'-2"		
	2x8	15'-0"	15'-0"	15'-0"	15'-0"	14'-9"		
35.7 130 MPH EXP C	2x4	15'-0"	7'-7"	4'-0"	1'-11"	0'-6"	4	
	2x6	15'-0"	15'-0"	12'-8"	8'-5"	5'-7"		
	2x8	15'-0"	15'-0"	15'-0"	15'-0"	12'-0"		
42 130 MPH EXP C	2x4	14'-0"	6'-3"	3'-2"	1'-4"	0'-0"	4	
	2x6	14'-0"	14'-0"	10'-6"	8'-10"	4'-5"		
	2x8	14'-0"	14'-0"	14'-0"	13'-8"	9'-10"		
60 130 MPH EXP C	2x4	12'-0"	5'-1"	2'-5"	0'-10"	0'-0"	4	
	2x6	13'-0"	13'-0"	8'-7"	5'-5"	3'-3"		
	2x8	13'-0"	13'-0"	13'-0"	11'-1"	7'-10"		
60 130 MPH EXP C	2x4	9'-11"	4'-1"	1'-9"	0'-4"	0'-0"	4	
	2x6	12'-0"	11'-9"	6'-11"	4'-2"	2'-4"		
	2x8	12'-0"	12'-0"	12'-0"	8'-11"	6'-1"		

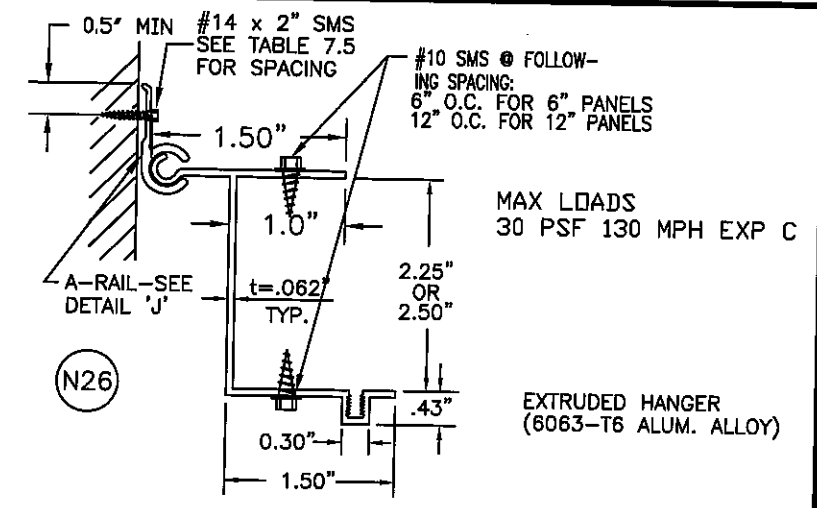

(N26)

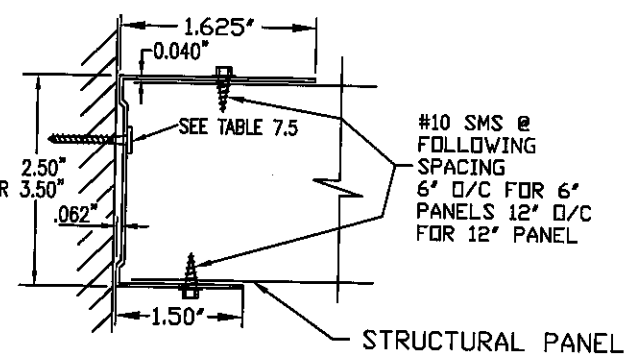


(N27) ROLLFORMED HANGER (3004-H34 ALUM. ALLOY)

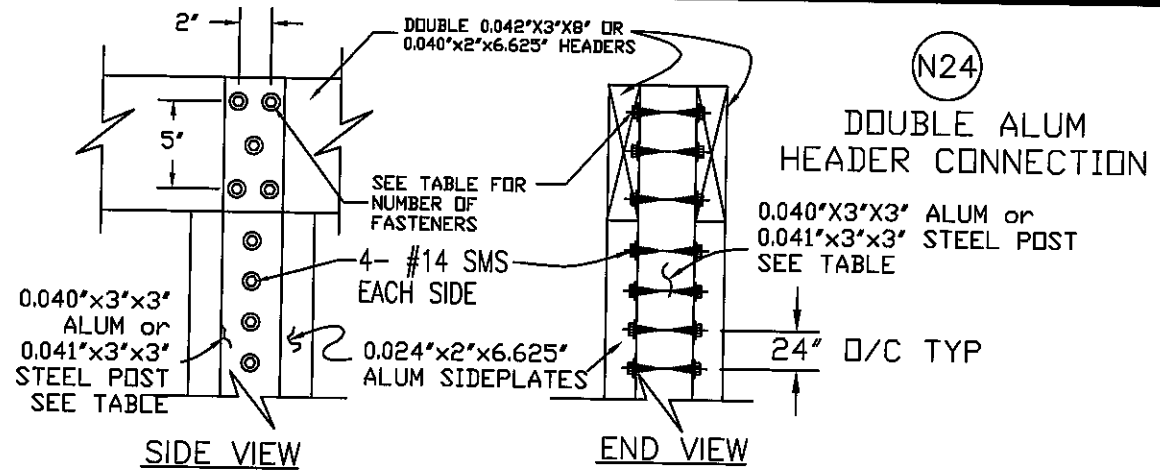


(N24)

DOUBLE ALUM HEADER CONNECTION

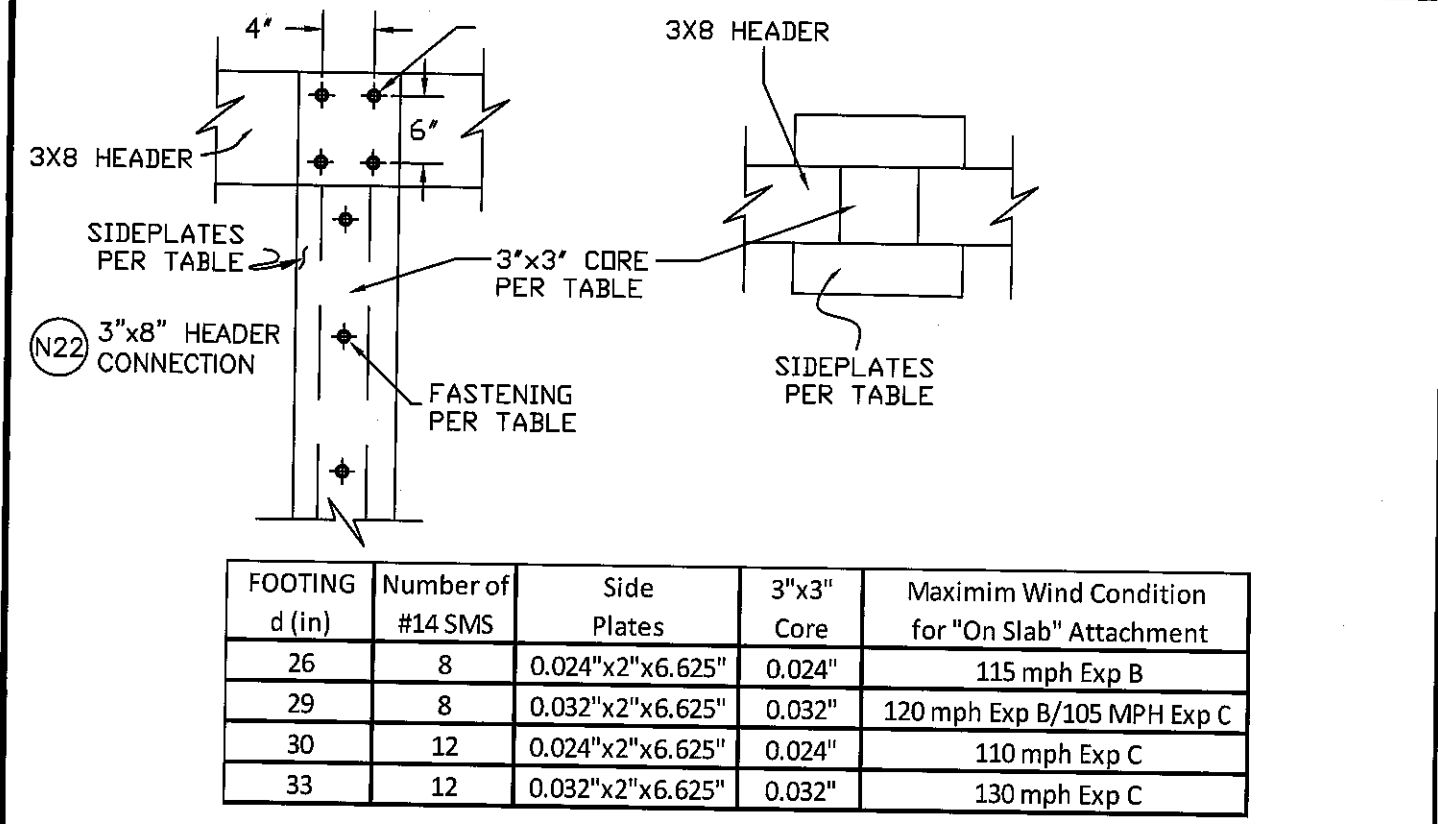


(N22)

FOOTING d (in)	Number of #14 SMS	Side Plates	3"x3" Core	Maximum Wind Condition for "On Slab" Attachment
26	8	0.024"x2"x6.625"	0.024"	115 mph Exp B
29	8	0.032"x2"x6.625"	0.032"	120 mph Exp B/105 MPH Exp C
30	12	0.024"x2"x6.625"	0.024"	110 mph Exp C
33	12	0.032"x2"x6.625"	0.032"	130 mph Exp C

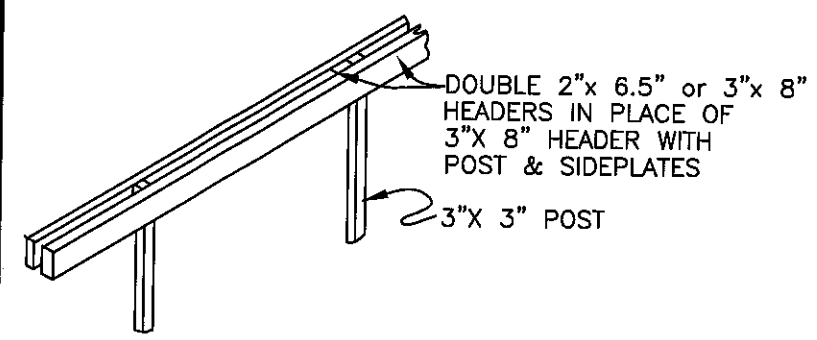


(N25) DOUBLE 2"x6.625" HEADERS (DETAIL N31)  
DOUBLE 3"x8" HEADER (DETAIL N30)

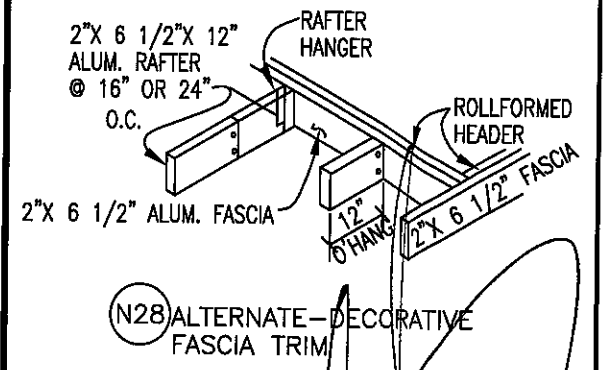


(N28) ALTERNATE-DECORATIVE FASCIA TRIM

Max Uplift Footing d (in)	Total Number of #14 SMS	Maximum Wind Condition for "On Slab" Attachment	Minimum 3"x3" Post
30	8	115 mph Exp B/100 mph Exp C	0.040" Alum
32	10	120 mph Exp C	0.040" Alum
34	12	130 mph Exp C	0.040" Alum
31	8	120 mph Exp C	0.041" Steel
34	10	130 mph Exp C	0.041" Steel

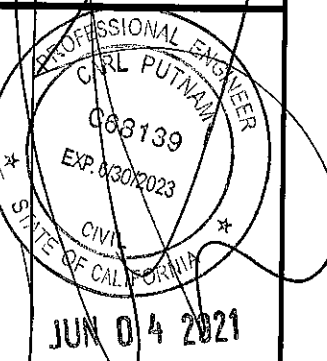


**Amerimax** 28921 US Hwy 74  
EXTERIOR HOME PRODUCTS Romoland, CA 92585


DRAWN BY: BEJ/CP TYPE:  
SCALE: NTS NAME: Component Parts & Connection Details for Newport Patio Structures  
DATE: FILE#: NP03-2018 SHEET: 3 of 4

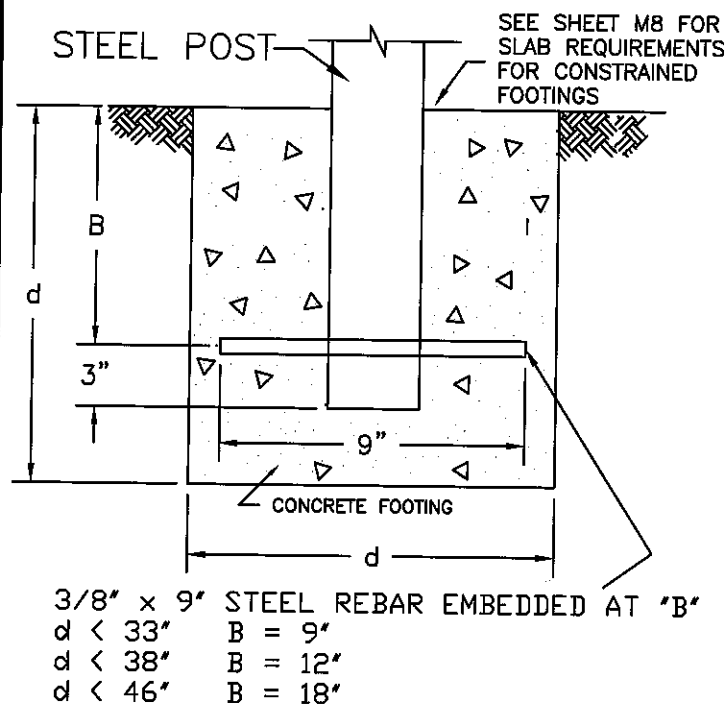


(N29) FREESTANDING OR ATTACHED POST/FOOTING CONNECTION

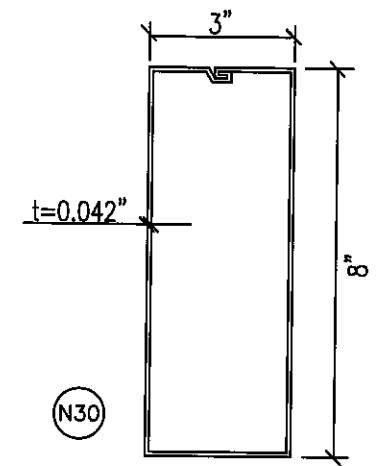


(N30) HEADER (3004-H34 ALUM. ALLOY)

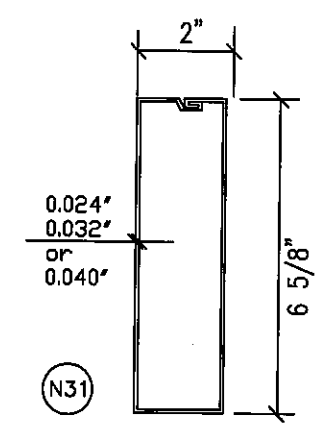


(N31) RAFTER & SIDEPLATES (3004-H34 ALUM. ALLOY)

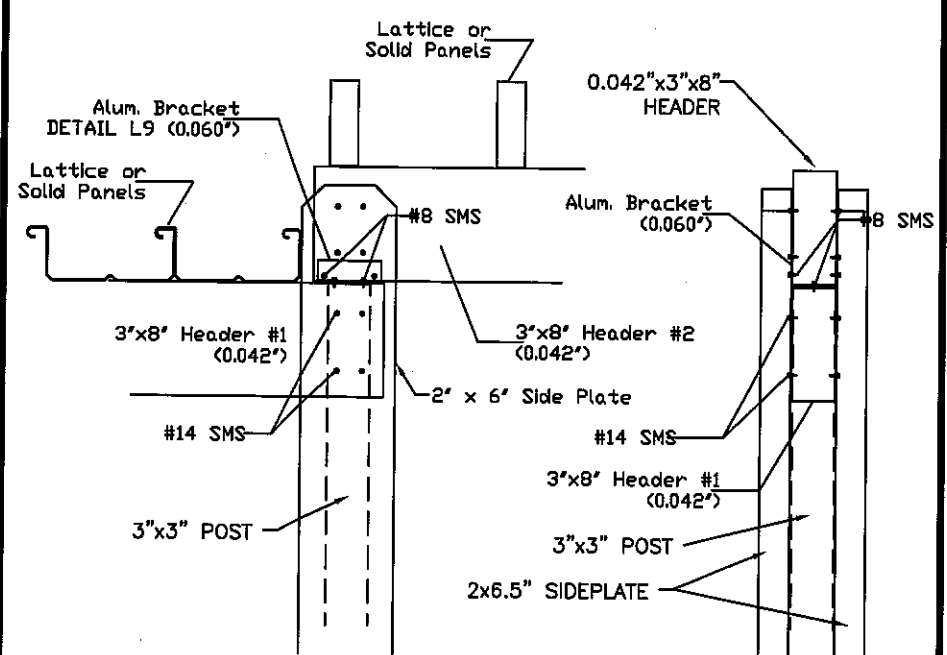

(N32) ALTERNATIVE SPLICE FOR ATTACHED UNITS USE SAME TABLE IN N22 FOR FOOTING SIZES AND "ON SLAB" WIND CONDITIONS

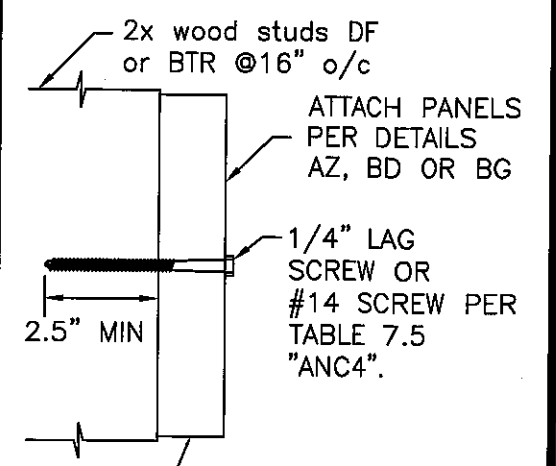


(N34) LEDGER BOARD ATTACHMENT

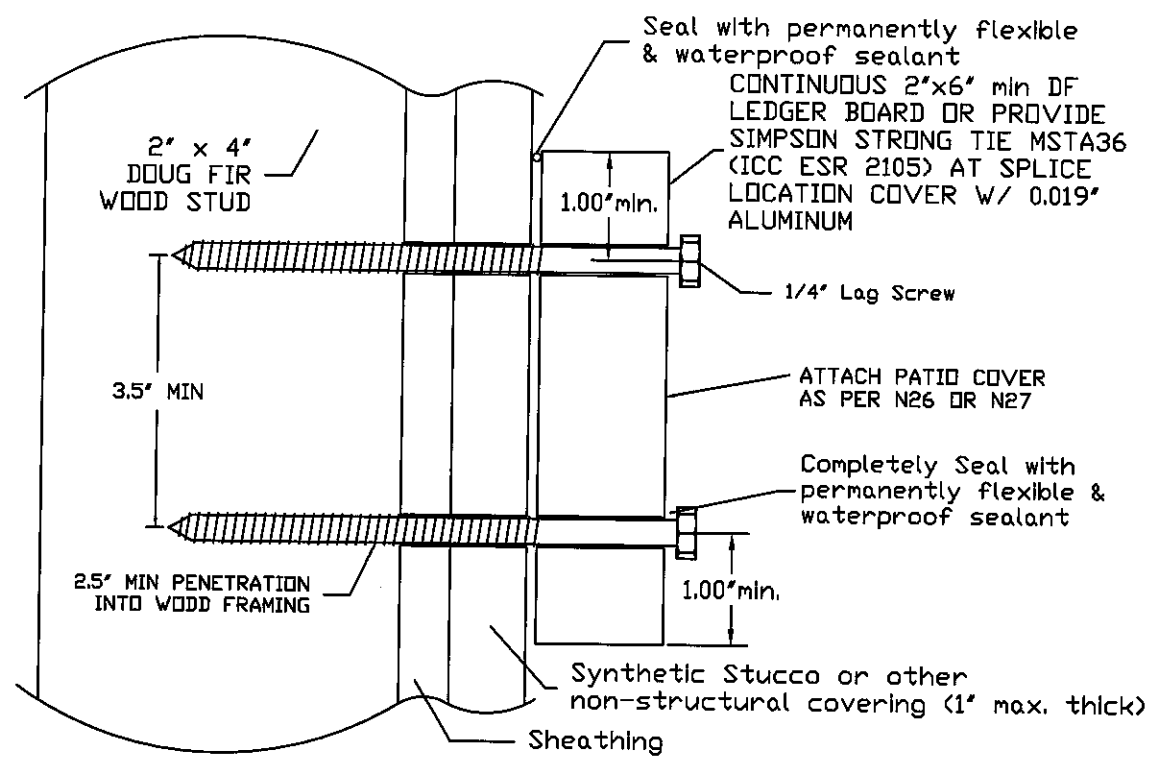


SEE ALLOWABLE DISTANCE TO FIRST ROW OF POSTS IN TABLE 7.7

(N33) STUCCO ATTACHMENT DETAIL W/ LEDGER BOARD

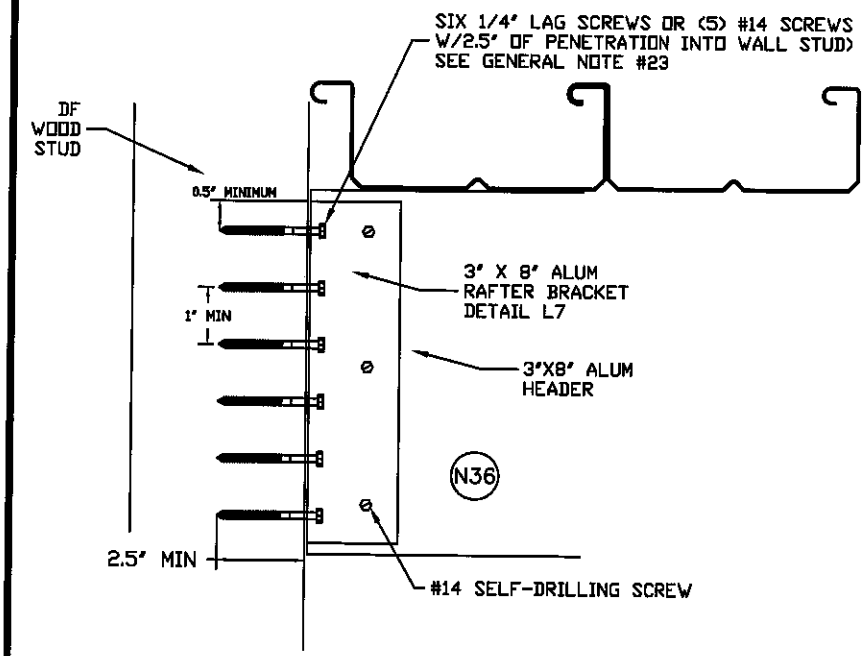


(N36) POST ALTERNATIVE FOR SLAB ATTACHMENT MAX WIND LOAD IS 130 MPH EXP B or 110 MPH EXP C

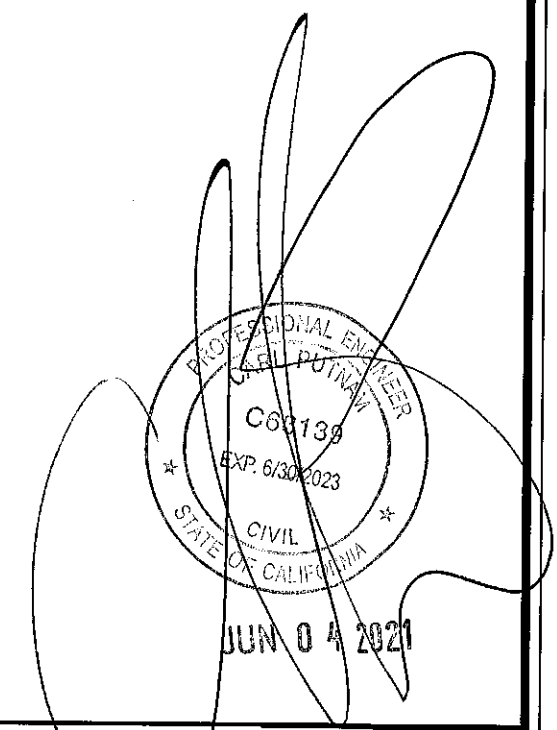


**Amerimax** 28921 US Hwy 74  
 EXTERIOR HOME PRODUCTS Romoland, CA 92585

DRAWN BY: BEJ/CP	TYPE:
SCALE: NTS	NAME: Component Parts & Connection Details for Newport Patio Structures
DATE:	FILE: NP04-2018
	SHEET: 4 of 4



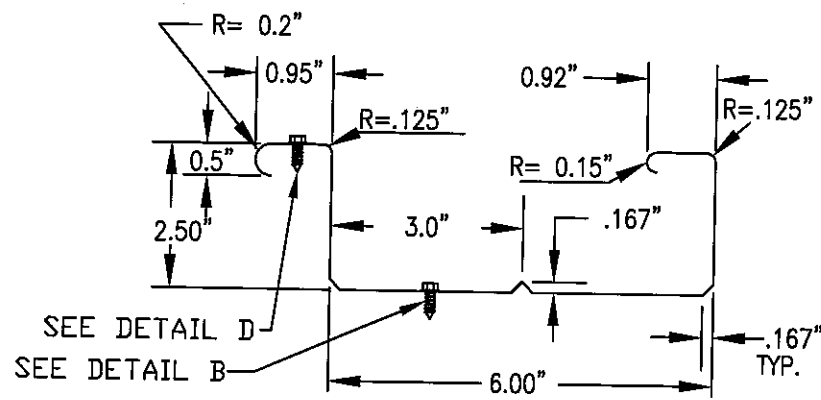


(A) 2.5"x6" SUPER SIX PANEL  
 t = 0.018" 3004H36  
 t > 0.018" 3004H34

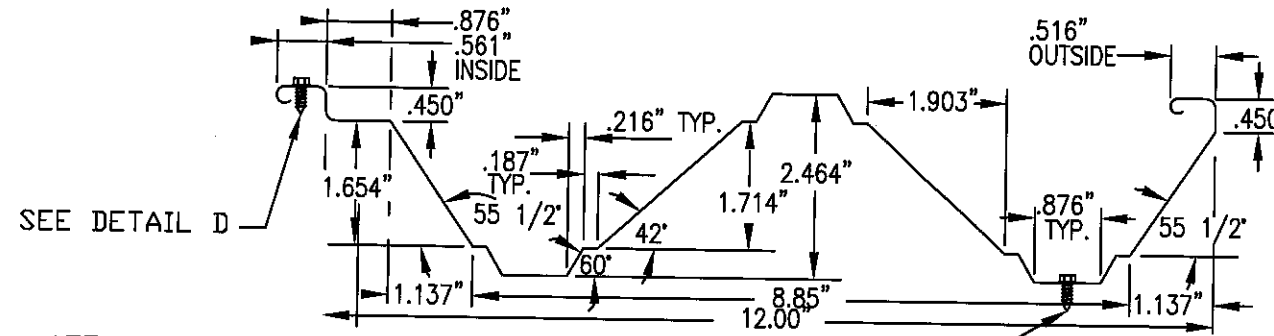


SEE DETAIL D  
 ATTACH TO TOP OF HEADER BEAM AS PER TABLES 4.36a-b  
 or 4.37a-b OR ATTACH PER STRUCTURAL FASCIA DETAILS


(B) 2.5"x12" MARK X ALUMINUM PANEL  
 0.018"-0.032" 3004 H36  
 0.036" 3004 H34

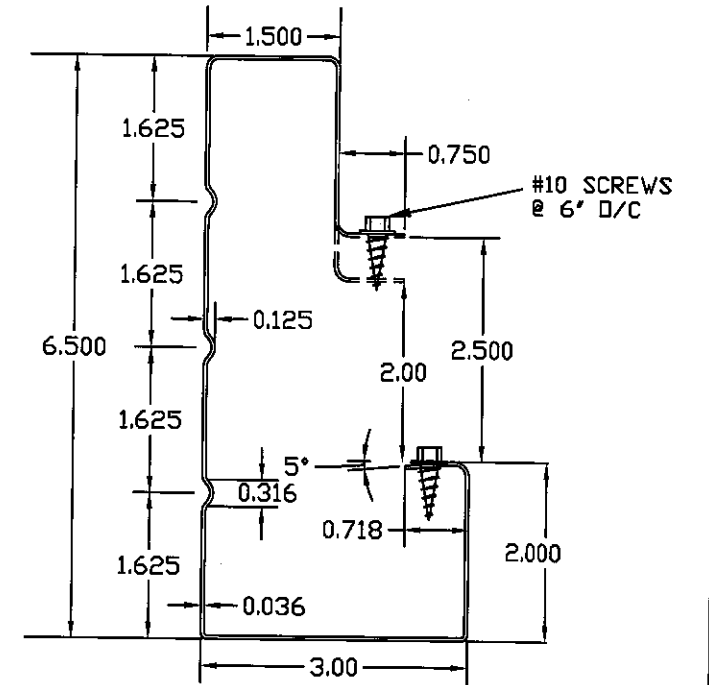


(E) 6 1/2" ROLLFORMED FASCIA 3105H25 ALLOY

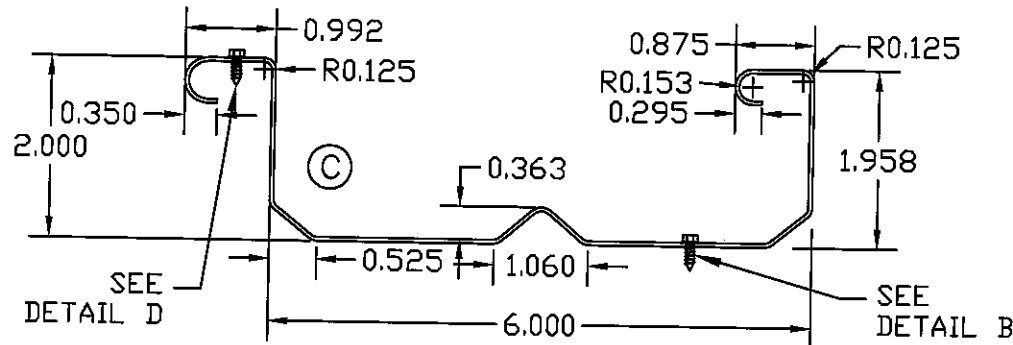

(C) 2"x6" FLAT PANEL  
 t = 0.018" 3004H36 ALUMINUM  
 t > 0.018" 3004H34 ALUMINUM

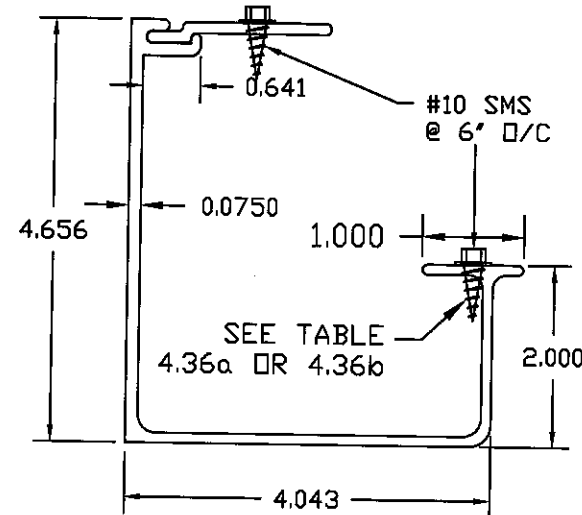


(G) CALIFORNIA FASCIA  
 (6063-T6 ALUM. ALLOY)

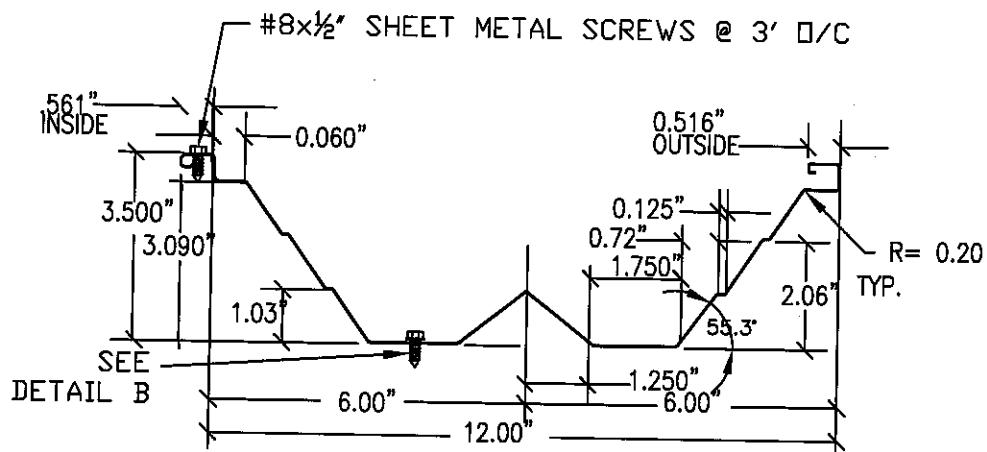

(D) 3.5"x12" "W" PANEL  
 t = 0.018" 3004H36 ALUMINUM  
 t > 0.018" 3004H34 ALUMINUM


Amerimax Standard Plan 2019 CBC 12/9/2019




JUN 04 2021

**Amerimax** 28921 US Hwy 74  
 EXTERIOR HOME PRODUCTS Romoland, CA 92585


DRAWN BY: BEJ/CP	TYPE:
SCALE: NTS	NAME: Component Parts & Connection Details
DATE:	FILE: CD01-2018
	SHEET: 1 of 9

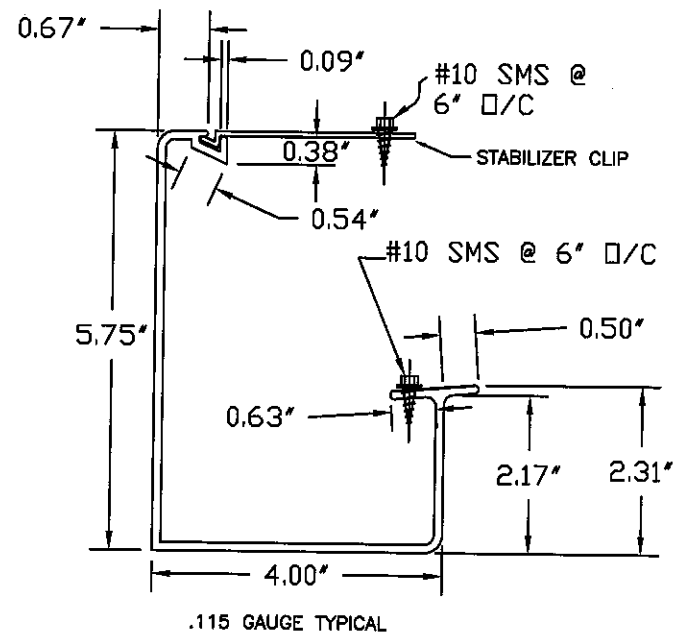


(H) CLASSIC FASCIA  
W/ STABLIZER CLIP  
(6061-T6 Alum. Alloy)

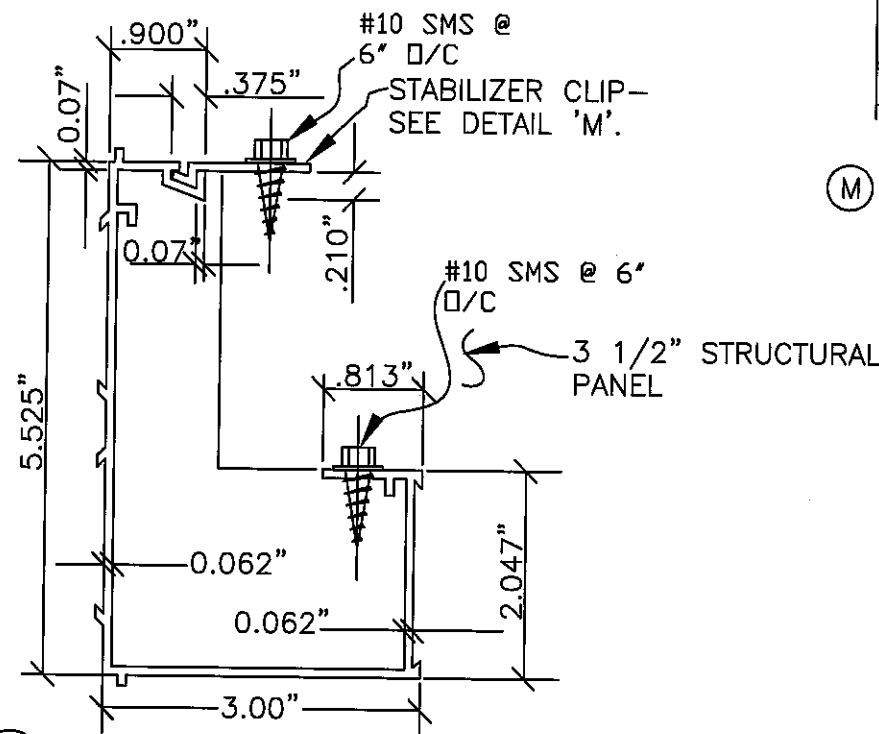


(L) 5 1/2" EXTRUDED HEADER  
(6105-T5 ALUM. ALLOY)

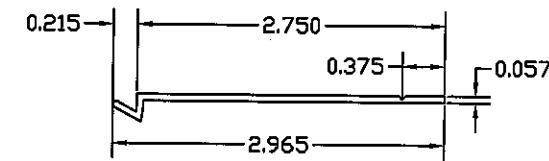


(M) STABILIZER CLIP FOR EXTRUDED HEADERS 'H' & 'L'  
(6063-T6 ALUM. ALLOY)

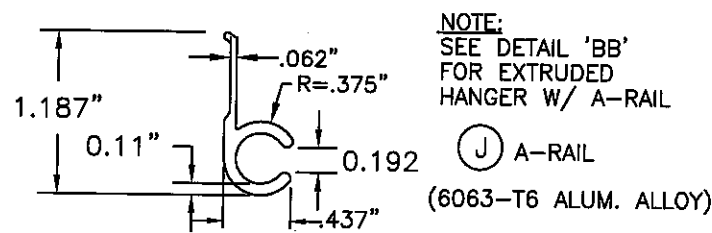

NOTE: SEE DETAIL 'BB' FOR EXTRUDED HANGER W/ A-RAIL  
(J) A-RAIL  
(6063-T6 ALUM. ALLOY)

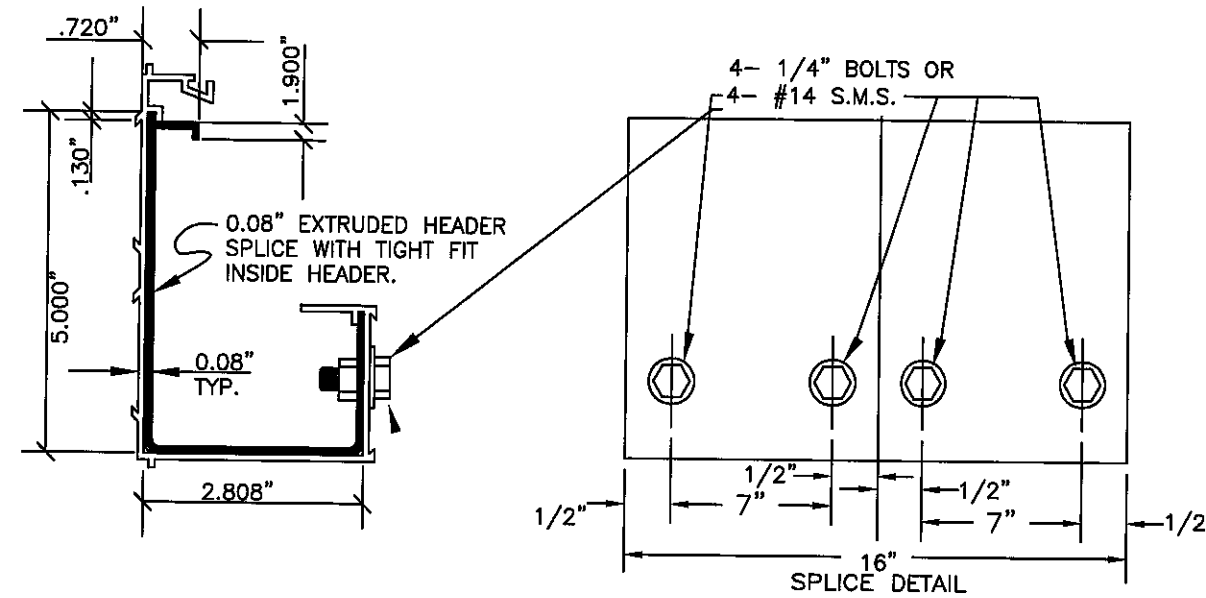


(N) 5 1/2" EXTRUDED HEADER SPLICE  
6063T5 ALUMIMUM ALLOY

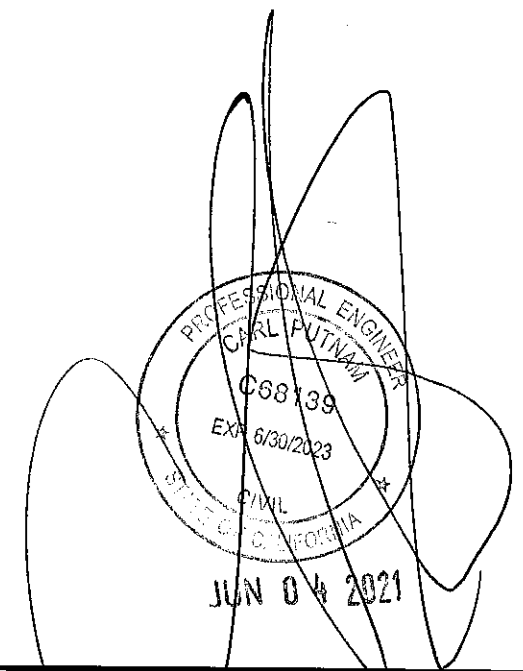



**Amerimax** 28921 US Hwy 74  
EXTERIOR HOME PRODUCTS Romoland, CA 92585

DRAWN BY: BEJ/CP	TYPE:
SCALE: NTS	NAME: Component Parts & Connection Details
DATE:	FILE: CD02-2018
	SHEET: 2 of 9

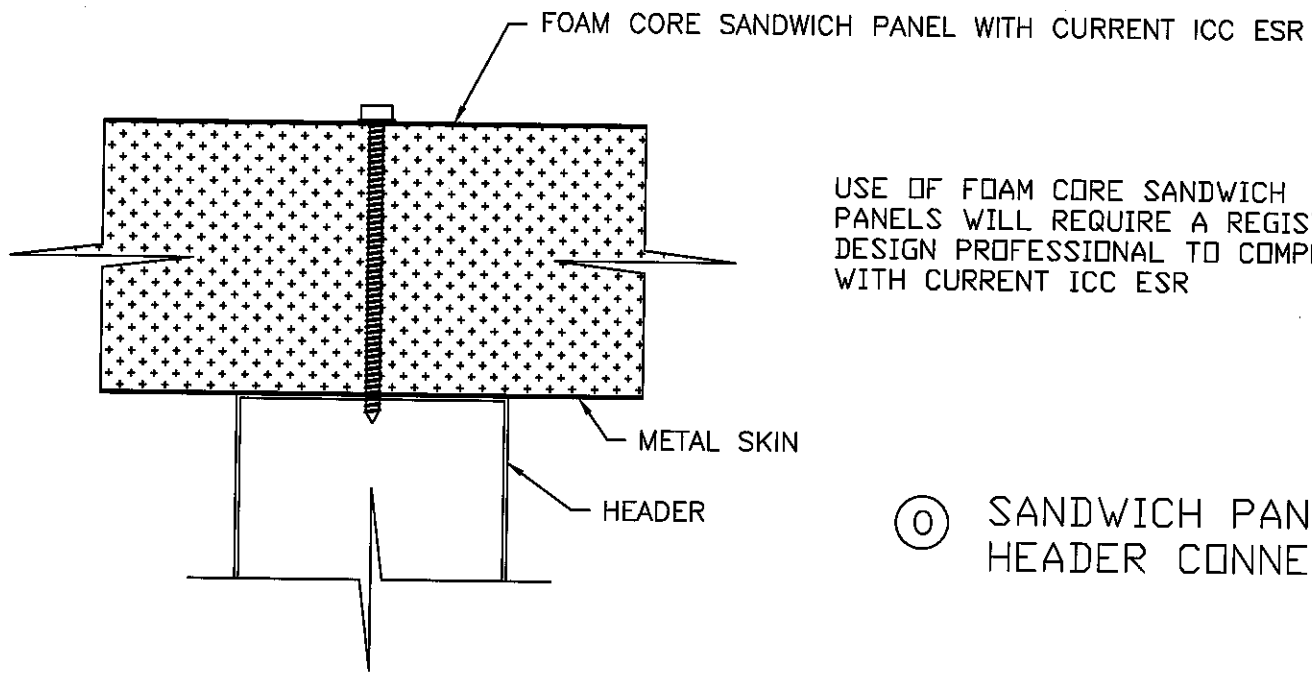


USE OF FOAM CORE SANDWICH PANELS WILL REQUIRE A REGISTERED DESIGN PROFESSIONAL TO COMPLY WITH CURRENT ICC ESR

ⓐ SANDWICH PANEL TO HEADER CONNECTION

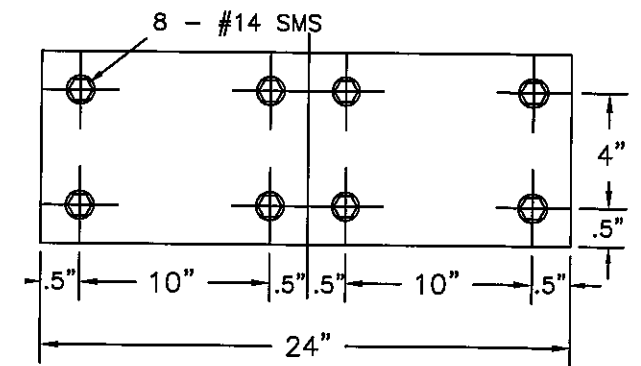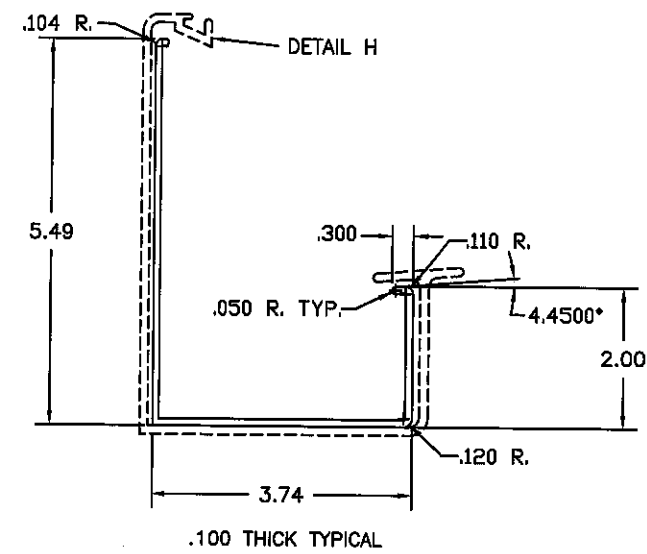


ⓑ CLASSIC ALASKAN HEADER SPLICE (6063 T5 ALUM. ALLOY)

SEE TABLE 4.37a OR 4.37b

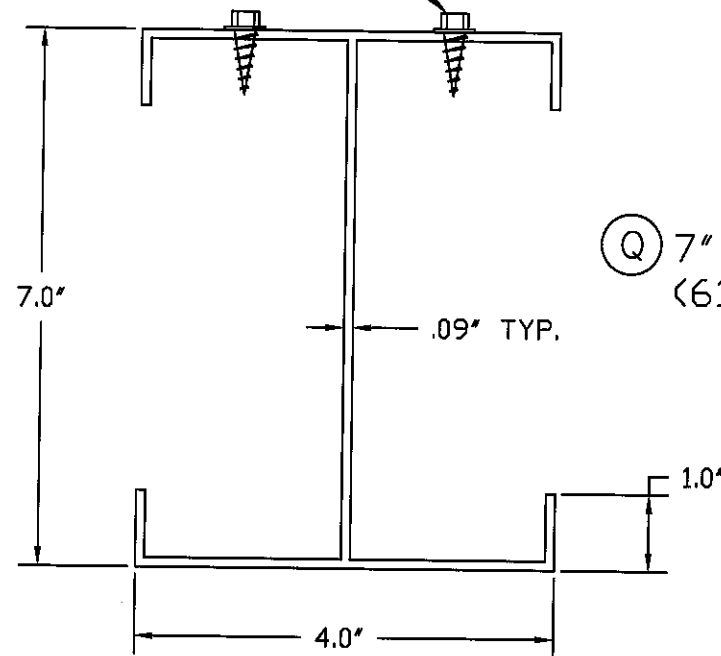


ⓐ 7" x 4" I BEAM HEADER (6105-T5 ALUM. ALLOY)

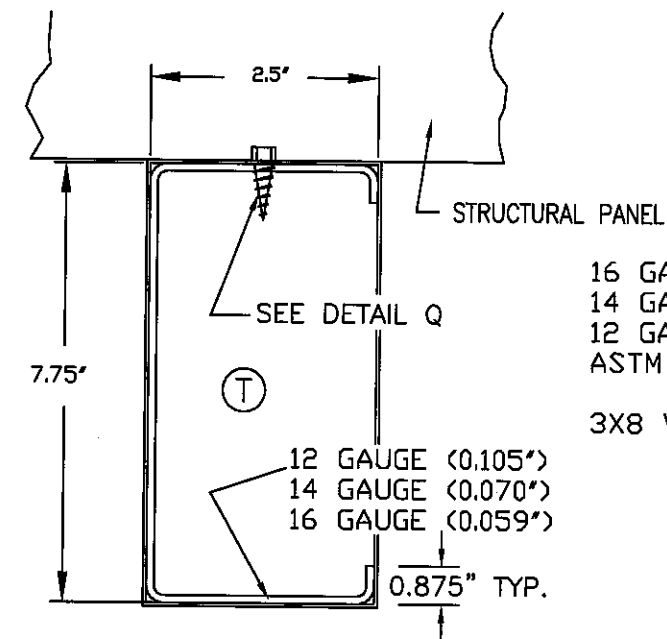


16 GA (t=0.059") 3"X8" STEEL HEADER  
 14 GA (t=0.070") 3"X8" STEEL HEADER  
 12 GA (t=0.105") 3"X8" STEEL HEADER  
 ASTM A653 GRADE 50

3X8 WRAP REQUIRED AS PER DETAIL AW

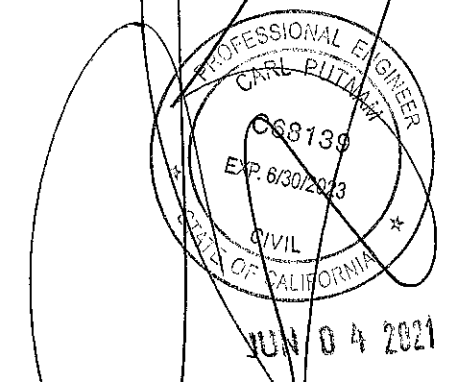


**Amerimax** 28921 US Hwy 74  
 EXTERIOR HOME PRODUCTS Romoland, CA 92585

DRAWN BY: BEJ/CP	TYPE:
SCALE: NTS	NAME: Component Parts & Connection Details
DATE:	FILE: CD03-2018
	SHEET: 3 of 9


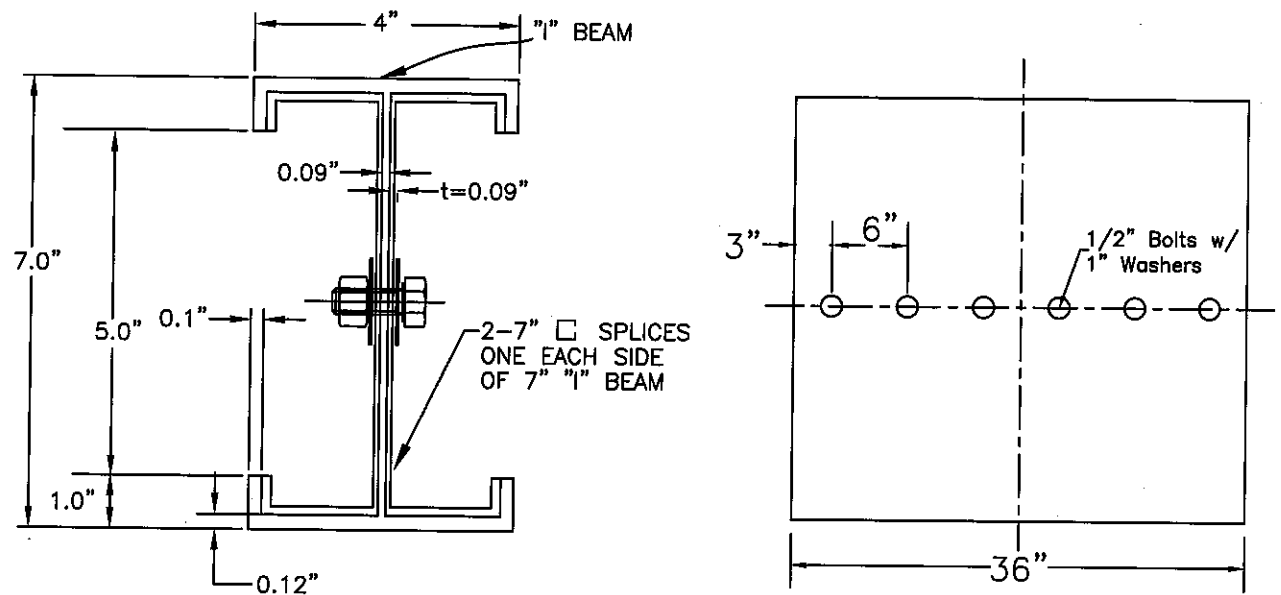


7" X 4" I-BEAM SPLICE  
(6105-T5 ALUM. ALLOY)

U 7" X 4" ALUM. I-BEAM FULL STRENGTH SPLICE BOLT LAYOUT

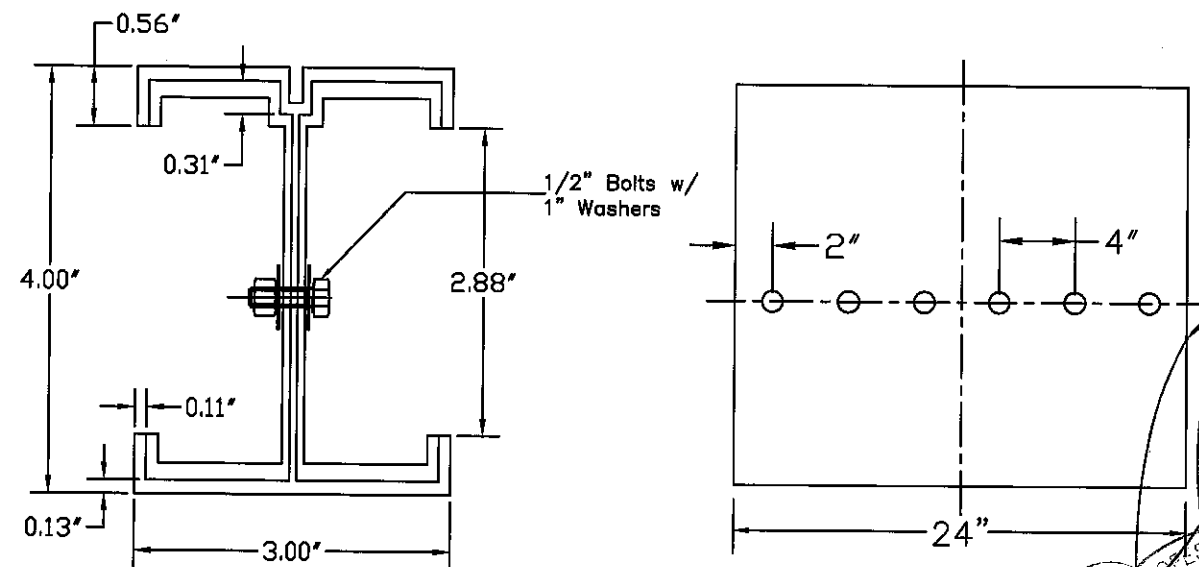



X 4"X3" I BEAM FULL STRENGTH  
SPLICE BOLT LAYOUT  
6063-T6 ALUMINUM ALLOY

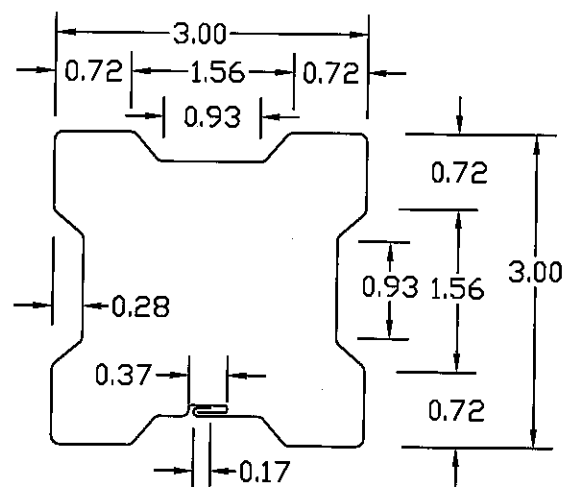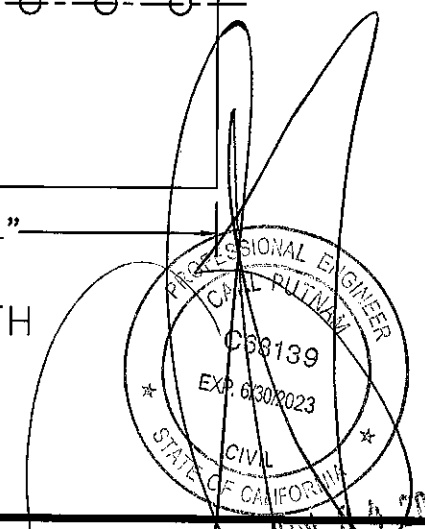


t = 0.041"

W 3"x3" CLOVERLEAF HEADER  
(A-653 Fy=40 KSI STEEL)

Y 4"x3" I BEAM  
6063-T6 ALUM

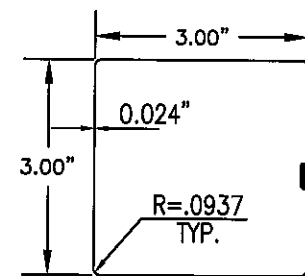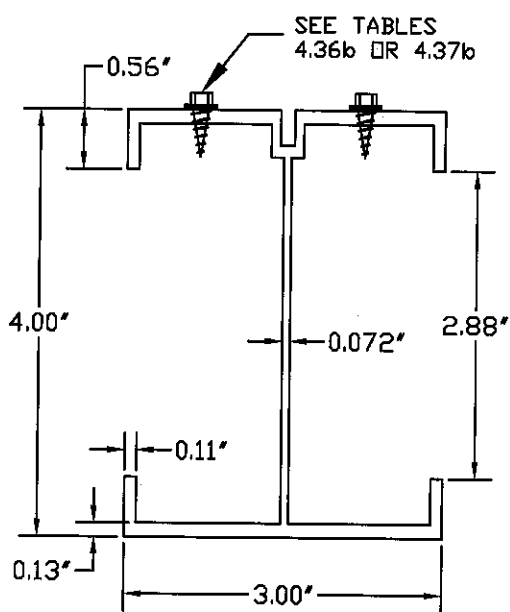


Z 3" SQUARE POST  
(3004-H34 ALUM. ALLOY)


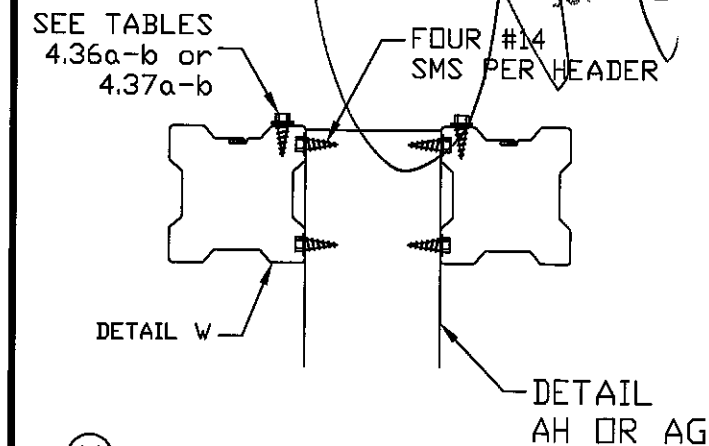


AA SINGLE OR DOUBLE STEEL  
CLOVERLEAF HEADER ASTM A653  
GRADE 40




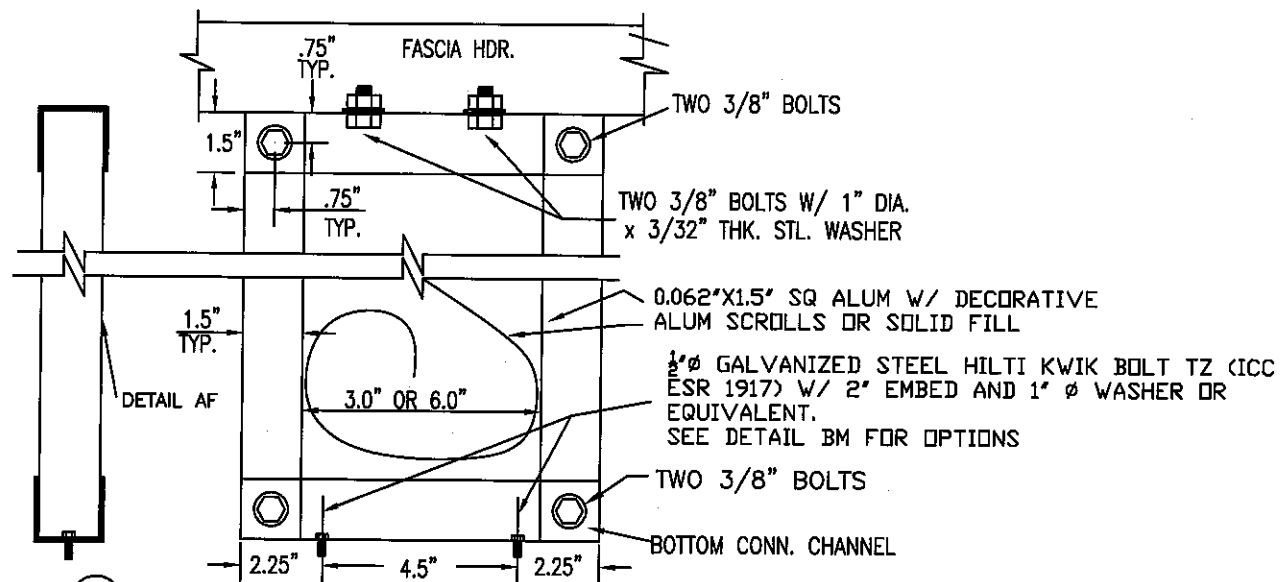


AC SCROLL POST CONNECTION TO CONCRETE SLAB OR FOOTING BRACKET = 6063 T6 ALUM ALLOY  
POST = DETAIL AF  
ONLY USABLE FOR SINGLE SPAN ATTACHED UNITS

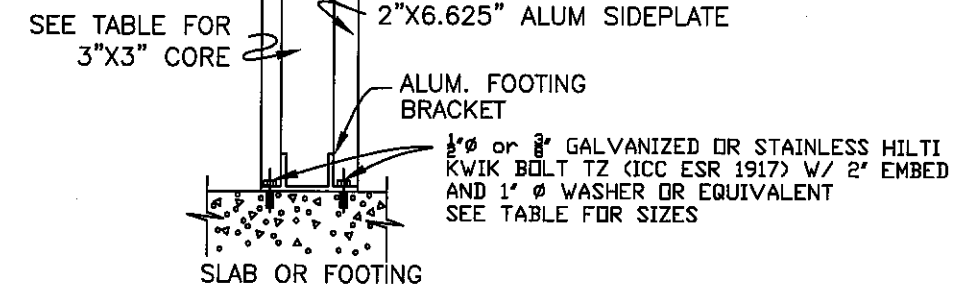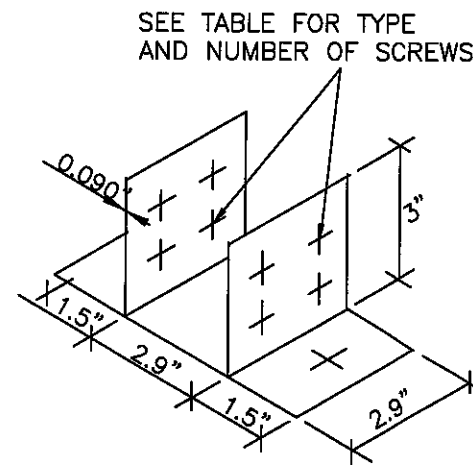


AD ALUMINUM FOOTING BRACKET FOR CONNECTING TO CONCRETE SLAB OR FOOTING  
6063 T6 ALUM ALLOY  
ONLY USABLE FOR SINGLE SPAN ATTACHED UNITS


Footing d (in)	Number Of #14 SMS	3"x3" Post	Concrete Anchors	Maximum Wind Condition for "On Slab" Attachment
26	8	0.024" Alum	3/8"	110 mph Exp B
29	8	0.032" Alum	3/8"	105 mph Exp C / 130 mph Exp B
30	12	0.024" Alum	1/2"	115 mph Exp C
33	12	0.032" Alum	1/2"	130 mph Exp C
33	8	0.041" Steel	1/2"	150 mph Exp C

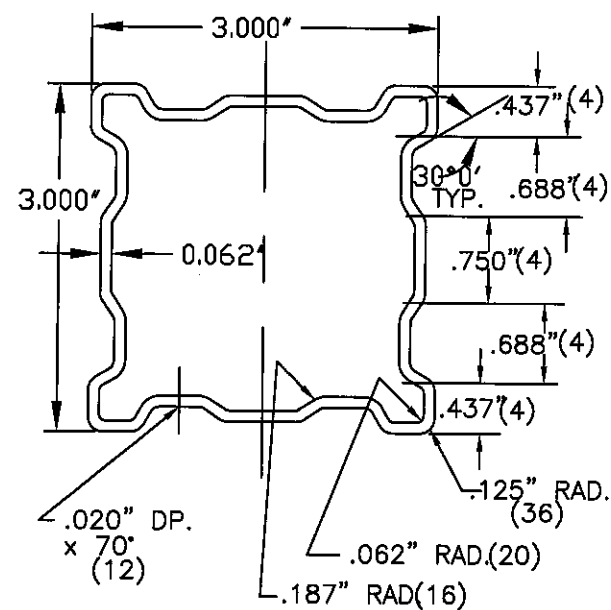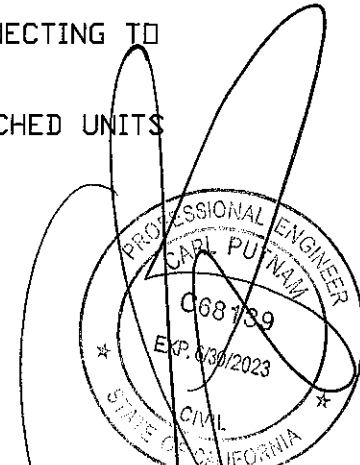


AE COLONIAL POSTS  
(3" ALUM. 6063-T6)  
"t" = 0.062" UNLESS OTHERWISE NOTED

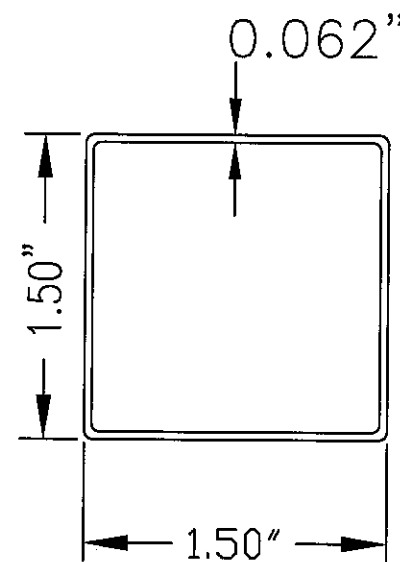

AF TWIN 1.5" SQ. X .062" EXTRUDED POST  
(ALUM. 6063-T6)

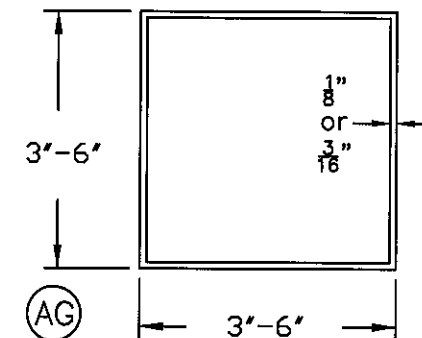


AG 3', 4', 5' or 6' ASTM A500 GRADE B STEEL POST  
SEE GENERAL NOTE #9 FOR CORROSION PROTECTION

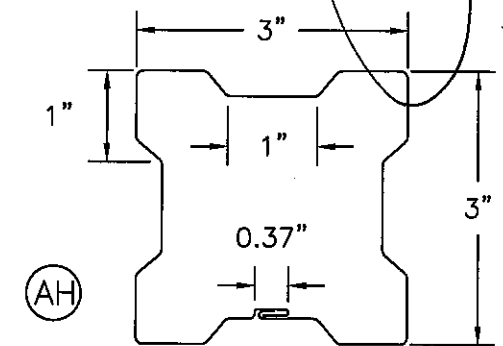

AH t (IN) = 0.030, 0.040 (ALUM)  
= 0.041 (STEEL)



3" CLOVERLEAF POST  
(3105 H25 ALUM OR ASTM A653 GRADE 40 STEEL)

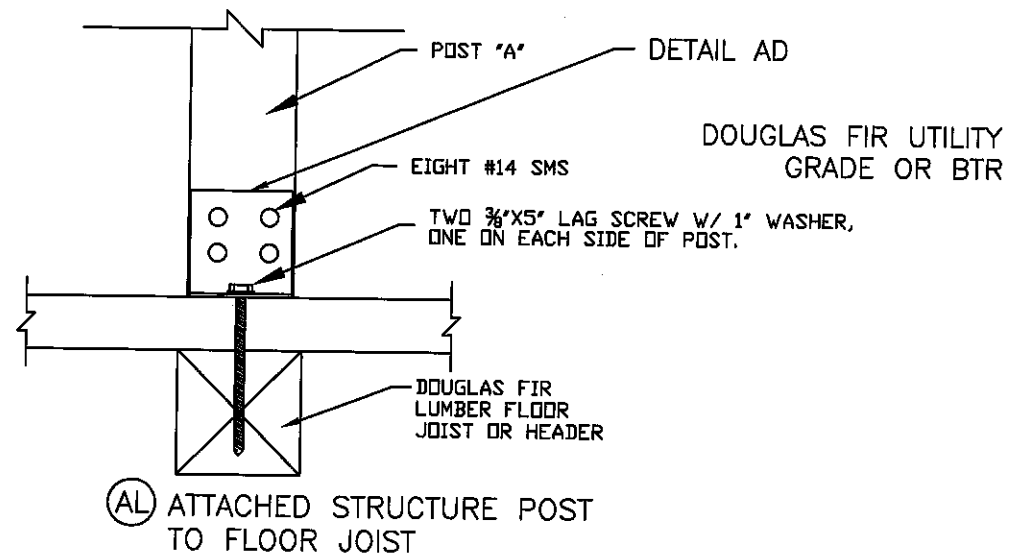

POST SPACING IS RESTRICTED TO THE 'ON SLAB' SPACING SHOWN IN TABLES IN SECTION 5.0.


SOLID COVERS MUST USE THESE RESTRICTIONS  
 FOR 10 PSF SNOW/LIVE LOAD  
 MAXIMUM WINDSPEED IS  
 130 MPH EXP B  
 110 MPH EXP C

FOR 20 PSF OR GREATER SNOW/LIVE LOAD  
 MAXIMUM WINDSPEED IS  
 150 MPH EXP C

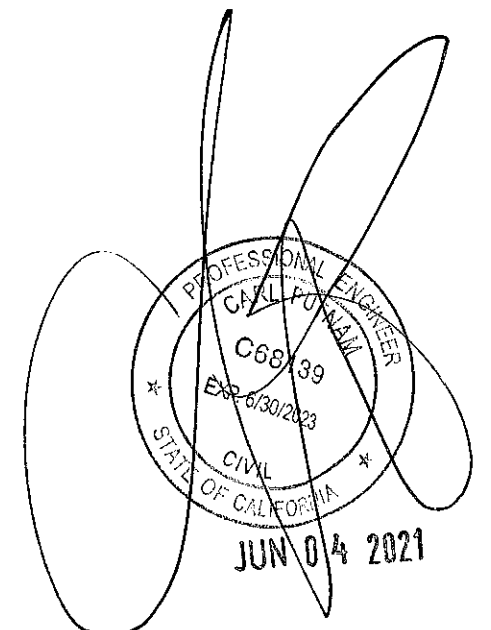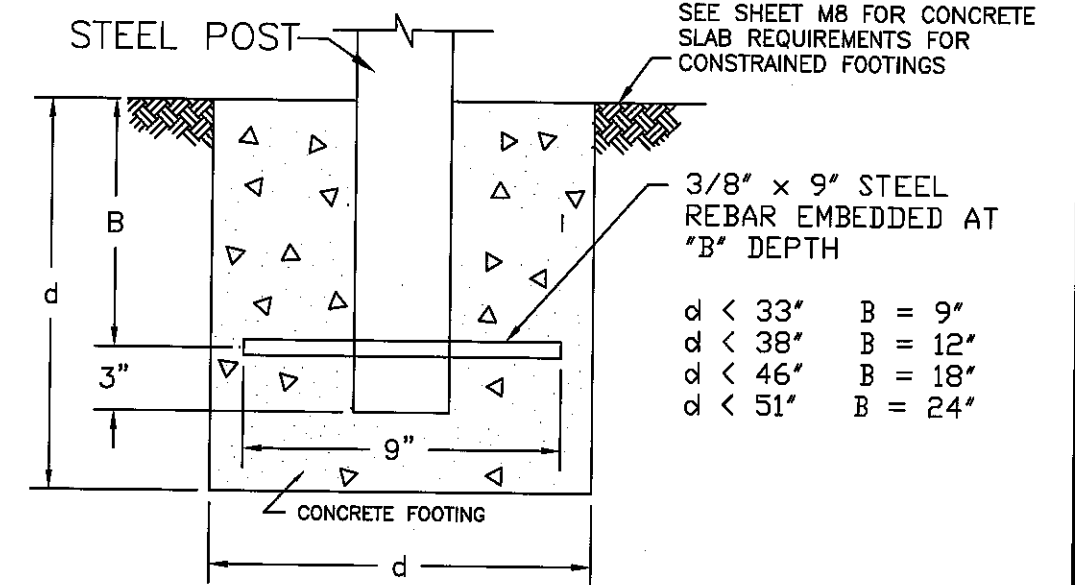


<b>Amerimax</b>		28921 US Hwy 74	
EXTERIOR HOME PRODUCTS		Romoland, CA 92585	
DRAWN BY: BEJ/CP	TYPE:		
SCALE: NTS	NAME: Component Parts & Connection Details		
DATE:	FILE: CD06-2018	SHEET: 6 of 9	

3/8" BOLTS W/ 1.0" DIA. x 3/32" THK. STL. WASHER OR #14 SDS. SEE NOTE FOR QTY (4 FASTENERS MAX).

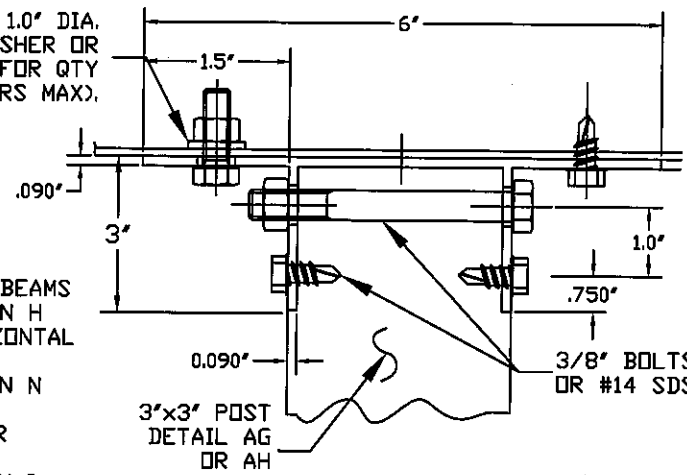


ALL "I" BEAMS & "C" BEAMS USE TABLE 7.3 COLUMN H FOR NUMBER OF HORIZONTAL BOLTS  
USE TABLE 7.4 COLUMN N FOR VERTICAL BOLTS  
USE 7.3 COLUMN I FOR HORIZONTAL #14 SDS  
USE TABLE 7.4 COLUMN I FOR VERTICAL #14 SDS  
(SDS= SELF DRILLING SCREW)

(AR) ALTERNATE 3" SQ. POST CONNECTOR BRACKET (6063-T6 ALUM. ALLOY)


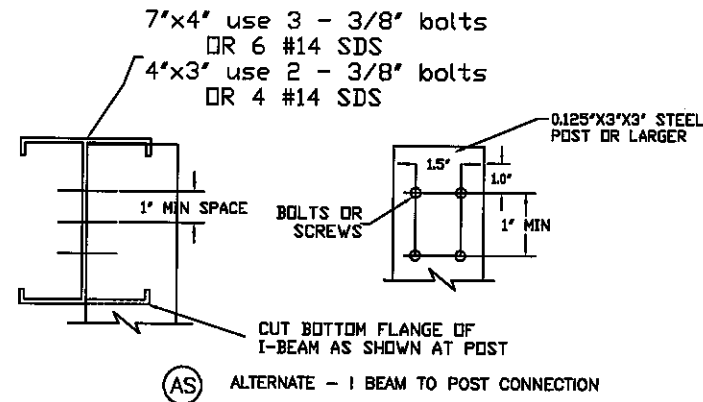


(AS) ALTERNATE - I BEAM TO POST CONNECTION


FOUR #14 SMS EACH SIDE

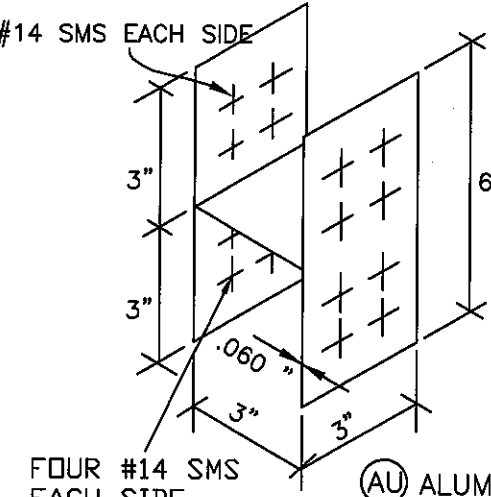


(AU) ALUMINUM 'H' BRACKET FOR CONNECTING COLUMN TO HEADER (6063-T5 ALUM. ALLOY)

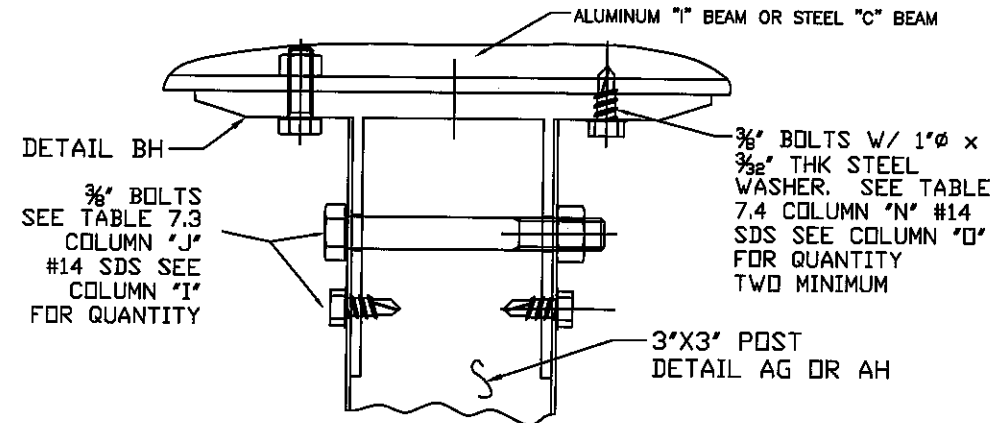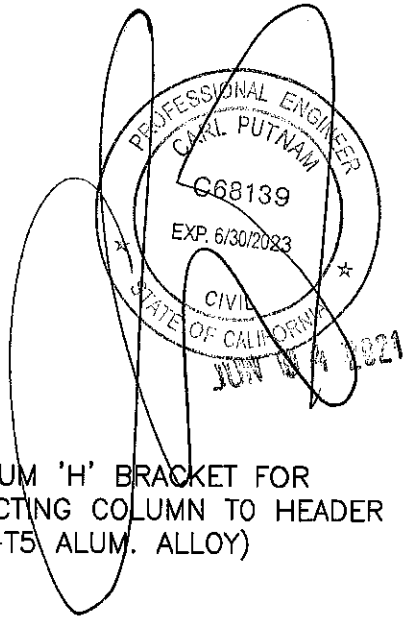

(AT) 3" STEEL POST TO HEADER CONN. BRACKET

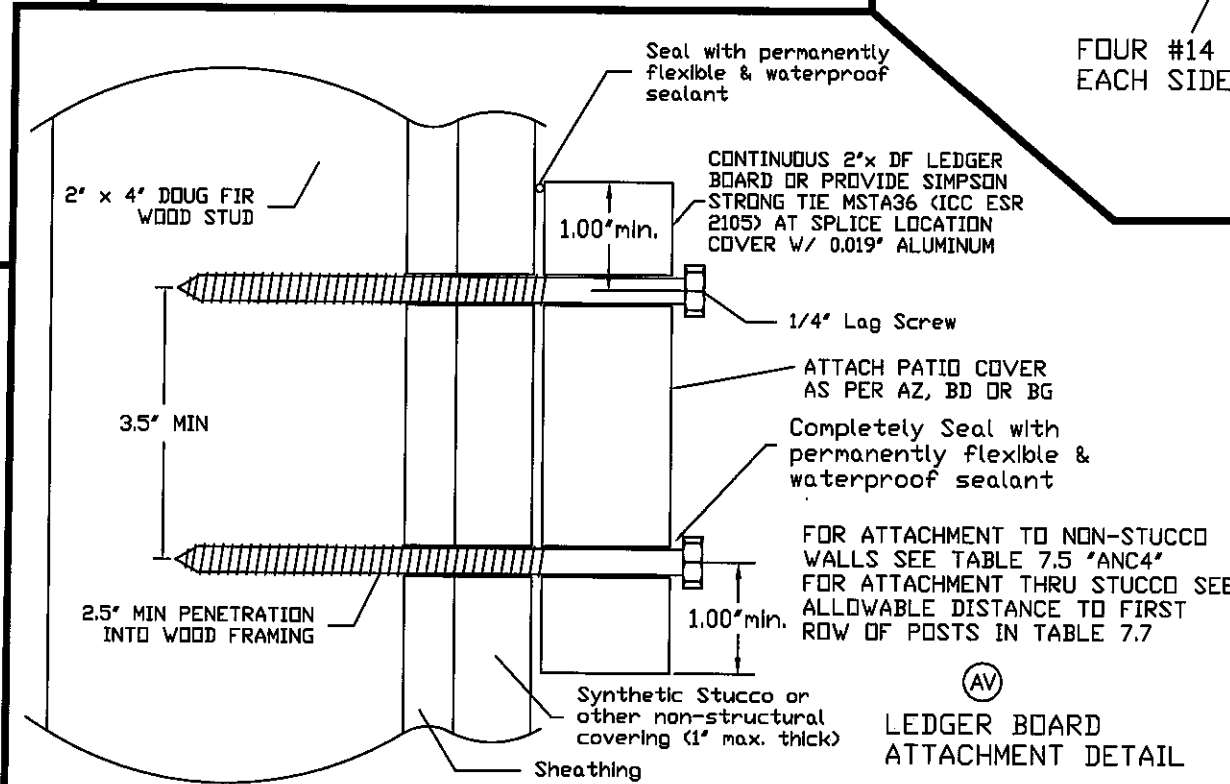


(AV) LEDGER BOARD ATTACHMENT DETAIL

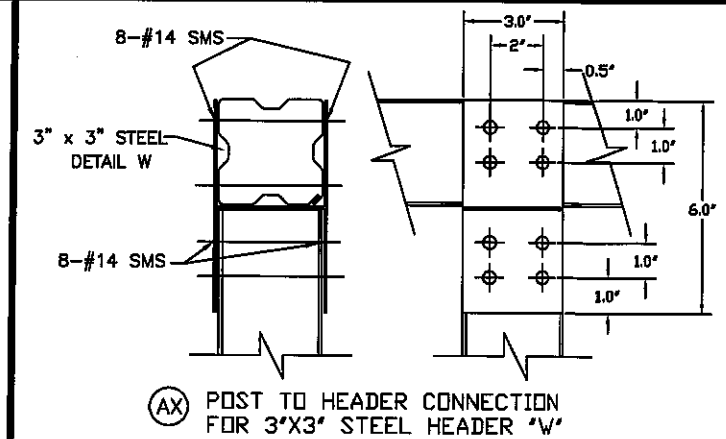


(AX) POST TO HEADER CONNECTION FOR 3"X3" STEEL HEADER 'W'

3"x8" STEEL C BEAM W/ 0.042"x3"x8" ALUM WRAP

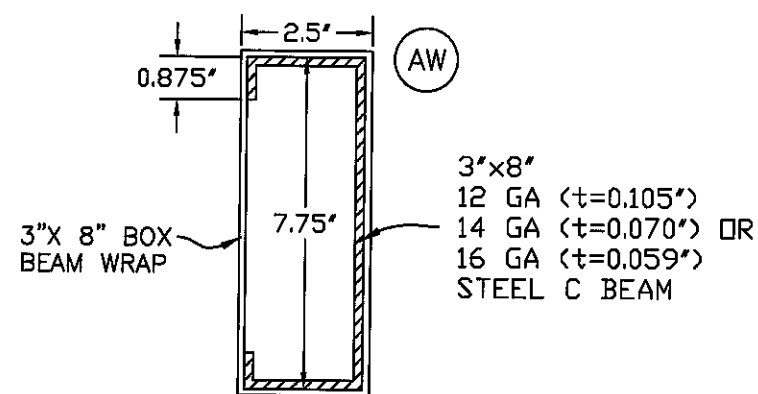

1/4" BOLTS ASTM A307 OR #14 SELF DRILLING SCREWS (SDS) SEE TABLE FOR QTY

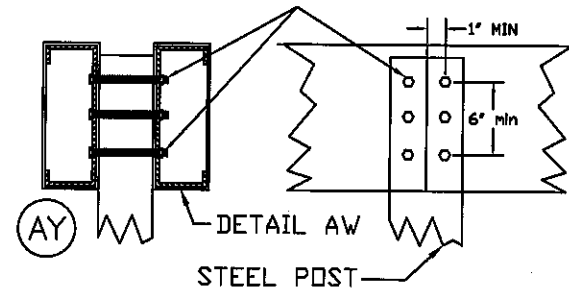


(AY) DOUBLE OR SINGLE 3"x8" STEEL C BEAM. BOLT LAYOUT FOR SPLICED AND NON-SPLICE ATTACHMENT

Required # of 1/4" Bolts (# of 14 Self Drilling Screws)



Beam Type	Ground Snow Load 60 psf	Required # of 1/4" Bolts (# of 14 Self Drilling Screws)				
		115 mph Exp C 20 psf (Live)	105 mph Exp B 20 psf (Live)	170 mph Exp C 10 psf (Live)	130 mph Exp C 10 psf (Live)	105 mph Exp B 10 psf (Live)
All C Beams "On Slab"	4 (4)	4 (4)	4 (4)	4 (4)	4 (4)	4 (4)
16G and 14G Steel 3x8	4 (4)	4 (4)	4 (4)	4 (4)	4 (4)	4 (4)
12G Steel 3x8	6 (8)	6 (8)	6 (8)	6 (8)	6 (8)	6 (8)
Double 16G Steel 3x8	4 (12)	4 (10)	4 (10)	4 (10)	4 (10)	4 (10)
Double 14G Steel 3x8	5 (14)	5 (12)	5 (12)	5 (12)	5 (12)	4 (10)
Double 12G Steel 3x8	7 (18)	6 (16)	6 (14)	6 (16)	6 (14)	(5) 14

**Amerimax** 28921 US Hwy 74  
EXTERIOR HOME PRODUCTS Romoland, CA 92585


DRAWN BY: BEJ/CP	TYPE:
SCALE: NTS	NAME: Component Parts & Connection Details
DATE:	FILE: CD07-2018
	SHEET: 7 of 9

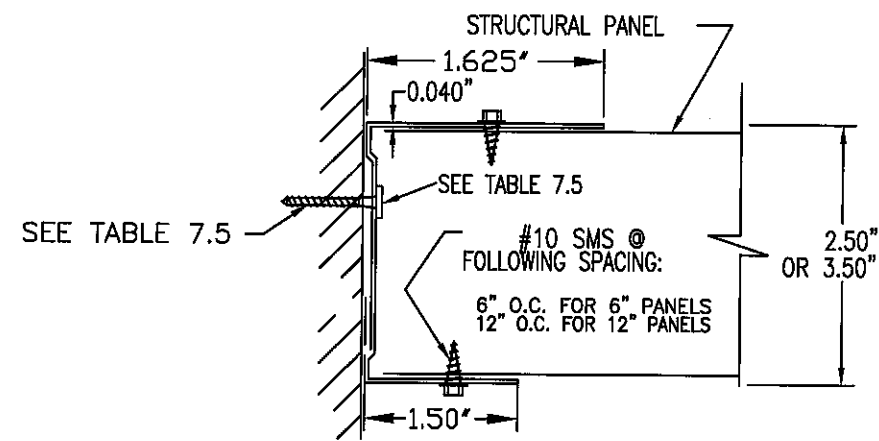



ⒶZ ROLLFORMED HANGER (3004-H34 ALUM. ALLOY)

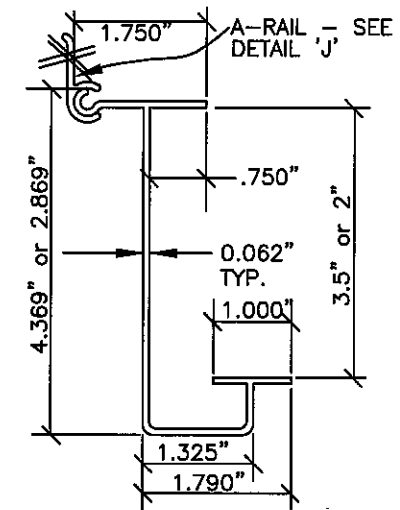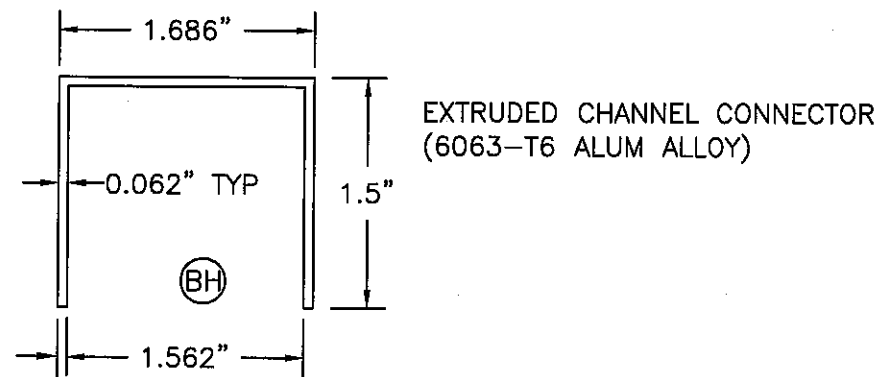



ⒷB 3 1/2" "J" HANGER (6063-T6 ALUM. ALLOY)

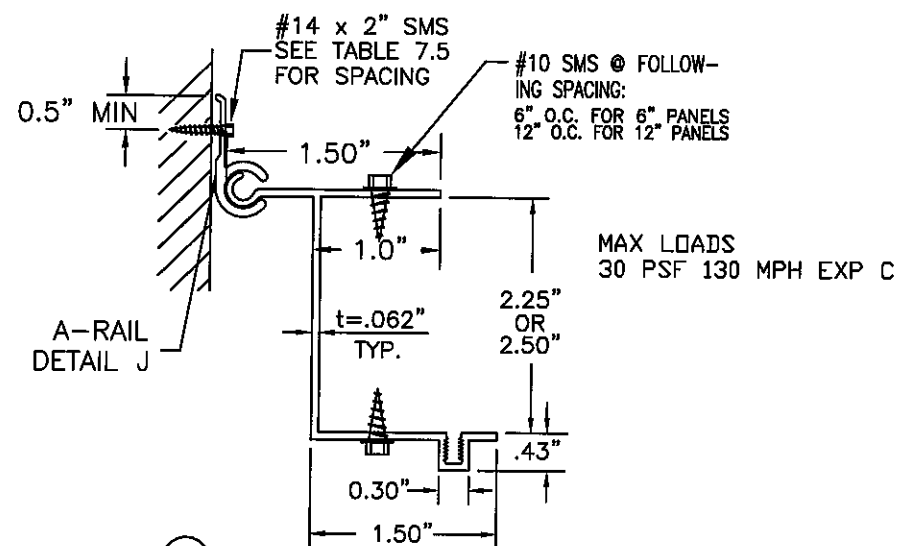

ⒷD EXTRUDED HANGER (6063-T6 ALUM. ALLOY)

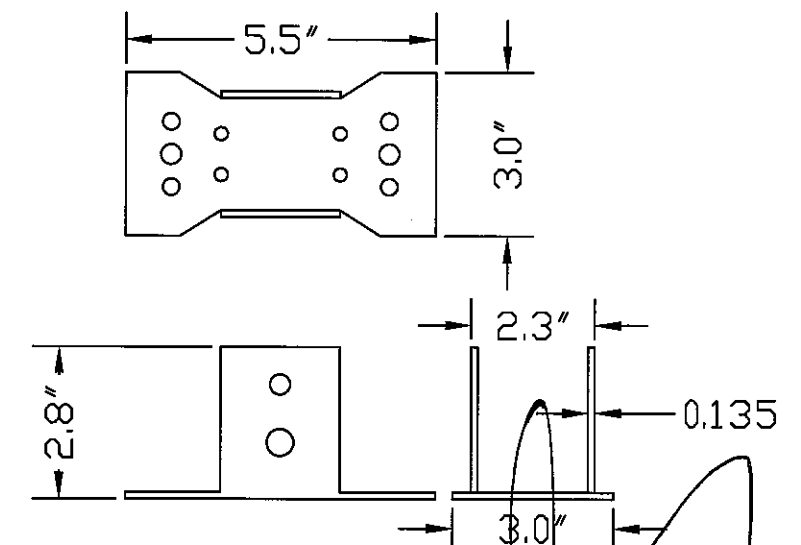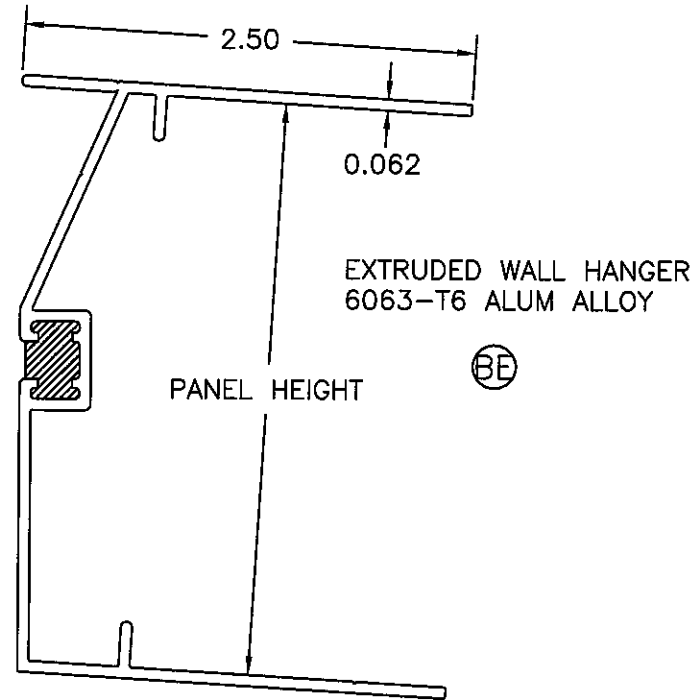

ⒷH ASTM A36 STEEL BRACKET

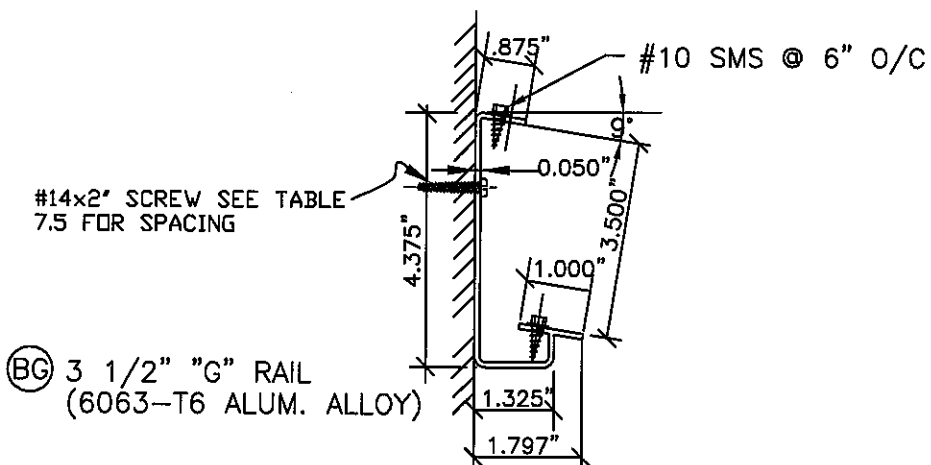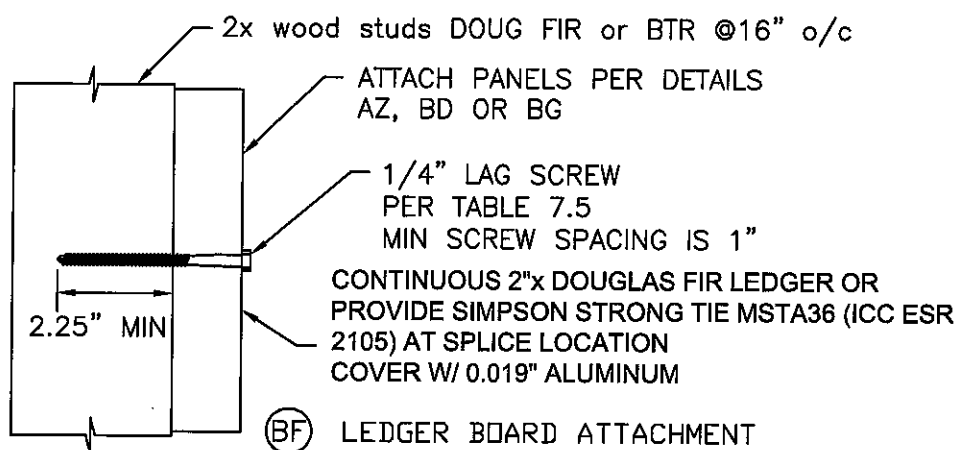


PROFESSIONAL ENGINEER  
CARL PUTNAM  
C68799  
EXP. 6/30/2023  
CIVIL  
STATE OF CALIFORNIA

JUN 04 2021

**Amerimax** 28921 US Hwy 74  
EXTERIOR HOME PRODUCTS Romoland, CA 92585


DRAWN BY: BEJ/CP	TYPE:
SCALE: NTS	NAME: Component Parts & Connection Details
DATE:	FILE: CD08-2018
	SHEET: 8 of 9



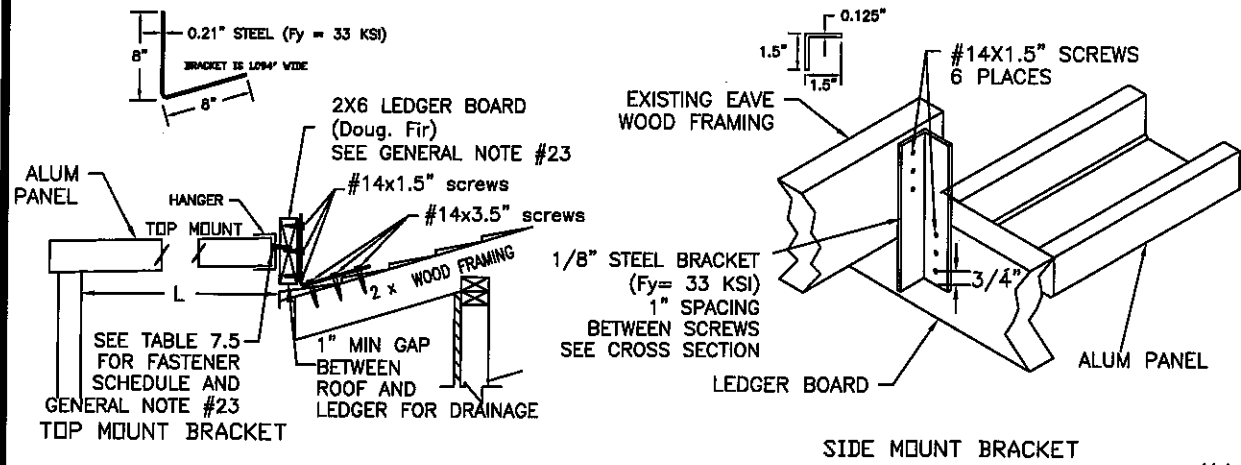


Live Load (psf)	Wind Speed and Exposure	MAX "L" FOR TOP OR SIDE MOUNT	
		16" o/c	24" o/c
10	115 mph Exp B	15'-2"	10'-1"
	130 mph Exp B	13'-7"	9'-1"
	100 mph Exp C	15'-2"	10'-1"
	110 mph Exp C	14'-7"	9'-8"
	115 mph Exp C	13'-10"	9'-3"
20	130 mph Exp C	12'-2"	8'-2"
	115 mph Exp B	10'-3"	6'-9"
	100 mph Exp C	10'-3"	6'-9"
	110 mph Exp C	10'-0"	6'-8"
115 mph Exp C	115 mph Exp C	9'-8"	6'-6"
	130 mph Exp C	8'-9"	5'-10"



ALL HOUSE PENETRATIONS MUST BE COMPLETELY AND PERMANENTLY SEALED NOT ALLOWED IN SNOW LOAD AREAS SEE GENERAL NOTE #9 FOR CORROSION PROTECTION

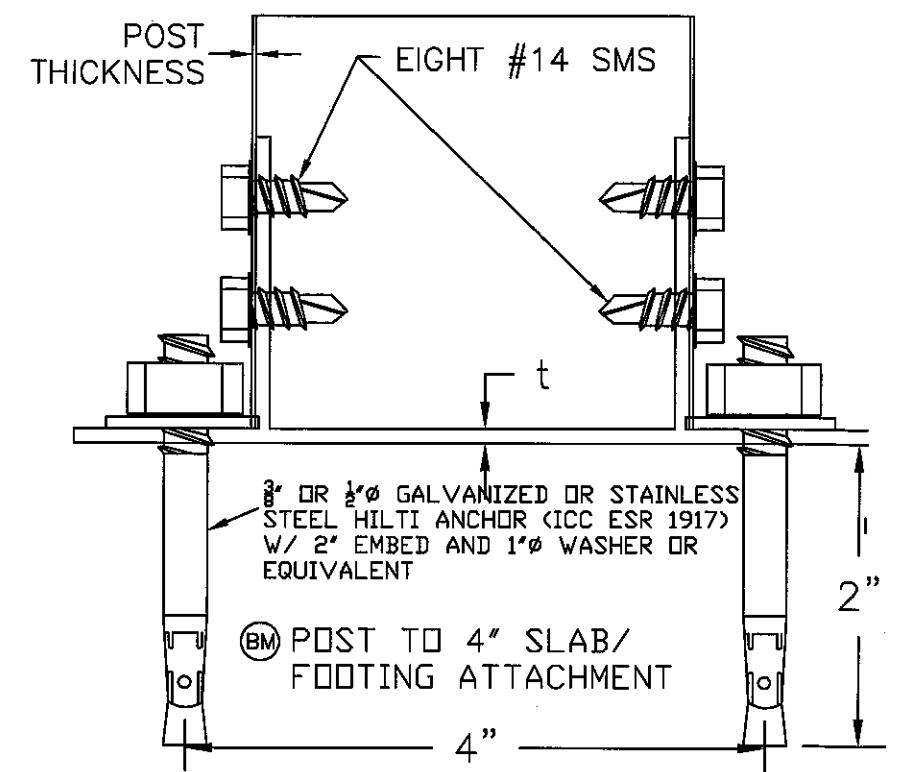

6063T6 ALUMINUM BRACKET OR ASTM A36 STEEL  
 t = 0.090" >> SLAB ATTACH FOR 130 EXP B/115 MPH EXP C  
 t = 0.090" >> FOOTING d = 31" MAX  
 t = 0.140" >> FOOTING d = 35" MAX WITH DETAIL AH STEEL POST  
 t = 0.140" >> SLAB ATTACH FOR 140 EXP C

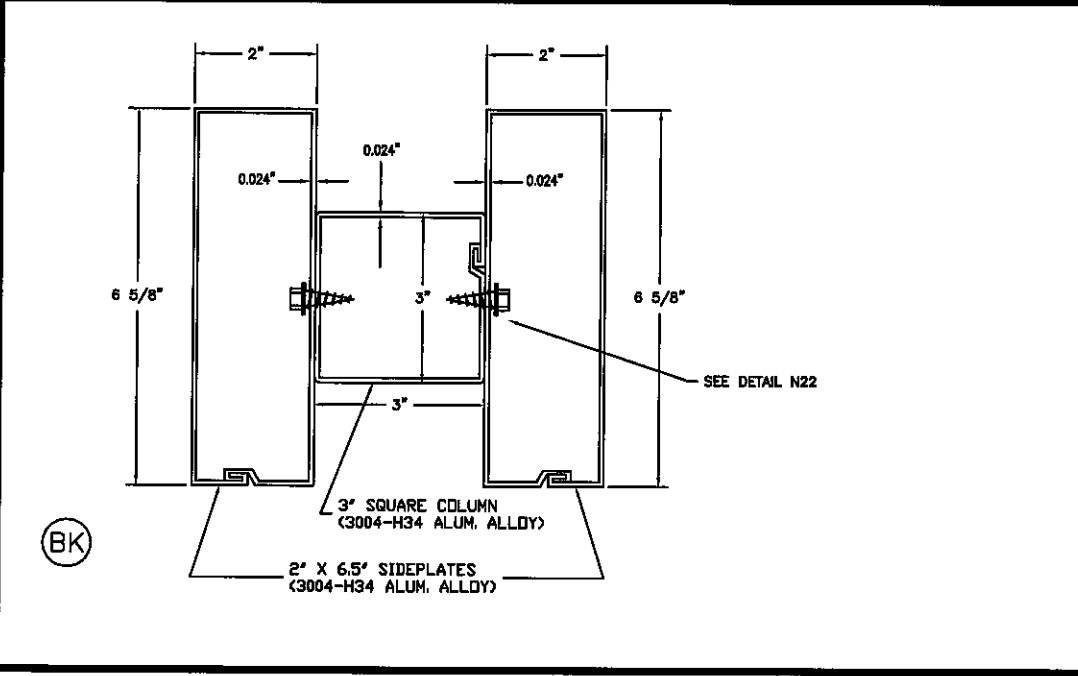


Live/Snow Load Solid Cover Wind (psf)	RAFTER SIZE (24" O/C)	MAX DISTANCE TO FIRST ROW OF POSTS "L"					# of #14 Screws
		6"	12"	18"	24"	30"	
10	2x4	21'-0"	20'-5"	11'-8"	6'-4"	2'-10"	2
	2x6	21'-0"	21'-0"	21'-0"	21'-0"	16'-3"	
	2x8	21'-0"	21'-0"	21'-0"	21'-0"	21'-0"	
115 MPH EXP B	2x4	21'-0"	20'-3"	11'-5"	6'-4"	2'-9"	2
	2x6	21'-0"	21'-0"	21'-0"	21'-0"	16'-2"	
	2x8	21'-0"	21'-0"	21'-0"	21'-0"	21'-0"	
10	2x4	21'-0"	17'-8"	9'-11"	5'-6"	2'-5"	3
	2x6	21'-0"	21'-0"	21'-0"	20'-1"	14'-1"	
	2x8	21'-0"	21'-0"	21'-0"	21'-0"	21'-0"	
130 MPH EXP C	2x4	16'-0"	10'-2"	5'-9"	3'-2"	1'-5"	3
	2x6	16'-0"	16'-0"	16'-0"	11'-7"	8'-1"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
20	2x4	16'-0"	10'-2"	5'-9"	3'-2"	1'-5"	3
	2x6	16'-0"	16'-0"	16'-0"	11'-7"	8'-1"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
115 MPH EXP C	2x4	16'-0"	10'-2"	5'-9"	3'-2"	1'-5"	3
	2x6	16'-0"	16'-0"	16'-0"	11'-7"	8'-1"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
20	2x4	16'-0"	10'-2"	5'-9"	3'-2"	1'-5"	3
	2x6	16'-0"	16'-0"	16'-0"	11'-7"	8'-1"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
130 MPH EXP C	2x4	16'-0"	10'-2"	5'-9"	3'-2"	1'-5"	3
	2x6	16'-0"	16'-0"	16'-0"	11'-7"	8'-1"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
25	2x4	16'-0"	11'-2"	6'-3"	3'-6"	1'-6"	3
	2x6	16'-0"	16'-0"	16'-0"	12'-8"	8'-10"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
110 MPH EXP C	2x4	16'-0"	11'-2"	6'-3"	3'-6"	1'-6"	3
	2x6	16'-0"	16'-0"	16'-0"	12'-8"	8'-10"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
25	2x4	16'-0"	11'-2"	6'-3"	3'-6"	1'-6"	3
	2x6	16'-0"	16'-0"	16'-0"	12'-8"	8'-10"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
130 MPH EXP C	2x4	16'-0"	11'-2"	6'-3"	3'-6"	1'-6"	3
	2x6	16'-0"	16'-0"	16'-0"	12'-8"	8'-10"	
	2x8	16'-0"	16'-0"	16'-0"	16'-0"	16'-0"	
30	2x4	15'-0"	9'-2"	5'-1"	2'-9"	1'-0"	4
	2x6	15'-0"	15'-0"	15'-0"	10'-5"	7'-2"	
	2x8	15'-0"	15'-0"	15'-0"	15'-0"	14'-9"	
130 MPH EXP C	2x4	15'-0"	7'-7"	4'-0"	1'-11"	0'-6"	4
	2x6	15'-0"	15'-0"	12'-8"	8'-5"	5'-7"	
	2x8	15'-0"	15'-0"	15'-0"	15'-0"	12'-0"	
42	2x4	14'-0"	8'-3"	3'-2"	1'-4"	0'-0"	4
	2x6	14'-0"	14'-0"	10'-6"	6'-10"	4'-5"	
	2x8	14'-0"	14'-0"	14'-0"	13'-8"	9'-10"	
130 MPH EXP C	2x4	12'-0"	5'-1"	2'-5"	0'-10"	0'-0"	4
	2x6	13'-0"	13'-0"	8'-7"	5'-5"	3'-3"	
	2x8	13'-0"	13'-0"	13'-0"	11'-1"	7'-10"	
50	2x4	12'-0"	5'-1"	2'-5"	0'-10"	0'-0"	4
	2x6	13'-0"	13'-0"	8'-7"	5'-5"	3'-3"	
	2x8	13'-0"	13'-0"	13'-0"	11'-1"	7'-10"	
130 MPH EXP C	2x4	9'-11"	4'-1"	1'-9"	0'-4"	0'-0"	4
	2x6	12'-0"	11'-9"	6'-11"	4'-2"	2'-4"	
	2x8	12'-0"	12'-0"	12'-0"	8'-11"	6'-1"	

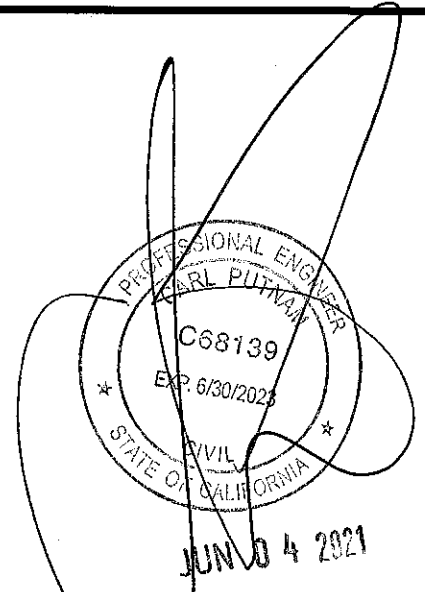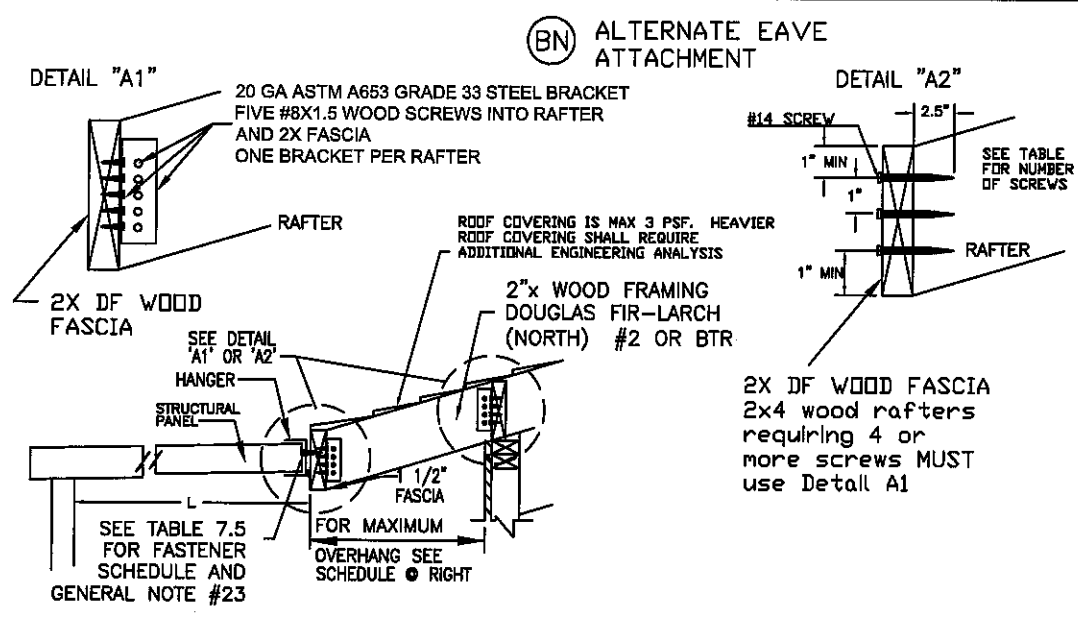


**Amerimax** 28921 US Hwy 74  
 EXTERIOR HOME PRODUCTS Romoland, CA 92585




DRAWN BY: BEJ/CP TYPE:  
 SCALE: NTS NAME: Component Parts & Connection Details  
 DATE: FILE#: CD09-2018 SHEET: 9 of 9

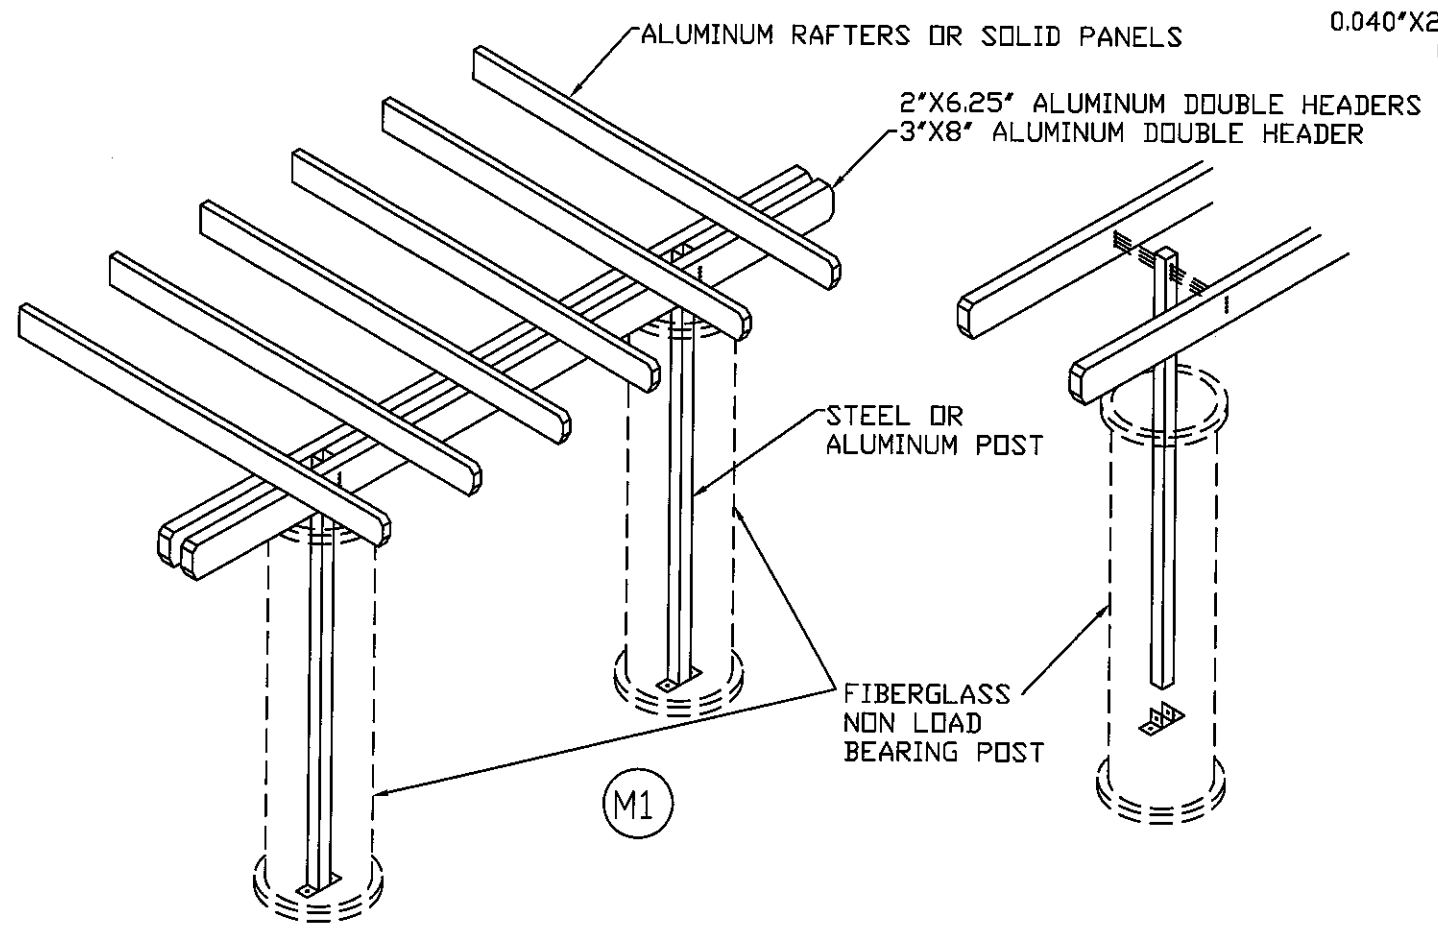

0.040\"X2\"X6.625\" ALUM HEADERS OR  
0.042\"X3\"X8\" ALUM HEADERS

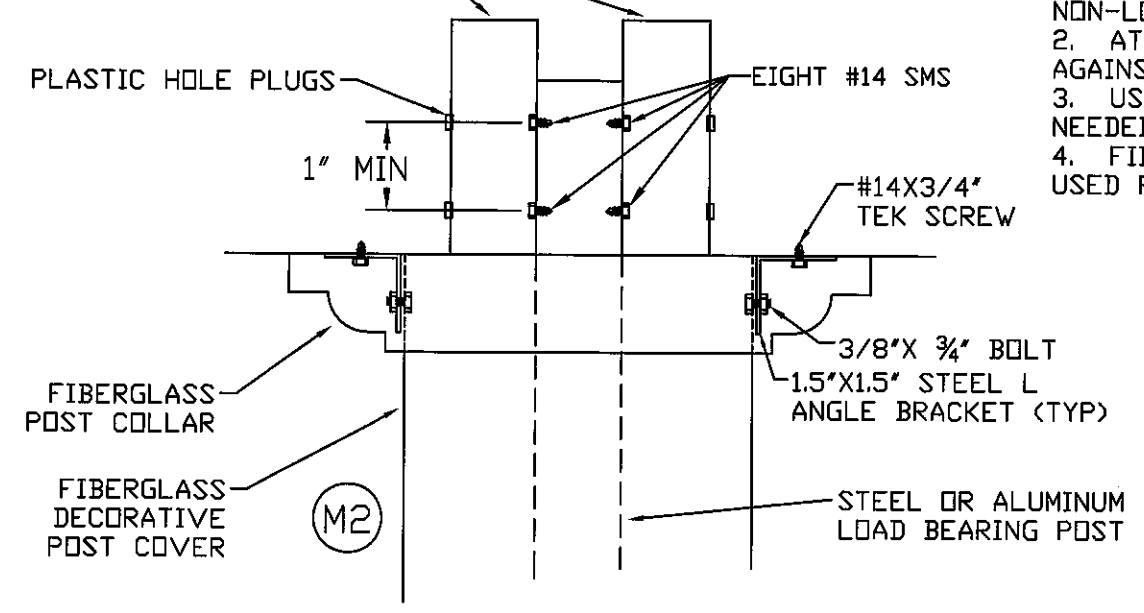

- NOTES:
1. FIBERGLASS POSTS ARE NON-LOAD BEARING.
  2. ATTACHMENT TO HOLD COVERING AGAINST MINOR LATERAL FORCES.
  3. USE MULTIPLE BRACKETS AS NEEDED.
  4. FIBERGLASS POSTS MAY BE USED FOR ANY STRUCTURE.

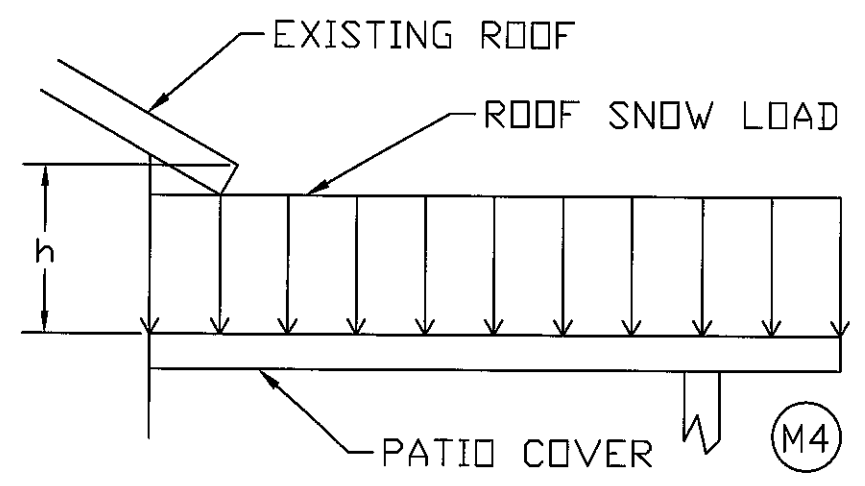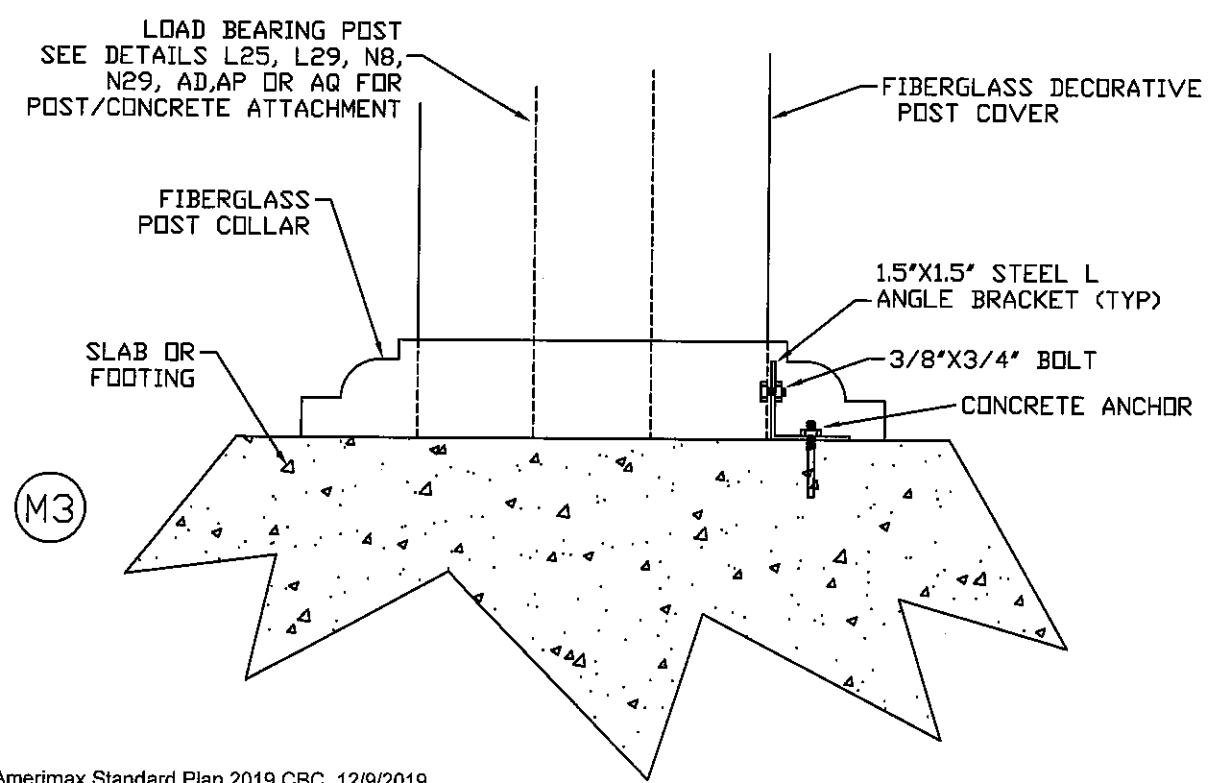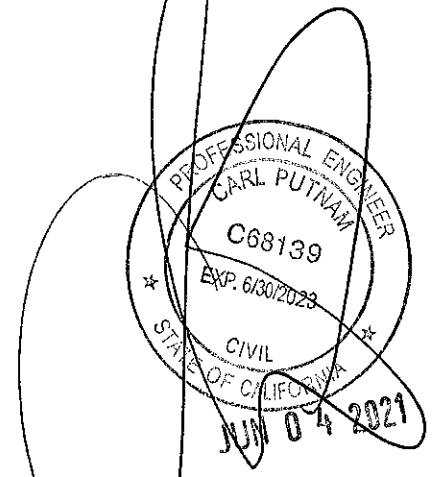


STRUCTURES COMPLYING WITH THIS DETAIL DO NOT REQUIRE ADDITIONAL DRIFTING SNOW CONSIDERATIONS

GROUND SNOW LOAD (PSF)	MAXIMUM "h" (IN)
10	9
15	14
20	17
25	18
30	20
36	23
42	26
50	30
60	33

Engineer's Stamp

**Amerimax**™ 28921 US Hwy 74  
EXTERIOR HOME PRODUCTS Romoland, CA 92585


DRAWN BY: CP	TYPE:
SCALE: NTS	NAME: Miscellaneous Details
DATE:	FILE: Misc1a-2018
SHEET:	

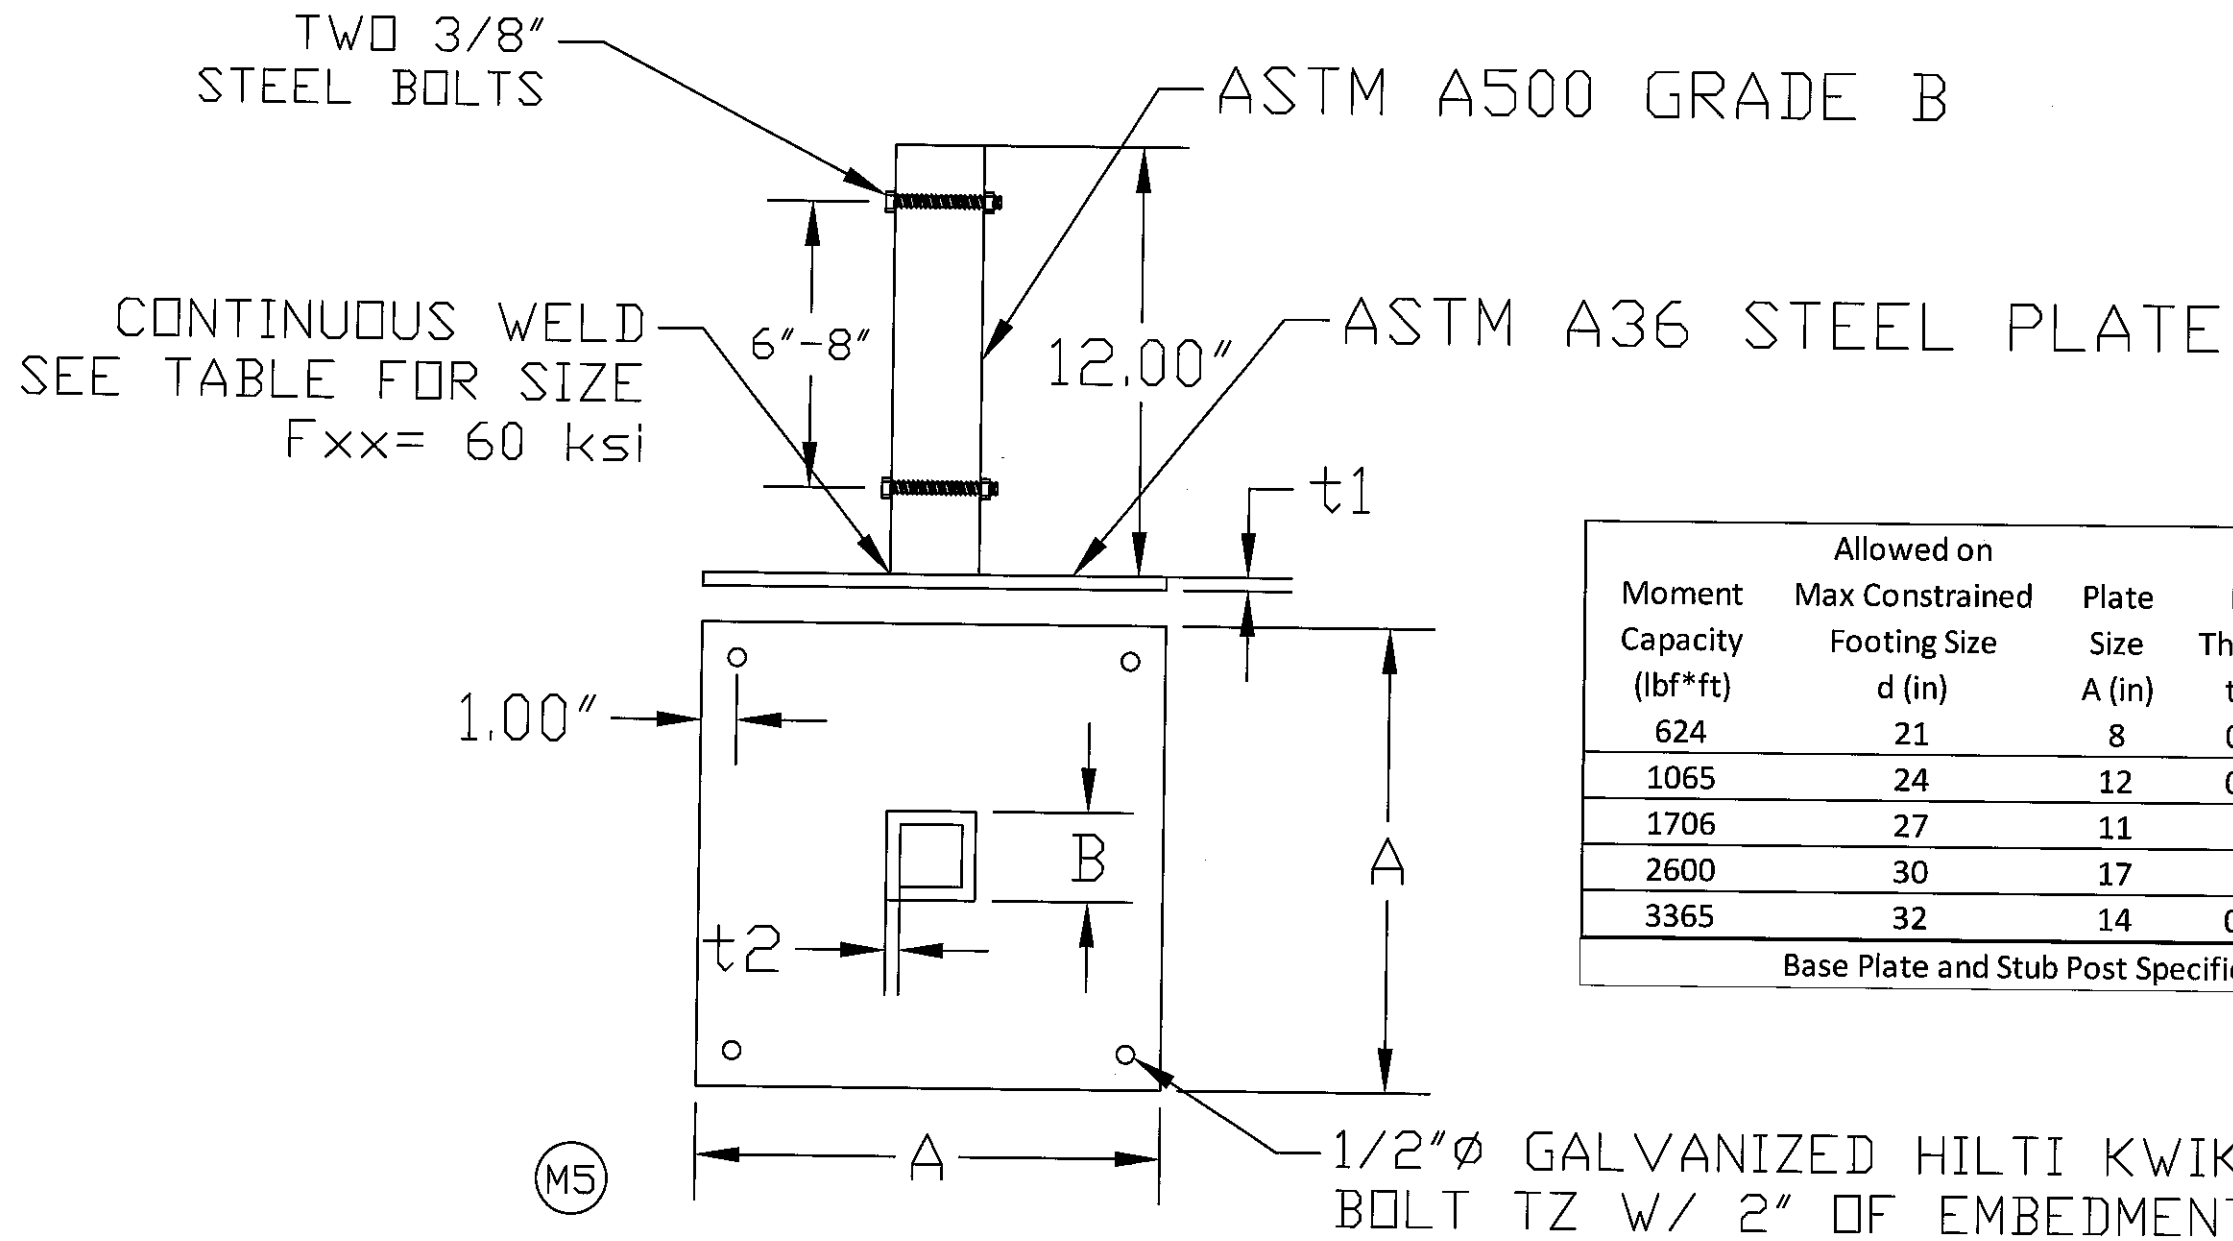

Moment Capacity (lb*ft)	Allowed on		Plate Thickness t1 (in)	Stub Post Size B (in)	Stub Post Size t2 (in)	Minimum Weld Size (in)
	Max Constrained Footing Size d (in)	Plate Size A (in)				
624	21	8	0.375	2.5	0.188	0.125
1065	24	12	0.375	2.5	0.188	0.125
1706	27	11	0.5	2.5	0.188	0.125
2600	30	17	0.5	2.5	0.25	0.188
3365	32	14	0.625	2.5	0.375	0.25




Base Plate and Stub Post Specifications

WELDED MOMENT RESISTING STEEL BASE PLATE  
 ALTERNATIVE TO POST EMBEDMENT IN CONCRETE FOOTING  
 THE WELDED POST BRACKET MUST BE VERIFIED TO  
 COMPLY WITH THE REQUIREMENTS IN DETAIL M5 OF THESE  
 PLANS AND FABRICATED IN ACCORDANCE W/ 2018 IBC  
 SECTION 1704.2.5.1 BY AN APPROVED FABRICATOR TO THE  
 SATISFACTION OF THE CODE OFFICIAL

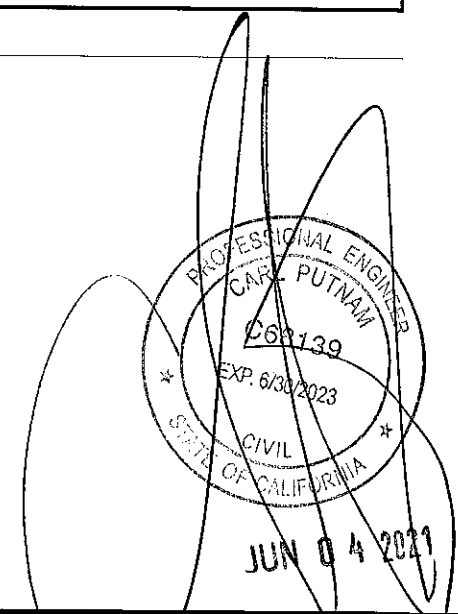


**Amerimax** 28921 US Hwy 74  
 EXTERIOR HOME PRODUCTS Romoland, CA 92585

DRAWN BY: CP	TYPE:
SCALE: NTS	NAME: Miscellaneous Details
DATE:	FILE: Misc1b-2018
SHEET:	

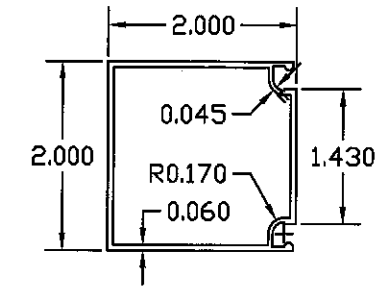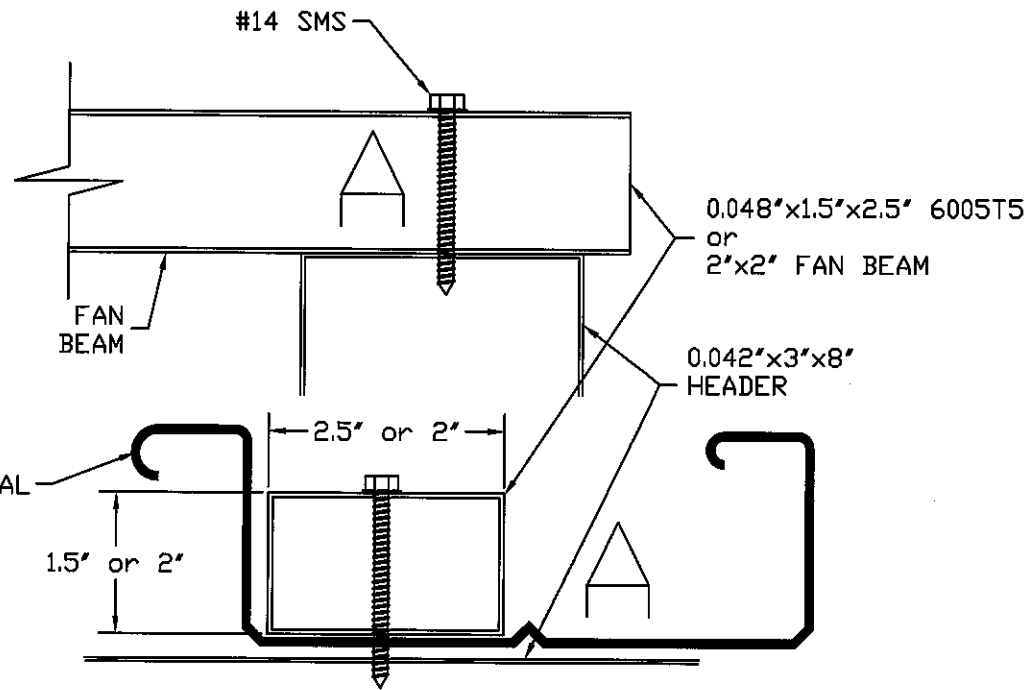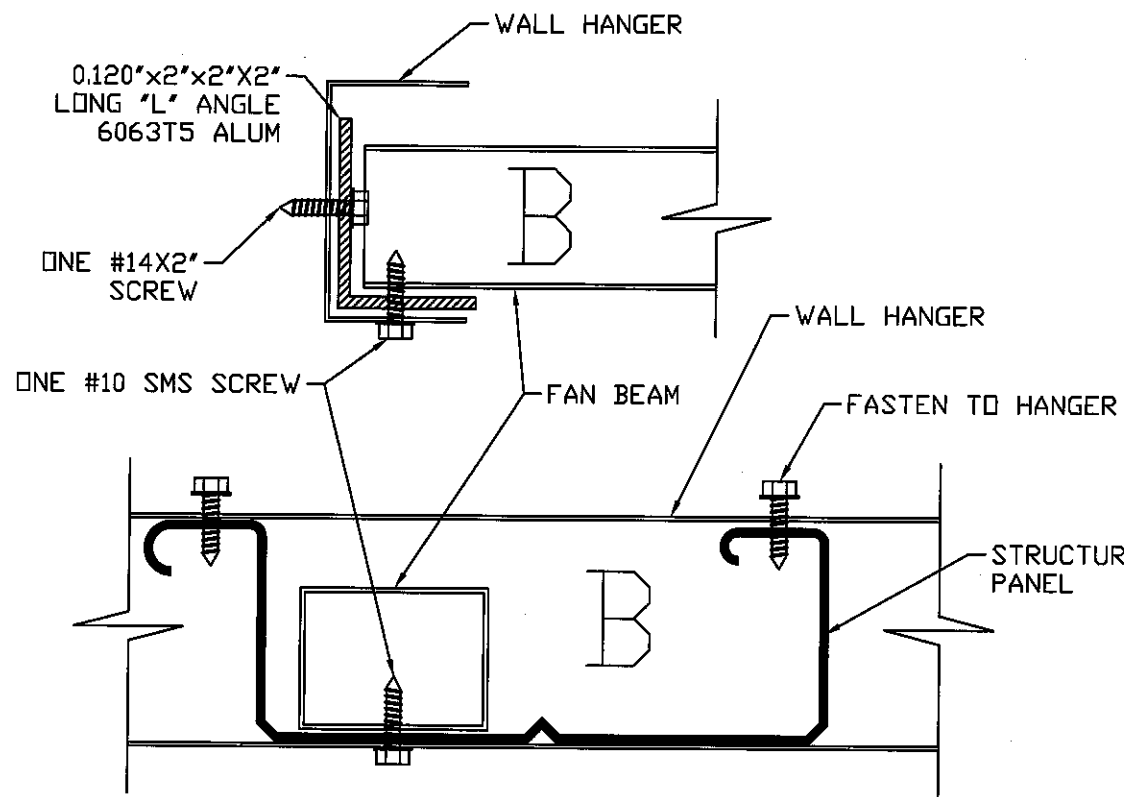


2"X2" FAN BEAM  
6063T5 ALUM  
NO ORIENTATION  
SPECIFIED

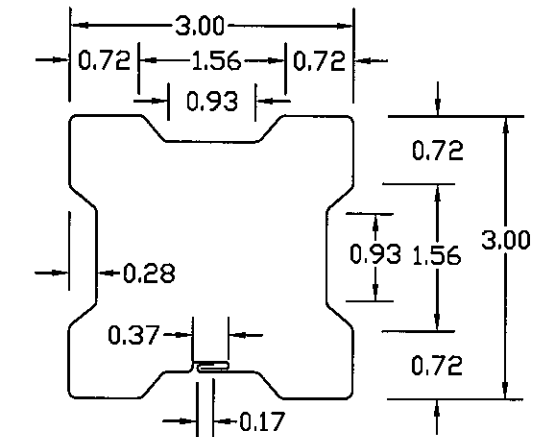


t = 0.041"

3" X 3" CLOVERLEAF HEADER  
(A-653 Fy=40 KSI STEEL)

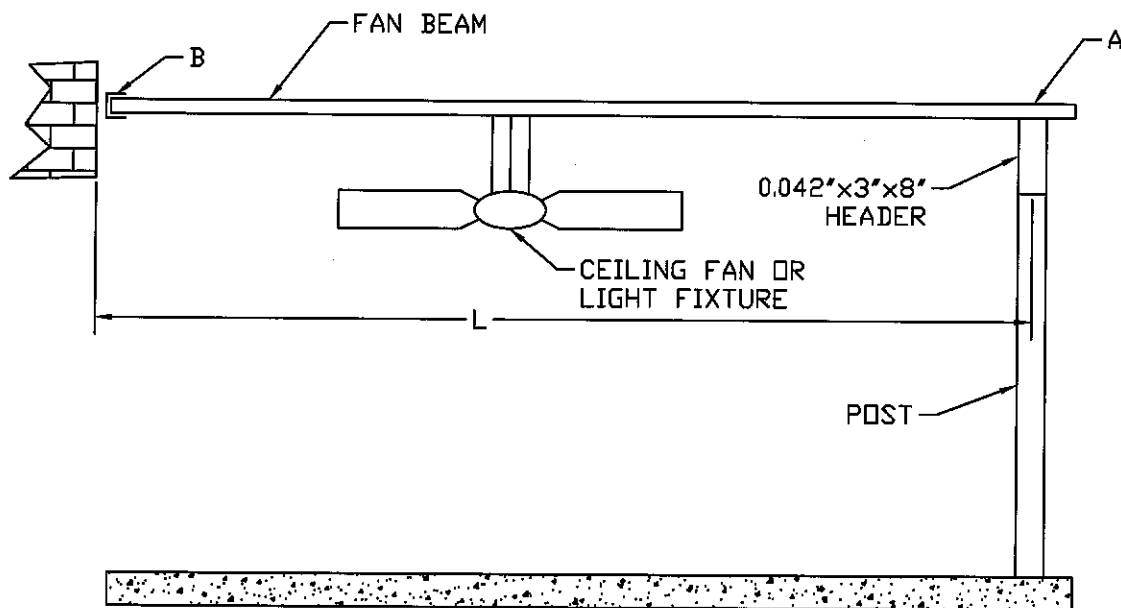

CONFORMANCE TO THE APPLICABLE ELECTRICAL CODE IS OUTSIDE THE SCOPE OF THIS DETAIL AND MUST BE APPROVED SEPERATELY.

Weight of fan/lights	Allowable Fan Beam Spans	
	0.048"x1.5"x2.5"	2"x2" Fan Beam 3x3 Steel Beam
30 lbs	15'-10"	23'

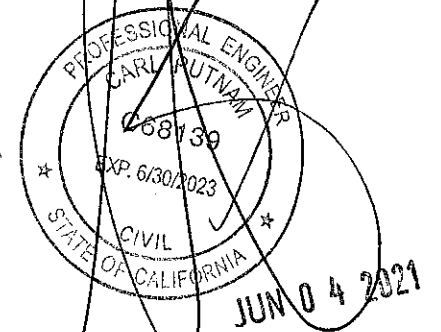

**Amerimax** 28921 US Hwy 74  
EXTERIOR HOME PRODUCTS Romoland, CA 92585

DRAWN BY: CP	TYPE:
SCALE: NTS	NAME: Miscellaneous Details
DATE:	FILE: Misc2-2018
	SHEET:





7.0 ALTERNATIVE FOOTING TABLES (PAGE 1)

CONVERSION TO SQUARE TOP FOOTING

EQUIVALENT UPLIFT AND CONSTRAINED FOOTINGS		For UPLIFT Footings Only								
CONSTRAINED FOOTING (IN)	NON CONSTRAINED FOOTING (IN)	Footings Only								
		Footings Only								
DIAMETER OF CIRCULAR FOOTINGS (IN)		Footings Only								
12" 18" 24" 36"		Footings Only								
DEPTH OF CIRCULAR FOOTINGS (IN)		Footings Only								
14" 15" 16" 17" 18" 19" 20" 21" 22" 23" 24" 25" 26" 27" 28" 29" 30" 31" 32" 33" 34" 35" 36" 37" 38" 39" 40" 41" 42" 43" 44" 45" 46" 47" 48" 49" 50" 51" 52" 53" 54" 55" 56" 57" 58" 59" 60" 61" 62" 63" 64" 65" 66" 67" 68" 69" 70" 71" 72" 73" 74" 75" 76" 77" 78" 79" 80" 81" 82" 83" 84" 85" 86" 87" 88" 89" 90" 91" 92" 93" 94" 95" 96" 97" 98" 99" 100"		Footings Only								
14"	17"	24"	14"	14"	14"	20"	21"	18"	16"	15"
15"	18"	30"	15"	15"	15"	21"	23"	20"	18"	16"
16"	19"	36"	16"	16"	16"	22"	24"	21"	19"	17"
17"	21"	43"	19"	17"	17"	23"	26"	23"	20"	18"
18"	22"	52"	23"	18"	18"	24"	28"	24"	21"	20"
19"	23"	61"	27"	19"	19"	25"	29"	26"	23"	21"
20"	24"	n/a	31"	20"	20"	26"	31"	27"	24"	22"
21"	26"	n/a	36"	21"	21"	27"	33"	29"	26"	23"
22"	27"	n/a	42"	24"	22"	28"	35"	30"	27"	25"
23"	28"	n/a	48"	27"	23"	29"	37"	32"	29"	26"
24"	30"	n/a	54"	31"	24"	30"	39"	34"	30"	27"
25"	31"	n/a	61"	35"	25"	31"	41"	35"	32"	29"
26"	32"	n/a	69"	39"	26"	32"	43"	37"	33"	30"
27"	34"	n/a	77"	44"	27"	33"	45"	39"	35"	32"
28"	35"	n/a	86"	49"	28"	34"	47"	40"	36"	33"
29"	36"	n/a	n/a	54"	29"	35"	49"	42"	38"	35"
30"	38"	n/a	n/a	60"	30"	36"	51"	44"	39"	36"
31"	39"	n/a	n/a	66"	31"	37"	53"	46"	41"	38"
32"	40"	n/a	n/a	72"	32"	38"	55"	48"	43"	39"
33"	42"	n/a	n/a	79"	35"	39"	57"	50"	44"	41"
34"	43"	n/a	n/a	87"	39"	40"	60"	52"	46"	42"
35"	44"	n/a	n/a	95"	42"	41"	N/A	54"	48"	43"
36"	46"	n/a	n/a	103"	46"	42"	N/A	56"	50"	45"
37"	47"	n/a	n/a	112"	50"	43"	N/A	58"	51"	47"
38"	48"	n/a	n/a	n/a	54"	44"	N/A	60"	53"	49"
39"	50"	n/a	n/a	n/a	58"	45"	N/A	62"	55"	51"
40"	51"	n/a	n/a	n/a	63"	46"	N/A	64"	57"	53"
41"	53"	n/a	n/a	n/a	68"	47"	N/A	66"	59"	55"
42"	54"	n/a	n/a	n/a	73"	48"	N/A	68"	61"	57"
43"	55"	n/a	n/a	n/a	78"	49"	N/A	70"	63"	59"
44"	57"	n/a	n/a	n/a	84"	50"	N/A	72"	65"	61"


TABLE 7.9

TABLE 7.8

UPLIFT FOOTING SIZE BASED ON ACTUAL SITE DIMENSIONS

Trib Area (sq ft)	Wind Condition												Lattice Trib Area (sq ft)
	95 MPH Exp B	100 MPH Exp B	105 MPH Exp B	95 MPH Exp C or 110 MPH Exp B	100 MPH Exp C or 115 MPH Exp B	105 MPH Exp C or 120 MPH Exp B	110 MPH Exp C or 130 MPH Exp B	115 MPH Exp C or 130 MPH Exp B	120 MPH Exp C or 140 MPH Exp B	130 MPH Exp C or 150 MPH Exp B	140 MPH Exp C or 160 MPH Exp B		
	Required "d" of Footing (in)												
15	14"	15"	15"	16"	17"	17"	18"	18"	19"	20"	21"	21"	25
20	16"	16"	17"	18"	18"	19"	19"	20"	21"	22"	22"	23"	33
25	17"	17"	18"	19"	20"	20"	21"	22"	23"	24"	24"	25"	42
30	18"	19"	19"	20"	21"	22"	23"	23"	24"	25"	26"	26"	50
35	19"	20"	20"	21"	22"	23"	23"	24"	25"	26"	27"	27"	58
40	20"	20"	21"	22"	23"	24"	25"	25"	26"	27"	28"	28"	67
45	21"	21"	22"	23"	24"	25"	26"	26"	27"	28"	29"	29"	75
50	21"	22"	23"	24"	25"	26"	26"	27"	28"	29"	30"	30"	83
55	22"	23"	24"	25"	26"	26"	27"	28"	29"	30"	31"	31"	92
60	23"	23"	24"	25"	26"	27"	28"	29"	30"	31"	32"	32"	100
65	23"	24"	25"	26"	27"	28"	29"	30"	31"	32"	33"	33"	108
70	24"	25"	25"	27"	28"	29"	30"	31"	32"	33"	34"	34"	117
80	25"	26"	27"	28"	29"	30"	31"	32"	33"	34"	35"	35"	133
90	26"	27"	28"	29"	30"	31"	32"	33"	34"	35"	36"	36"	150
100	27"	28"	29"	30"	31"	32"	33"	34"	35"	36"	37"	37"	167
110	28"	29"	30"	31"	32"	33"	34"	35"	36"	37"	38"	38"	183
120	28"	29"	31"	32"	33"	34"	35"	36"	37"	38"	39"	39"	200
130	29"	30"	31"	33"	34"	35"	36"	37"	38"	39"	40"	40"	217
140	30"	31"	32"	34"	35"	36"	37"	38"	39"	40"	41"	41"	233
150	31"	32"	33"	34"	36"	37"	38"	39"	40"	41"	42"	42"	250
160	31"	32"	34"	35"	36"	38"	39"	40"	41"	42"	43"	43"	267
170	32"	33"	34"	36"	37"	39"	40"	41"	42"	43"	44"	44"	283
180	33"	34"	35"	37"	38"	39"	41"	42"	43"	44"	45"	45"	300
190	33"	34"	36"	37"	39"	40"	41"	42"	43"	44"	45"	46"	317
200	34"	35"	36"	38"	39"	41"	42"	43"	44"	45"	46"	47"	333
210	34"	36"	37"	39"	40"	41"	43"	44"	45"	46"	47"	48"	350
220	35"	36"	37"	39"	41"	42"	43"	44"	45"	46"	47"	48"	367
230	35"	37"	38"	40"	41"	43"	44"	45"	46"	47"	48"	49"	383
240	36"	37"	38"	40"	42"	43"	45"	46"	47"	48"	49"	50"	400
250	36"	38"	39"	41"	42"	44"	45"	46"	47"	48"	49"	50"	417
260	37"	38"	39"	41"	43"	44"	45"	46"	47"	48"	49"	50"	433
270	37"	39"	40"	42"	43"	45"	46"	47"	48"	49"	50"	51"	450
280	38"	39"	40"	42"	44"	45"	46"	47"	48"	49"	50"	51"	467
290	38"	40"	41"	43"	44"	46"	47"	48"	49"	50"	51"	52"	483
300	39"	40"	41"	43"	45"	47"	48"	49"	50"	51"	52"	53"	500
310	39"	40"	42"	44"	45"	47"	49"	50"	51"	52"	53"	54"	517
320	39"	41"	42"	44"	46"	48"	49"	51"	52"	53"	54"	55"	533
330	40"	41"	43"	45"	46"	48"	50"	51"	53"	54"	55"	56"	550
340	40"	42"	43"	45"	47"	49"	50"	52"	53"	54"	55"	56"	567
350	41"	42"	44"	46"	47"	49"	51"	52"	54"	55"	56"	57"	583
360	41"	43"	44"	46"	48"	49"	51"	53"	54"	55"	56"	57"	600

TABLE 7.10

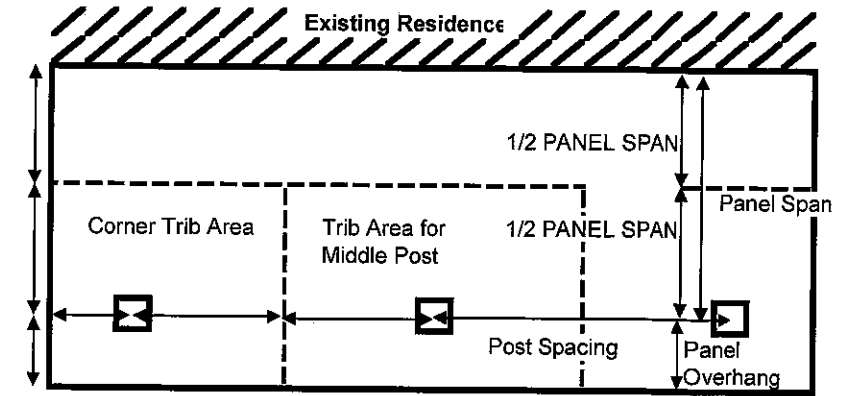


Determine Trib Area from Figure 1

INSTRUCTIONS TO USE TABLE 7.10

- TABLE DETERMINES UPLIFT FOOTING SIZE ONLY MAY BE USED FOR FREESTANDING COVERS. DOES NOT AFFECT REQUIRED CONSTRAINED FOOTING SIZE.
- DETERMINE ACTUAL TRIBUTARY AREA FOR MIDDLE POSTS THIS IS: TRIBUTARY WIDTH x POST SPACING FOR END POSTS THIS IS: (OVERHANG+ HALF OF POST SPACING) x TRIBUTARY WIDTH
- DETERMINE FOOTING SIZE FOR WIND CONDITION
- FOR LATTICE USE LAST COLUMN FOR TRIBUTARY AREA

Amerimax Exterior Home Products  
28921 US Hwy 74  
Romoland, CA 92585

Carl Putnam, P. E.  
3441 Ivylink Place  
Lynchburg, VA 24503

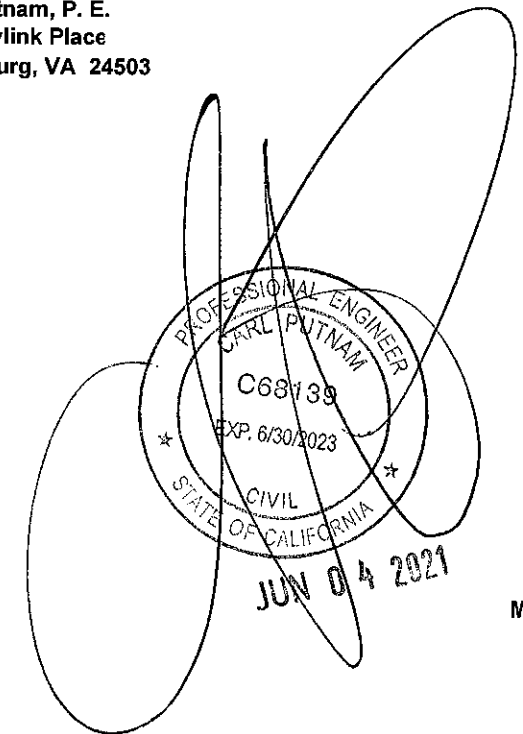

Misc4a-2018



7.0 Requirements for Surface Mounted Posts on Concrete Slabs or Footings for Single Span Attached Lattice Structures

**REQUIRED NUMBER OF POSTS FOR SINGLE SPAN LATTICE UNITS WITH SURFACE MOUNTED POSTS ON CONCRETE SLABS OR FOOTINGS**

**Table L1a: Use this table for the following headers**  
Moment Frame A = 367 lbf/ft

Wind Speed	Required Number of Posts	Post Height (ft)									
		Wind Exposure B					Wind Exposure C				
		8'	9'	10'	11'	12'	8'	9'	10'	11'	12'
MAXIMUM TRIBUTARY WIDTH ALLOWED											
95 mph	2 or 3	8'	6.5'	5'	4'	2.5'	5'	3.5'	2.5'	1.5'	0.5'
	4	13'	11'	9'	7.5'	6'	8.5'	7'	5.5'	4.5'	3'
	5	18.5'	15.5'	13.5'	11.5'	9.5'	12.5'	10.5'	8.5'	7'	5.5'
	6	23.5'	20'	17.5'	15'	13'	16'	13.5'	11.5'	9.5'	8'
	7	24'	24'	21.5'	19'	16.5'	20'	17'	14.5'	12.5'	10.5'
100 mph	2 or 3	7'	5.5'	4'	3'	2'	4'	3'	2'	1'	0.5'
	4	11.5'	9.5'	8'	6.5'	5'	7.5'	6'	4.5'	3.5'	2.5'
	5	16.5'	14'	11.5'	10'	8.5'	11'	9'	7.5'	6'	4.5'
	6	21'	18'	15.5'	13'	11.5'	14.5'	12'	10'	8.5'	7'
	7	24'	22'	19'	16.5'	14.5'	17.5'	15'	12.5'	11'	9'
105 mph	2 or 3	6'	4.5'	3.5'	2.5'	1.5'	3.5'	2.5'	1.5'	0.5'	0'
	4	10.5'	8.5'	7'	5.5'	4.5'	6.5'	5'	4'	3'	2'
	5	14.5'	12'	10'	8.5'	7'	9.5'	8'	6.5'	5'	4'
	6	19'	16'	13.5'	11.5'	10'	13'	10.5'	9'	7'	6'
	7	23'	20'	17'	15'	13'	16'	13.5'	11'	9.5'	8'
110 mph	2 or 3	5'	4'	3'	2'	1'	3'	2'	1'	0'	0'
	4	9'	7.5'	6'	4.5'	3.5'	6'	4.5'	3.5'	2'	1.5'
	5	13'	11'	9'	7.5'	6'	8.5'	7'	5.5'	4.5'	3'
	6	17'	14.5'	12'	10.5'	8.5'	11.5'	9.5'	7.5'	6.5'	5'
	7	21'	18'	15.5'	13'	11.5'	14'	12'	10'	8.5'	7'
115 mph	2 or 3	4.5'	3.5'	2.5'	1.5'	0.5'	2.5'	1.5'	0.5'	0'	0'
	4	8'	6.5'	5'	4'	3'	5'	4'	2.5'	1.5'	1'
	5	11.5'	9.5'	8'	6.5'	5'	7.5'	6'	4.5'	3.5'	2.5'
	6	15.5'	13'	11'	9'	7.5'	10'	8.5'	7'	5.5'	4'
	7	19'	16'	13.5'	11.5'	10'	13'	10.5'	9'	7.5'	6'
120 mph	2 or 3	4'	3'	2'	1'	0'	2'	1'	0.5'	0'	0'
	4	7.5'	5.5'	4.5'	3.5'	2.5'	4.5'	3.5'	2'	1.5'	0.5'
	5	10.5'	8.5'	7'	5.5'	4.5'	7'	5.5'	4'	3'	2'
	6	14'	11.5'	9.5'	8'	6.5'	9'	7.5'	6'	4.5'	3.5'
	7	17'	14.5'	12.5'	10.5'	9'	11.5'	9.5'	8'	6.5'	5'
130 mph	2 or 3	3'	2'	1'	0'	0'	1.5'	0.5'	0'	0'	0'
	4	6'	4.5'	3.5'	2.5'	1.5'	3.5'	2.5'	1.5'	0.5'	0'
	5	8.5'	7'	5.5'	4.5'	3'	5.5'	4'	3'	2'	1'
	6	11.5'	9.5'	7.5'	6.5'	5'	7.5'	6'	4.5'	3.5'	2.5'
	7	14'	12'	10'	8.5'	7'	9.5'	7.5'	6'	5'	3.5'
140 mph	2 or 3	2'	1.5'	0.5'	0'	0'	1'	0'	0'	0'	0'
	4	4.5'	3.5'	2.5'	1.5'	0.5'	2.5'	1.5'	0.5'	0'	0'
	5	7'	5.5'	4.5'	3'	2'	4.5'	3'	2'	1'	0.5'
	6	9.5'	7.5'	6'	5'	4'	6'	4.5'	3.5'	2.5'	1.5'
	7	12'	10'	8'	6.5'	5.5'	8'	6'	5'	3.5'	2.5'

**Table L1b: Use this table for the following headers**  
Moment Frame B = 489 lbf/ft

Wind Speed	Required Number of Posts	Post Height (ft)									
		Wind Exposure B					Wind Exposure C				
		8'	9'	10'	11'	12'	8'	9'	10'	11'	12'
MAXIMUM TRIBUTARY WIDTH ALLOWED											
95 mph	2 or 3	11.5'	9.5'	7.5'	6.5'	5'	7.5'	6'	4.5'	3.5'	2.5'
	4	18.5'	15.5'	13.5'	11.5'	9.5'	12.5'	10.5'	8.5'	7'	5.5'
	5	24'	22'	19'	16.5'	14'	17.5'	14.5'	12.5'	10.5'	9'
	6	24'	24'	24'	21.5'	19'	22.5'	19'	16.5'	14'	12'
	7	24'	24'	24'	24'	23.5'	24'	23.5'	20.5'	18'	15.5'
100 mph	2 or 3	10'	8'	6.5'	5.5'	4'	6.5'	5'	4'	2.5'	1.5'
	4	16.5'	14'	11.5'	10'	8.5'	11'	9'	7.5'	6'	4.5'
	5	22.5'	19.5'	16.5'	14.5'	12.5'	15.5'	13'	11'	9'	7.5'
	6	24'	24'	21.5'	19'	16.5'	20'	17'	14.5'	12.5'	10.5'
	7	24'	24'	24'	23.5'	20.5'	24'	21'	18'	15.5'	13.5'
105 mph	2 or 3	9'	7'	5.5'	4.5'	3.5'	5.5'	4'	3'	2'	1'
	4	14.5'	12'	10'	8.5'	7'	9.5'	8'	6.5'	5'	4'
	5	20.5'	17.5'	15'	12.5'	11'	14'	11.5'	9.5'	8'	6.5'
	6	24'	22.5'	19.5'	17'	14.5'	18'	15'	13'	11'	9.5'
	7	24'	24'	24'	21'	18.5'	22'	18.5'	16'	14'	12'
110 mph	2 or 3	8'	6'	5'	3.5'	2.5'	5'	3.5'	2.5'	1.5'	0.5'
	4	13'	11'	9'	7.5'	6'	8.5'	7'	5.5'	4.5'	3'
	5	18.5'	15.5'	13'	11'	9.5'	12.5'	10'	8.5'	7'	5.5'
	6	23.5'	20'	17.5'	15'	13'	16'	13.5'	11.5'	9.5'	8'
	7	24'	24'	21.5'	18.5'	16.5'	20'	17'	14.5'	12.5'	10.5'
115 mph	2 or 3	7'	5.5'	4'	3'	2'	4'	3'	2'	1'	0.5'
	4	11.5'	9.5'	8'	6.5'	5'	7.5'	6'	4.5'	3.5'	2.5'
	5	16.5'	14'	12'	10'	8.5'	11'	9'	7.5'	6'	5'
	6	21.5'	18'	15.5'	13.5'	11.5'	14.5'	12'	10'	8.5'	7'
	7	24'	22.5'	19.5'	17'	14.5'	18'	15'	13'	11'	9.5'
120 mph	2 or 3	6'	5'	3.5'	2.5'	1.5'	3.5'	2.5'	1.5'	0.5'	0'
	4	10.5'	8.5'	7'	5.5'	4.5'	7'	5.5'	4'	3'	2'
	5	15'	12.5'	10.5'	9'	7.5'	10'	8'	6.5'	5'	4'
	6	19.5'	16.5'	14'	12'	10'	13'	11'	9'	7.5'	6'
	7	23.5'	20.5'	17.5'	15'	13'	16'	13.5'	11.5'	9.5'	8'
130 mph	2 or 3	5'	3.5'	2.5'	1.5'	0.5'	2.5'	1.5'	1'	0'	0'
	4	8.5'	7'	5.5'	4.5'	3'	5.5'	4'	3'	2'	1'
	5	12.5'	10'	8.5'	7'	5.5'	8'	6.5'	5'	4'	3'
	6	16'	13.5'	11.5'	9.5'	8'	11'	9'	7'	6'	4.5'
	7	20'	17'	14.5'	12.5'	10.5'	13.5'	11'	9.5'	7.5'	6.5'
140 mph	2 or 3	4'	2.5'	1.5'	1'	0'	2'	1'	0.5'	0'	0'
	4	7'	5.5'	4.5'	3'	2'	4.5'	3'	2'	1'	0.5'
	5	10.5'	8.5'	7'	5.5'	4.5'	6.5'	5'	4'	3'	2'
	6	13.5'	11.5'	9.5'	8'	6.5'	9'	7'	5.5'	4.5'	3.5'
	7	16.5'	14'	12'	10'	8.5'	11'	9'	7.5'	6'	5'

**Seismic Size Requirements**

Table L2a Moment Frame A			Table L2b Moment Frame B		
Ss	Size Allowed (cubic feet)		Ss	Size Allowed (cubic feet)	
20%	1575		20%	2099	
30%	1050		30%	1399	
40%	852	***	40%	1135	
50%	720	**	50%	960	***
60%	600	*	60%	800	
70%	514		70%	685	
80%	525		80%	700	**
90%	467		90%	622	
100%	420		100%	560	*
110%	382		110%	509	
120%	350		120%	466	
130%	323		130%	431	
140%	300		140%	400	
150%	280		150%	373	

- Directions for using Seismic Table L2a, L2b, L2c or L2d\*\*\*\*\***
- Determine Tributary width
  - Determine width of structure
  - Determine height of structure
  - Determine number of posts structure has
  - Determine Ss for your area (contact your local building department)\*\*\*\*
  - Choose Table L2a-d based on the header
  - Determine the maximum size allowed on the chart
  - Multiply #1, #2 and #3 and divide by #4\*\*\*\*\*
  - If #8 is lower than #7 the structure is OK for seismic
  - If the " Ss is over 150% but less than 215% use 150%


\*no check needed for Patio Covers attached to slab under these conditions  
 \*\*no check needed for Patio Covers that are 10' tall attached to slab under these conditions  
 \*\*\*no check needed for Patio Covers that are 8' tall attached to slab under these conditions  
 \*\*\*\*Ss is the Maximum Considered Earthquake Ground Motion (0.2 sec) mapped on Figure 1613.3.1(1) in the 2018 IBC  
 \*\*\*\*\* Alternatively, divide by these numbers  
 For 2 post Structures divide by 3  
 For 3 post Structures divide by 3  
 For 4 post Structures divide by 4.5  
 For 5 post Structures divide by 6  
 For all others add 1.5 to number of posts  
 \*\*\*\*\* Not for use in areas with flat roof snow loads exceeds 30 psf.

- Moment Frame A: Detail L26, 4 screws, A=5", B= 7", sideplates = 0.024"
- Moment Frame A: Detail L12, 4 screws per header, A=2", B= 5", DBL HEADER
- Moment Frame A: Detail L8, 6 screws, A=2", B= 6", SINGLE STEEL C
- Moment Frame B: Detail L26, 4 screws, A=5", B= 7", sideplates = 0.032"
- Moment Frame B: Detail L26, 6 screws, A=5", B= 7", sideplates = 0.024"
- Moment Frame C: Detail L26, 8 screws, A=4", B= 6", sideplates = 0.024"
- Moment Frame C: Detail L12, 4 screws per header, A=2", B= 7", DBL HEADER
- Moment Frame C: Detail L12, 6 screws per header, A=2", B= 5", DBL HEADER
- Moment Frame C: Detail L8, 4 BOLTS, A=2", B= 7", SINGLE STEEL C
- Moment Frame C: Detail L8, 10 screws, A=2", B= 6", SINGLE STEEL C
- Moment Frame D: Detail L8, 4 BOLTS, A=2", B= 5", DBL STEEL C
- Moment Frame D: Detail L8, 6 screws per header, A=2", B= 6", DBL STEEL C

Tables L1 and L2 need to be checked for surface mount concrete attachment

Amerimax Exterior Home Products  
 28921 US Hwy 74  
 Romoland, CA 92585

Carl Putnam, P. E.  
 3441 Ivylink Place  
 Lynchburg, VA 24503

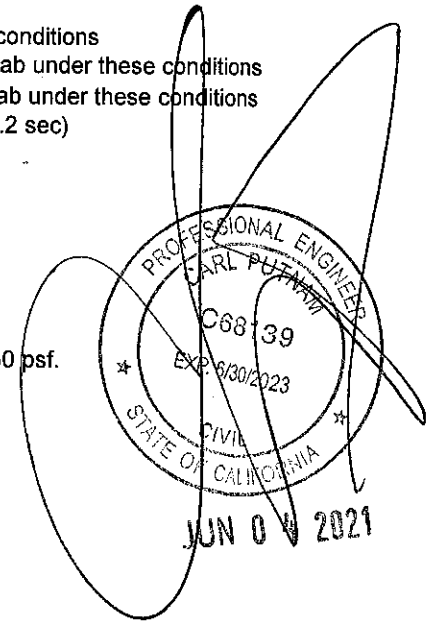



7.0 Requirements for Surface Mounted Posts on Concrete Slabs or Footings for Single Span Attached Lattice Structures

REQUIRED NUMBER OF POSTS FOR SINGLE SPAN LATTICE UNITS WITH SURFACE MOUNTED POSTS ON CONCRETE SLABS OR FOOTINGS

Table L1c: Use this table for the following headers  
Moment Frame C = 536 lbf/ft

Wind Speed	Required Number of Posts	Post Height (ft)									
		Wind Exposure B					Wind Exposure C				
		8'	9'	10'	11'	12'	8'	9'	10'	11'	12'
95 mph	2 or 3	12.5'	10.5'	9'	7'	6'	8.5'	6.5'	5.5'	4'	3'
	4	20.5'	17.5'	15'	13'	11'	14'	11.5'	9.5'	8'	6.5'
	5	24'	24'	21'	18.5'	16'	19.5'	16.5'	14'	12'	10'
	6	24'	24'	24'	24'	21'	24'	21'	18.5'	16'	14'
	7	24'	24'	24'	24'	24'	24'	24'	22.5'	20'	17.5'
100 mph	2 or 3	11.5'	9.5'	7.5'	6'	5'	7.5'	6'	4.5'	3.5'	2.5'
	4	18'	15.5'	13'	11'	9.5'	12'	10'	8.5'	7'	5.5'
	5	24'	21.5'	18.5'	16'	14'	17'	14.5'	12.5'	10.5'	9'
	6	24'	24'	24'	21'	18.5'	22'	19'	16'	14'	12'
	7	24'	24'	24'	24'	23'	24'	23.5'	20'	17.5'	15.5'
105 mph	2 or 3	10'	8'	6.5'	5'	4'	6.5'	5'	3.5'	2.5'	1.5'
	4	16'	13.5'	11.5'	9.5'	8'	11'	9'	7.5'	6'	4.5'
	5	22.5'	19'	16.5'	14.5'	12.5'	15.5'	13'	11'	9'	7.5'
	6	24'	24'	21.5'	19'	16.5'	20'	17'	14.5'	12.5'	10.5'
	7	24'	24'	24'	23.5'	20.5'	24'	21'	18'	15.5'	13.5'
110 mph	2 or 3	9'	7'	5.5'	4.5'	3.5'	5.5'	4'	3'	2'	1'
	4	14.5'	12'	10'	8.5'	7'	9.5'	8'	6.5'	5'	4'
	5	20.5'	17.5'	15'	12.5'	11'	14'	11.5'	9.5'	8'	6.5'
	6	24'	22.5'	19.5'	17'	14.5'	18'	15'	13'	11'	9'
	7	24'	24'	24'	21'	18.5'	22'	18.5'	16'	14'	12'
115 mph	2 or 3	8'	6.5'	5'	3.5'	2.5'	5'	3.5'	2.5'	1.5'	0.5'
	4	13'	11'	9'	7.5'	6'	8.5'	7'	5.5'	4.5'	3'
	5	18.5'	15.5'	13'	11.5'	9.5'	12.5'	10'	8.5'	7'	5.5'
	6	23.5'	20'	17.5'	15'	13'	16'	13.5'	11.5'	9.5'	8'
	7	24'	24'	21.5'	19'	16.5'	20'	17'	14.5'	12.5'	10.5'
120 mph	2 or 3	7'	5.5'	4'	3'	2'	4.5'	3'	2'	1'	0.5'
	4	12'	10'	8'	6.5'	5.5'	7.5'	6'	5'	3.5'	2.5'
	5	16.5'	14'	12'	10'	8.5'	11'	9'	7.5'	6'	5'
	6	21.5'	18.5'	15.5'	13.5'	11.5'	14.5'	12'	10'	8.5'	7'
	7	24'	22.5'	19.5'	17'	15'	18'	15'	13'	11'	9.5'
130 mph	2 or 3	5.5'	4.5'	3'	2'	1'	3.5'	2'	1.5'	0.5'	0'
	4	9.5'	8'	6.5'	5'	4'	6'	5'	3.5'	2.5'	1.5'
	5	14'	11.5'	9.5'	8'	6.5'	9'	7.5'	6'	4.5'	3.5'
	6	18'	15'	13'	11'	9.5'	12'	10'	8'	6.5'	5.5'
	7	22'	19'	16'	14'	12'	15'	12.5'	10.5'	9'	7.5'
140 mph	2 or 3	4.5'	3.5'	2'	1.5'	0.5'	2.5'	1.5'	0.5'	0'	0'
	4	8'	6.5'	5'	4'	3'	5'	3.5'	2.5'	1.5'	1'
	5	11.5'	9.5'	8'	6.5'	5'	7.5'	6'	4.5'	3.5'	2.5'
	6	15'	12.5'	10.5'	9'	7.5'	10'	8'	6.5'	5.5'	4'
	7	18.5'	16'	13.5'	11.5'	9.5'	12.5'	10.5'	8.5'	7'	6'

Table L1d: Use this table for the following headers  
Moment Frame D = 829 lbf/ft

Wind Speed	Required Number of Posts	Post Height (ft)									
		Wind Exposure B					Wind Exposure C				
		8'	9'	10'	11'	12'	8'	9'	10'	11'	12'
95 mph	2 or 3	21'	18'	15.5'	13.5'	11.5'	14.5'	12'	10'	8.5'	7'
	4	24'	24'	24'	22'	19'	23'	19.5'	17'	14.5'	12.5'
	5	24'	24'	24'	24'	24'	24'	24'	23.5'	20.5'	18'
	6	24'	24'	24'	24'	24'	24'	24'	24'	24'	23.5'
	7	24'	24'	24'	24'	24'	24'	24'	24'	24'	24'
100 mph	2 or 3	19'	16'	13.5'	11.5'	10'	12.5'	10.5'	8.5'	7'	6'
	4	24'	24'	22'	19.5'	17'	20.5'	17.5'	15'	12.5'	11'
	5	24'	24'	24'	24'	24'	24'	24'	21'	18'	16'
	6	24'	24'	24'	24'	24'	24'	24'	24'	23.5'	21'
	7	24'	24'	24'	24'	24'	24'	24'	24'	24'	24'
105 mph	2 or 3	17'	14'	12'	10'	8.5'	11.5'	9.5'	7.5'	6'	5'
	4	24'	23'	19.5'	17'	15'	18'	15.5'	13'	11'	9.5'
	5	24'	24'	24'	24'	21.5'	24'	21.5'	18.5'	16'	14'
	6	24'	24'	24'	24'	24'	24'	24'	24'	21'	18.5'
	7	24'	24'	24'	24'	24'	24'	24'	24'	24'	23'
110 mph	2 or 3	15'	12.5'	10.5'	9'	7.5'	10'	8'	6.5'	5.5'	4'
	4	24'	20.5'	17.5'	15.5'	13.5'	16.5'	14'	11.5'	10'	8.5'
	5	24'	24'	24'	21.5'	19'	22.5'	19.5'	16.5'	14.5'	12.5'
	6	24'	24'	24'	24'	24'	24'	24'	21.5'	19'	16.5'
	7	24'	24'	24'	24'	24'	24'	24'	24'	23.5'	20.5'
115 mph	2 or 3	13.5'	11.5'	9.5'	8'	6.5'	9'	7'	6'	4.5'	3.5'
	4	21.5'	18.5'	16'	13.5'	12'	15'	12.5'	10.5'	8.5'	7'
	5	24'	24'	22.5'	19.5'	17'	20.5'	17.5'	15'	13'	11'
	6	24'	24'	24'	24'	22.5'	24'	22.5'	19.5'	17'	15'
	7	24'	24'	24'	24'	24'	24'	24'	24'	21'	18.5'
120 mph	2 or 3	12.5'	10'	8.5'	7'	5.5'	8'	6.5'	5'	4'	3'
	4	19.5'	16.5'	14.5'	12'	10.5'	13.5'	11'	9'	7.5'	6.5'
	5	24'	23.5'	20'	17.5'	15.5'	18.5'	16'	13.5'	11.5'	10'
	6	24'	24'	24'	23'	20'	24'	20.5'	17.5'	15.5'	13.5'
	7	24'	24'	24'	24'	24'	24'	24'	22'	19'	16.5'
130 mph	2 or 3	10'	8'	6.5'	5.5'	4'	6.5'	5'	4'	2.5'	2'
	4	16.5'	14'	11.5'	10'	8.5'	11'	9'	7.5'	6'	4.5'
	5	22.5'	19.5'	16.5'	14.5'	12.5'	15.5'	13'	11'	9'	7.5'
	6	24'	24'	21.5'	19'	16.5'	20'	17'	14.5'	12.5'	10.5'
	7	24'	24'	24'	23.5'	21'	24'	21'	18'	15.5'	13.5'
140 mph	2 or 3	8.5'	6.5'	5.5'	4'	3'	5'	4'	3'	2'	1'
	4	14'	11.5'	9.5'	8'	6.5'	9'	7.5'	6'	4.5'	3.5'
	5	19.5'	16.5'	14'	12'	10'	13'	11'	9'	7.5'	6'
	6	24'	21'	18.5'	16'	14'	17'	14.5'	12'	10'	8.5'
	7	24'	24'	22.5'	20'	17.5'	21'	17.5'	15'	13'	11'

Seismic Size Requirements

Table L2c Moment Frame C		Table L2d Moment Frame D	
Ss	Size Allowed (cubic feet)	Ss	Size Allowed (cubic feet)
20%	2301	20%	3559
30%	1534	30%	2372
40%	1244	40%	1924
50%	1052	50%	1627
60%	877	60%	1356
70%	751	70%	1162
80%	767	80%	1186
90%	682	90%	1054
100%	614	100%	949
110%	558	110%	863
120%	511	120%	791
130%	472	130%	730
140%	438	140%	678
150%	409	150%	633

Directions for using Seismic Table L2a, L2b, L2c or L2d\*\*\*\*\*

- Determine Tributary width
- Determine width of structure
- Determine height of structure
- Determine number of posts structure has
- Determine Ss for your area (contact your local building department)\*\*\*\*
- Choose Table L2a-d based on the header
- Determine the maximum size allowed on the chart
- Multiply #1, #2 and #3 and divide by #4\*\*\*\*\*
- If #8 is lower than #7 the structure is OK for seismic
- If the " Ss is over 150% but less than 215% use 150%


\*no check needed for Patio Covers attached to slab under these conditions  
 \*\*no check needed for Patio Covers that are 10' tall attached to slab under these conditions  
 \*\*\*no check needed for Patio Covers that are 8' tall attached to slab under these conditions  
 \*\*\*\*Ss is the Maximum Considered Earthquake Ground Motion (0.2 sec) mapped on Figure 1613.3.1(1) in the 2018 IBC  
 \*\*\*\*\* Alternatively, divide by these numbers  
 For 2 post Structures divide by 3  
 For 3 post Structures divide by 3  
 For 4 post Structures divide by 4.5  
 For 5 post Structures divide by 6  
 For all others add 1.5 to number of posts  
 \*\*\*\*\* Not for use in areas with flat roof snow loads exceeds 30 psf.


- Moment Frame A: Detail L26, 4 screws, A=5", B= 7", sideplates = 0.024"
- Moment Frame A: Detail L12, 4 screws per header, A=2", B= 5", DBL HEADER
- Moment Frame A: Detail L8, 6 screws, A=2", B= 6", SINGLE STEEL C
- Moment Frame B: Detail L26, 4 screws, A=5", B= 7", sideplates = 0.032"
- Moment Frame B: Detail L26, 6 screws, A=5", B= 7", sideplates = 0.024"
- Moment Frame C: Detail L26, 8 screws, A=4", B= 6", sideplates = 0.024"
- Moment Frame C: Detail L12, 4 screws per header, A=2", B= 7", DBL HEADER
- Moment Frame C: Detail L12, 6 screws per header, A=2", B= 5", DBL HEADER
- Moment Frame C: Detail L8, 4 BOLTS, A=2", B= 7", SINGLE STEEL C
- Moment Frame C: Detail L8, 10 screws, A=2", B= 6", SINGLE STEEL C
- Moment Frame D: Detail L8, 4 BOLTS, A=2", B= 5", DBL STEEL C
- Moment Frame D: Detail L8, 6 screws per header, A=2", B= 6", DBL STEEL C

Tables L1 and L2 need to be checked for surface mount concrete attachment

Amerimax Exterior Home Products  
 28921 US Hwy 74  
 Romoland, CA 92585

Carl Putnam, P. E.  
 3441 Ivylink Place  
 Lynchburg, VA 24503

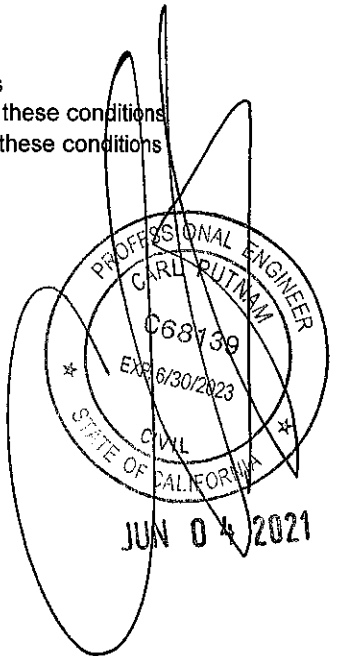

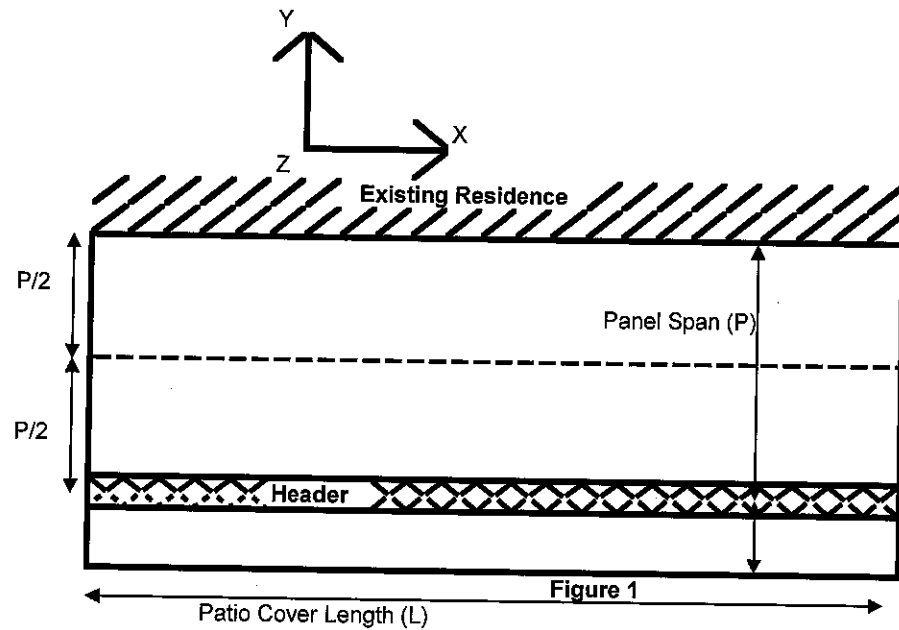

**Determine Snow Loads on Existing Structure**

- 1 Determine Roof Snow/Live Load, S. See General Note 3.
- 2 Dead Load = 1 psf
- 3 Add Dead and Live/Snow Loads, multiply by half of Panel Span  
 $Wall Load = (D + S) P / 2$
- 4 Result is wall load in pounds per linear foot.

**Determine Wind Loads on Existing Structure**

- 1 Determine Wind Load, W+ or W-. See Table 1
- 2 Add 1 psf to down load, subtract 0.6 psf from up load
- 3 Multiply W+ or W- by half of Panel Span  
 $Wall Load = W P / 2$
- 4 Result is wall load in pounds per linear foot.
- 5 Maximum Shear Load in X direction is 497 lbf (170 mph Exposure C, 12'-11" Panel Span)  
 Max load in Y direction (towards house) is 77 plf (170 mph Exp C, 10" I beam)  
 Max load in Y direction due to force couple resisting lateral is 108 plf  
 (170 mph Exp C, Projection = Width)

**Determine Seismic Loads on Existing Structure (Excludes Roof Snow Load over 30 psf)**

- 1 Vertical Loads and Horizontal Loads = maximum of 1 psf

**Combination Loads based on Equation 16-11**

- 1 Determine Combination Load, C. See Table 2
- 3 Multiply C by half of Panel Span  
 $Wall Load = C P / 2$
- 4 Result is wall load in pounds per linear foot.

Kz	0.7	0.98	height factor, Exposure B and C
Kzt	1		Topographic factor
Kd	0.85		Wind Directionality factor
I	1		Importance Factor

GCp net (up)	1.28	Net Pressure Coefficient uplift
GCP net( down)	0.78	Net Pressure Coefficient down
Dead	1 psf	


Wind Speed (mph)	Exposure	qh (psf)	Design Wind	Design Wind
			Down Load (psf) 0.6xW+	Up Load (psf) 0.6xW-
95	B	13.7	9.6	10.6
100	B	15.2	9.6	11.7
105	B	16.8	9.6	12.9
110	B	18.4	9.6	14.2
115	B	20.1	9.6	15.5
120	B	21.9	10.3	16.8
130	B	25.7	12.0	19.8
140	B	29.9	14.0	22.9
150	B	34.3	16.0	26.3
160	B	39.0	18.2	29.9
170	B	44.0	20.6	33.8
95	C	19.2	9.6	14.8
100	C	21.3	10.0	16.4
105	C	23.5	11.0	18.1
110	C	25.8	12.1	19.8
115	C	28.2	13.2	21.7
120	C	30.7	14.4	23.6
130	C	36.0	16.9	27.7
140	C	41.8	19.6	32.1
150	C	48.0	22.5	36.8
160	C	54.6	25.5	41.9
170	C	61.6	28.8	47.3

TABLE 1

Wind Speed (mph)	Exposure	Live Loads (psf)		Ground Snow Loads (psf)						
		10	20	15	25	30	35.7	42	50	60
Roof Live /Snow Loads		10	20	15	21	25.2	30.0	35.3	42	50.4
95	B	15.7	23.2	19.5	24.0	27.1	30.7	34.7	39.7	46.0
100	B	15.7	23.2	19.5	24.0	27.1	30.7	34.7	39.7	46.0
105	B	15.7	23.2	19.5	24.0	27.1	30.7	34.7	39.7	46.0
110	B	15.7	23.2	19.5	24.0	27.1	30.7	34.7	39.7	46.0
115	B	15.7	23.2	19.5	24.0	27.1	30.7	34.7	39.7	46.0
120	B	16.2	23.7	19.9	24.4	27.6	31.2	35.2	40.2	46.5
130	B	17.5	25.0	21.3	25.8	28.9	32.5	36.5	41.5	47.8
140	B	19.0	26.5	22.7	27.2	30.4	34.0	37.9	43.0	49.3
150	B	20.5	28.0	24.3	28.8	31.9	35.5	39.5	44.5	50.8
160	B	22.2	29.7	25.9	30.4	33.6	37.2	41.1	46.2	52.5
170	B	24.0	31.5	27.7	32.2	35.4	38.9	42.9	48.0	54.3
95	C	15.7	23.2	19.5	24.0	27.1	30.7	34.7	39.7	46.0
100	C	16.0	23.5	19.7	24.2	27.4	31.0	34.9	40.0	46.3
105	C	16.8	24.3	20.5	25.0	28.2	31.7	35.7	40.8	47.1
110	C	17.6	25.1	21.3	25.8	29.0	32.5	36.5	41.6	47.9
115	C	18.4	25.9	22.1	26.6	29.8	33.4	37.4	42.4	48.7
120	C	19.3	26.8	23.0	27.5	30.7	34.3	38.2	43.3	49.6
130	C	21.1	28.6	24.9	29.4	32.5	36.1	40.1	45.1	51.4
140	C	23.2	30.7	26.9	31.4	34.6	38.2	42.1	47.2	53.5
150	C	25.3	32.8	29.1	33.6	36.7	40.3	44.3	49.3	55.6
160	C	27.7	35.2	31.4	35.9	39.1	42.7	46.6	51.7	58.0
170	C	30.1	37.6	33.9	38.4	41.5	45.1	49.1	54.1	60.4

Amerimax Exterior Home Products  
 28921 US Hwy 74  
 Romoland, CA 92585

Carl Putnam, P. E.  
 3441 Ivylink Place  
 Lynchburg, VA 24503  
 (434) 384-2514  
[carlputnam@comcast.net](mailto:carlputnam@comcast.net)

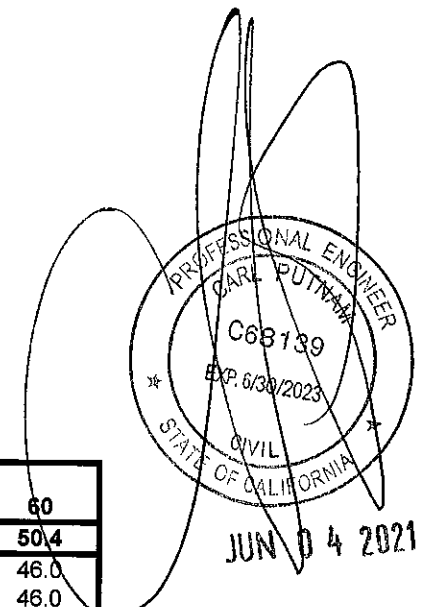


Misc6-2018

Amerimax Structural Properties of Beams, Fascia, Panels and Rafters for Use by Design Professionals

ASSUMES FULL LATERAL BRACING  
 Max Allowable Moment (top in compression) (lbf\*ft)  
 Max Allowable Moment (bottom in compression) (lbf\*ft)

Structural Element	I (in^4) top in compression	I (in^4) bottom in compression	Max Allowable Moment (top in compression) (lbf*ft)	Max Allowable Moment (bottom in compression) (lbf*ft)	Max Allowable Shear (lbf)	Material	E (ksi)	Ftu or Fu (ksi)	Fty or Fy (ksi)	Fcy (ksi)
<b>Rafters</b>										
0.024"x2"x6.625" Aluminum Rafter	2.283	same	298	278	166	3004H34	10100	32	25	22
0.032"x2"x6.625" Aluminum Rafter	3.072	same	563	504	398	3004H34	10100	32	25	22
0.040"x2"x6.625" Aluminum Rafter	3.873	same	866	801	784	3004H34	10100	32	25	22
0.042"x3"x8" Aluminum Rafter	7.907	same	1164	1038	747	3004H34	10100	32	25	22
0.024"x3"x3" Aluminum Rafter	0.445	same	130	124	380	3105H25	10100	23	19	17
0.040"x3"x3" Aluminum Rafter	0.754	same	389	343	1506	3105H25	10100	23	19	17
<b>Solid Panels</b>										
0.018"x2.5"x6" Aluminum Panel	0.265	same	138	109	779	3004H36	10100	35	28	25
0.024"x2.5"x6" Aluminum Panel	0.353	same	253	169	927	3004H34	10100	32	25	22
0.032"x2.5"x6" Aluminum Panel	0.471	same	385	253	1236	3004H34	10100	32	25	22
0.036"x2.5"x6" Aluminum Panel	0.53	same	439	301	1391	3004H34	10100	32	25	22
0.018"x3.5"x12" Aluminum Panel	0.545	same	316	352	450	3004H36	10100	35	28	25
0.024"x3.5"x12" Aluminum Panel	0.727	same	409	473	536	3004H34	10100	32	25	22
0.032"x3.5"x12" Aluminum Panel	0.969	same	568	692	715	3004H34	10100	32	25	22
0.036"x3.5"x12" Aluminum Panel	1.09	same	652	808	804	3004H34	10100	32	25	22
0.018"x2.5"x12" Aluminum Panel	0.25	same	184	141	246	3004H36	10100	35	28	25
0.024"x2.5"x12" Aluminum Panel	0.334	same	315	241	584	3004H36	10100	35	28	25
0.032"x2.5"x12" Aluminum Panel	0.445	same	484	371	1384	3004H36	10100	35	28	25
0.036"x2.5"x12" Aluminum Panel	0.501	same	511	392	1970	3004H34	10100	32	25	22
0.018"x2"x6" Aluminum Panel	0.154	same	133	150	528	3004H36	10100	35	28	25
0.024"x2"x6" Aluminum Panel	0.205	same	196	207	629	3004H34	10100	32	25	22
0.032"x2"x6" Aluminum Panel	0.273	same	294	318	838	3004H34	10100	32	25	22
0.036"x2"x6" Aluminum Panel	0.307	same	333	382	943	3004H34	10100	32	25	22
<b>Aluminum Headers</b>										
0.042"x3"x8" Aluminum Header	7.907	same	1164	1038	747	3004H34	10100	32	25	22
Double 0.042"x3"x8" Aluminum Header	15.814	same	2328	2076	1494	3004H34	10100	32	25	22
Double 0.040"x2"x6.625" Aluminum Header	7.746	same	1732	1602	1568	3004H34	10100	32	25	22
<b>Aluminum Fascia</b>										
California Extruded Fascia	3.09	same	1160	1536	5478	6063T6	10100	30	25	25
Classic Extruded Fascia	6.03	same	3089	3842	13837	6061T6	10100	38	35	35
5.5" Extruded Fascia	3.46	same	1564	1538	3414	6105T5	10100	38	35	35
Alaskan Fascia	3.95	same	2349	1905	4963	6105T5	10100	38	35	35
4"x3" Ibeam	3.617	same	2445	2580	2106	6063T6	10100	30	25	25
7"x4" Ibeam	13.857	same	6718	6718	4244	6105T5	10100	38	35	35
<b>Steel Headers</b>										
0.041"x3"x3" Steel Cloverleaf	0.77	same	1028	1028	6694	ASTM A653 Grade 40	29000	55	40	
Double 0.041"x3"x3" Steel Cloverleaf	1.54	same	2056	2056	13388	ASTM A653 Grade 40	29000	55	40	
12 Gauge Steel C Beam	13.28	same	8549	8549	11504	ASTM A653 Grade 50	29000	65	50	
14 Gauge Steel C Beam	9.04	same	5821	5821	4029	ASTM A653 Grade 50	29000	65	50	
16 Gauge Steel C Beam	7.46	same	4805	4805	2394	ASTM A653 Grade 50	29000	65	50	
Double 12 Gauge Steel C Beam	26.56	same	17098	17098	23008	ASTM A653 Grade 50	29000	65	50	
Double 14 Gauge Steel C Beam	18.08	same	11642	11642	8058	ASTM A653 Grade 50	29000	65	50	
Double 16 Gauge Steel C Beam	14.92	same	9610	9610	4788	ASTM A653 Grade 50	29000	65	50	

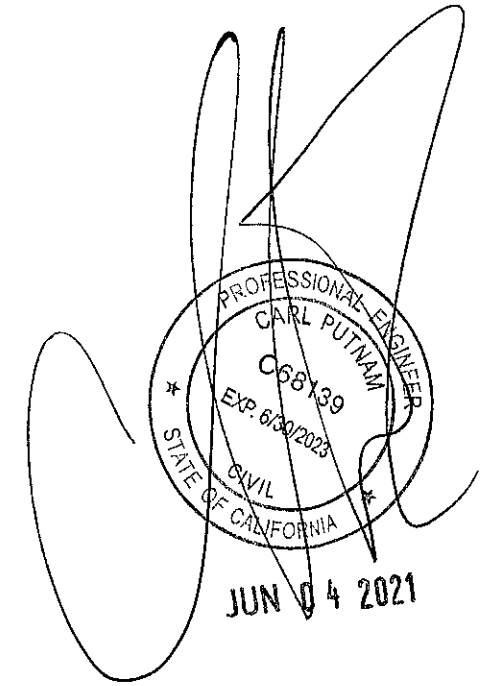

Misc7-2018

CONSTRAINED FOOTING SIZE d (IN)	REQUIRED SLAB AREA PER POST (SQUARE FEET)		
	3.5"	5.5"	7.25"
20	26	17	13
21	31	20	15
22	36	23	17
23	41	26	20
24	47	30	23
25	54	34	26
26	61	39	30
27	70	44	34
28	78	50	38
29	88	56	42
30	98	63	48
31	110	70	53
32	122	78	59
33	135	86	65
34	149	95	72
35	164	104	79
36	180	115	87
37	198	126	95
38	216	137	104
39	236	150	114
40	257	163	124
41	279	178	135
42	303	193	146
43	328	208	158
44	354	225	171
45	382	243	185
46	412	262	199
47	443	282	214
48	476	303	230
49	511	325	247
50	547	348	264

**Amerimax Exterior Home Products  
28921 US Hwy 74  
Romoland, CA 92585**

**Carl Putnam, P. E.  
3441 Ivylink Place  
Lynchburg, VA 24503**

**Misc8-2018**

